

Proposed New Addition For:  
**17 Sterling Forest Ln.**  
Montebello  
Rockland County, New York

INDEX

- A-101 FOUNDATION AND FOOTING PLAN
- A-102 BASEMENT FLOOR PLAN
- A-103 FIRST FLOOR PLAN WITH DETAILS
- A-104 SECOND FLOOR PLAN
- A-105 NORTH SOUTH WEST EAST SIDES ELEVATION
- A-106 ROOF PLAN WITH TRUSS SIGN AND TYP. WALL SECTION
- A-107 TYPICAL DECK AND BRACING DETAILS
- E-101 BASEMENT LEVEL ELECTRIC PLAN
- E-102 FIRST AND SECOND FLOORS ELECTRIC PLAN
- PL-01 PLUMBING RISER DIAGRAM AND REQUIREMENTS
- SP-01 GENERAL NOTES AND TABLES
- PLOT PLOT PLAN



MONROE, N.Y. 10950  
(845) 492-1783  
Email: office@szdrawings.com

PROJECT:

Proposed New Addition For:  
**17 Sterling Forest Ln.**  
Montebello  
Rockland County, New York

DRAWN BY:	Shlome Glauber
DATE:	7/15/2024
DATE:	8/2/2024
DATE:	8/28/2024
DATE:	1/13/2025
DATE:	3/10/2025

RODGER BRADLEY,  
ARCHITECTS  
NYS LIC. NO. 013-832  
50 PLATT'S HILL ROAD  
NEWTOWN, CT 06470  
T: 203.426.9918  
Email: rbraley2@sbeglobal.net



DESCRIPTION:

**COVER**

SCALE | AS NOTED

**PROJECT:**

Proposed New Addition For:  
**17 Sterling Forest Ln.**  
Montebello  
Rockland County, New York

<b>DRAWN BY:</b>	Shlome Glauber
<b>DATE:</b>	7/15/2024
<b>DATE:</b>	8/2/2024
<b>DATE:</b>	8/28/2024
<b>DATE:</b>	1/13/2025
<b>DATE:</b>	3/10/2025


**RODGER BRADLEY,**  
ARCHITECTS  
NYS LIC. NO. 013-832  
50 PLATT'S HILL ROAD  
NEWTOWN, CT 06470  
T: 203.426.9918  
Email: rbraley2@sbcglobal.net




**DESCRIPTION:**

**A-101**


**SCALE** AS NOTED

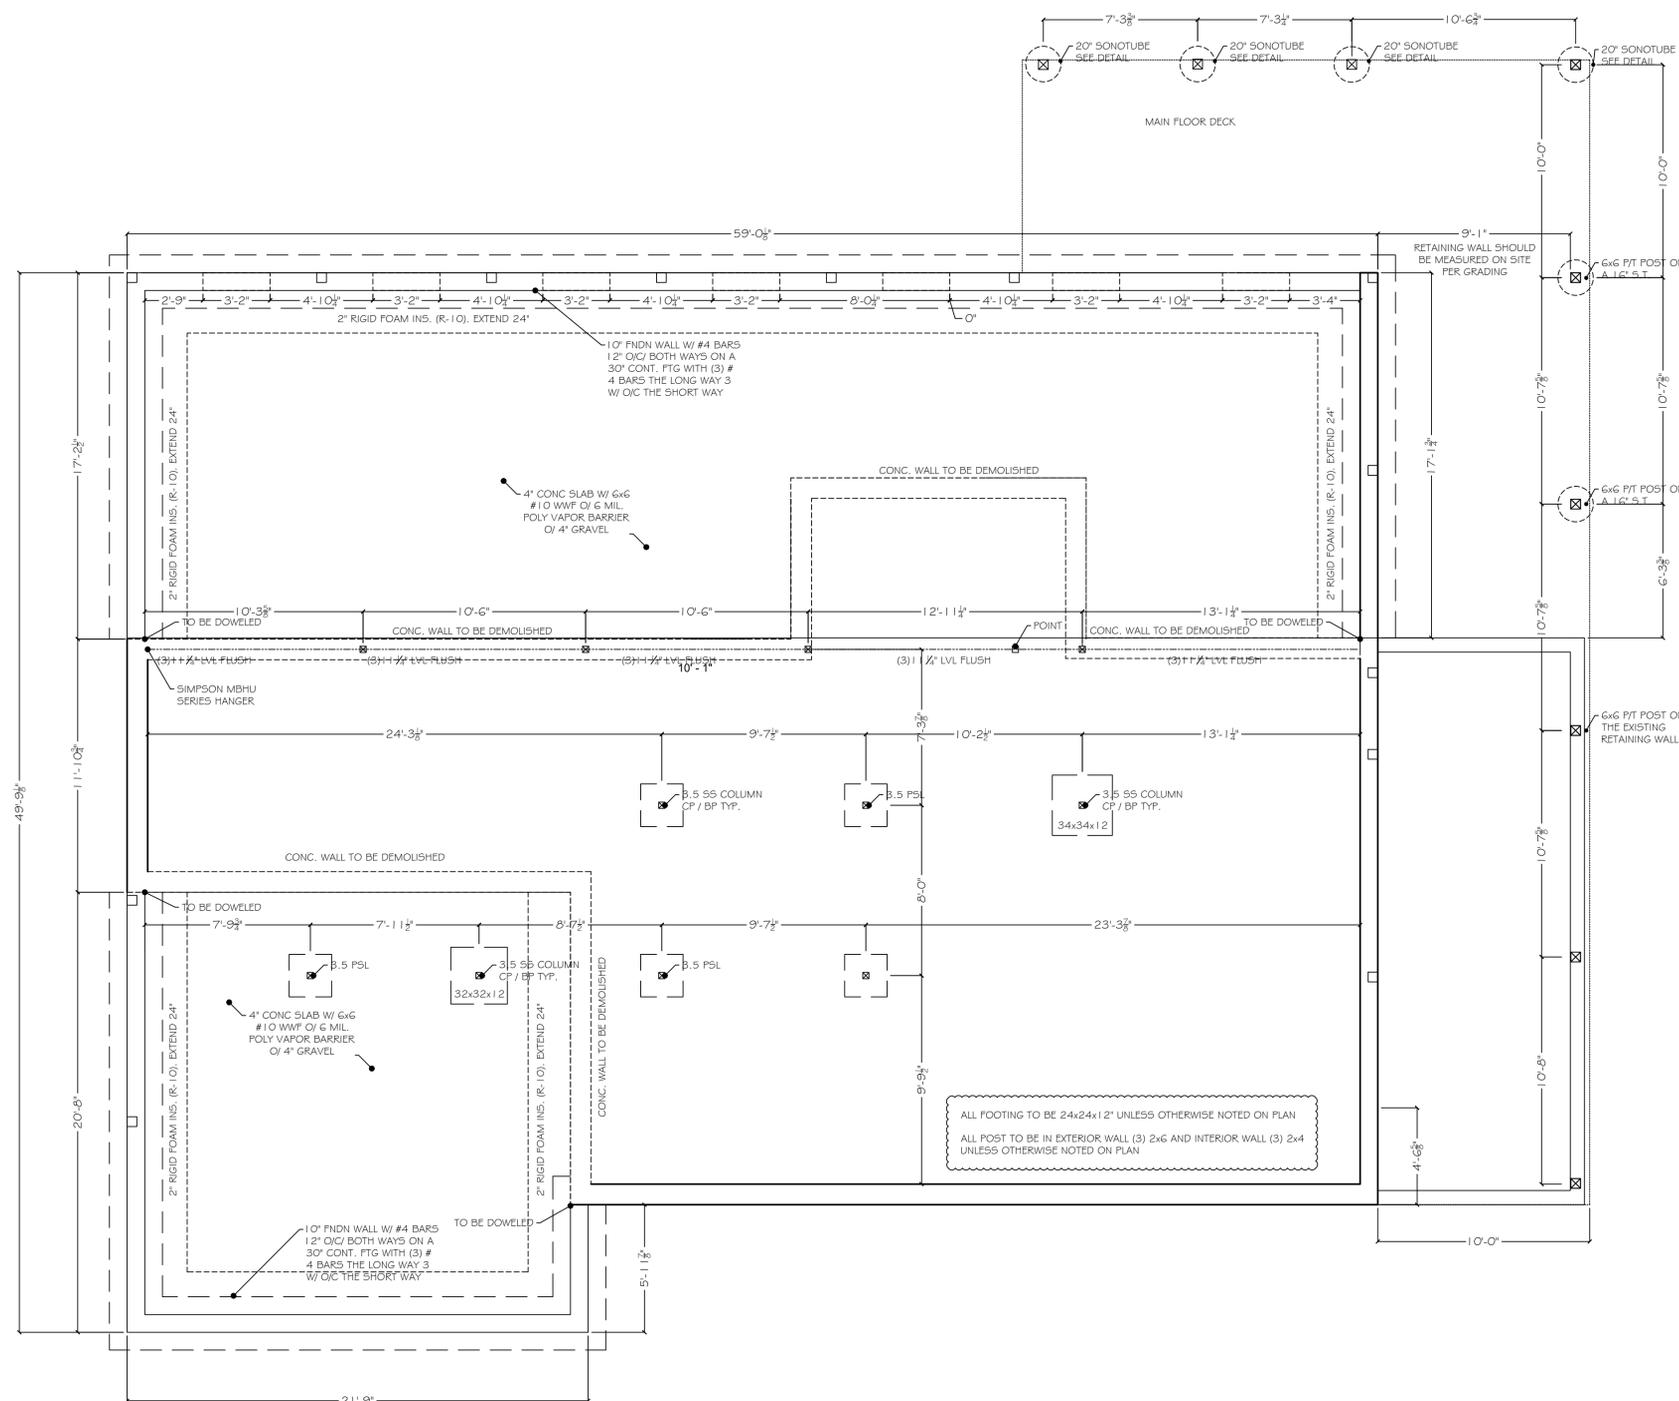


**1 FOUNDATION FOOTING PLAN**  
SCALE: 1/4" = 1' 0"

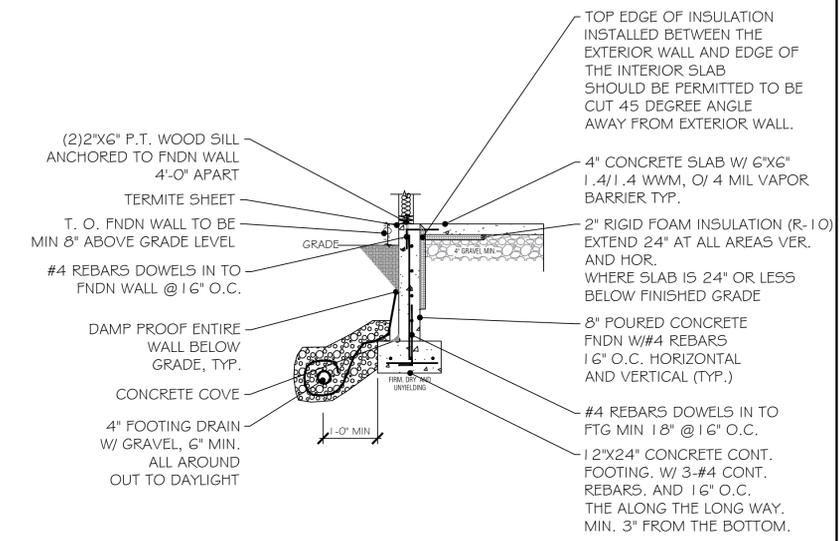

**2 FOUNDATION / FOOTING DETAIL**  
SCALE: N.T.S.

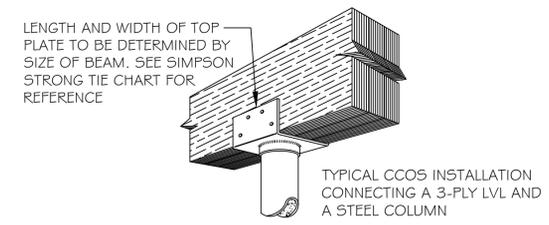

**3 POST CAP DETAIL**  
SCALE: 1/4" = 1' 0"

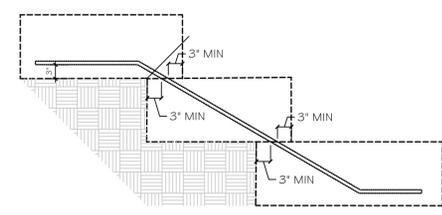

**4 STEP FOOTING DETAIL**  
SCALE: 1/4" = 1' 0"

PROJECT:

Proposed New Addition For:  
**17 Sterling Forest Ln.**  
Montebello  
Rockland County, New York

DRAWN BY:	Shlome Glauber
DATE:	7/15/2024
DATE:	8/2/2024
DATE:	8/28/2024
DATE:	1/13/2025
DATE:	3/10/2025


RODGER BRADLEY,  
ARCHITECTS  
NYS LIC. NO. 013-832  
50 PLATT'S HILL ROAD  
NEWTOWN, CT 06470  
T: 203.426.9918  
Email: rbraley2@sbeglobal.net




DESCRIPTION:

**A-102**


SCALE AS NOTED

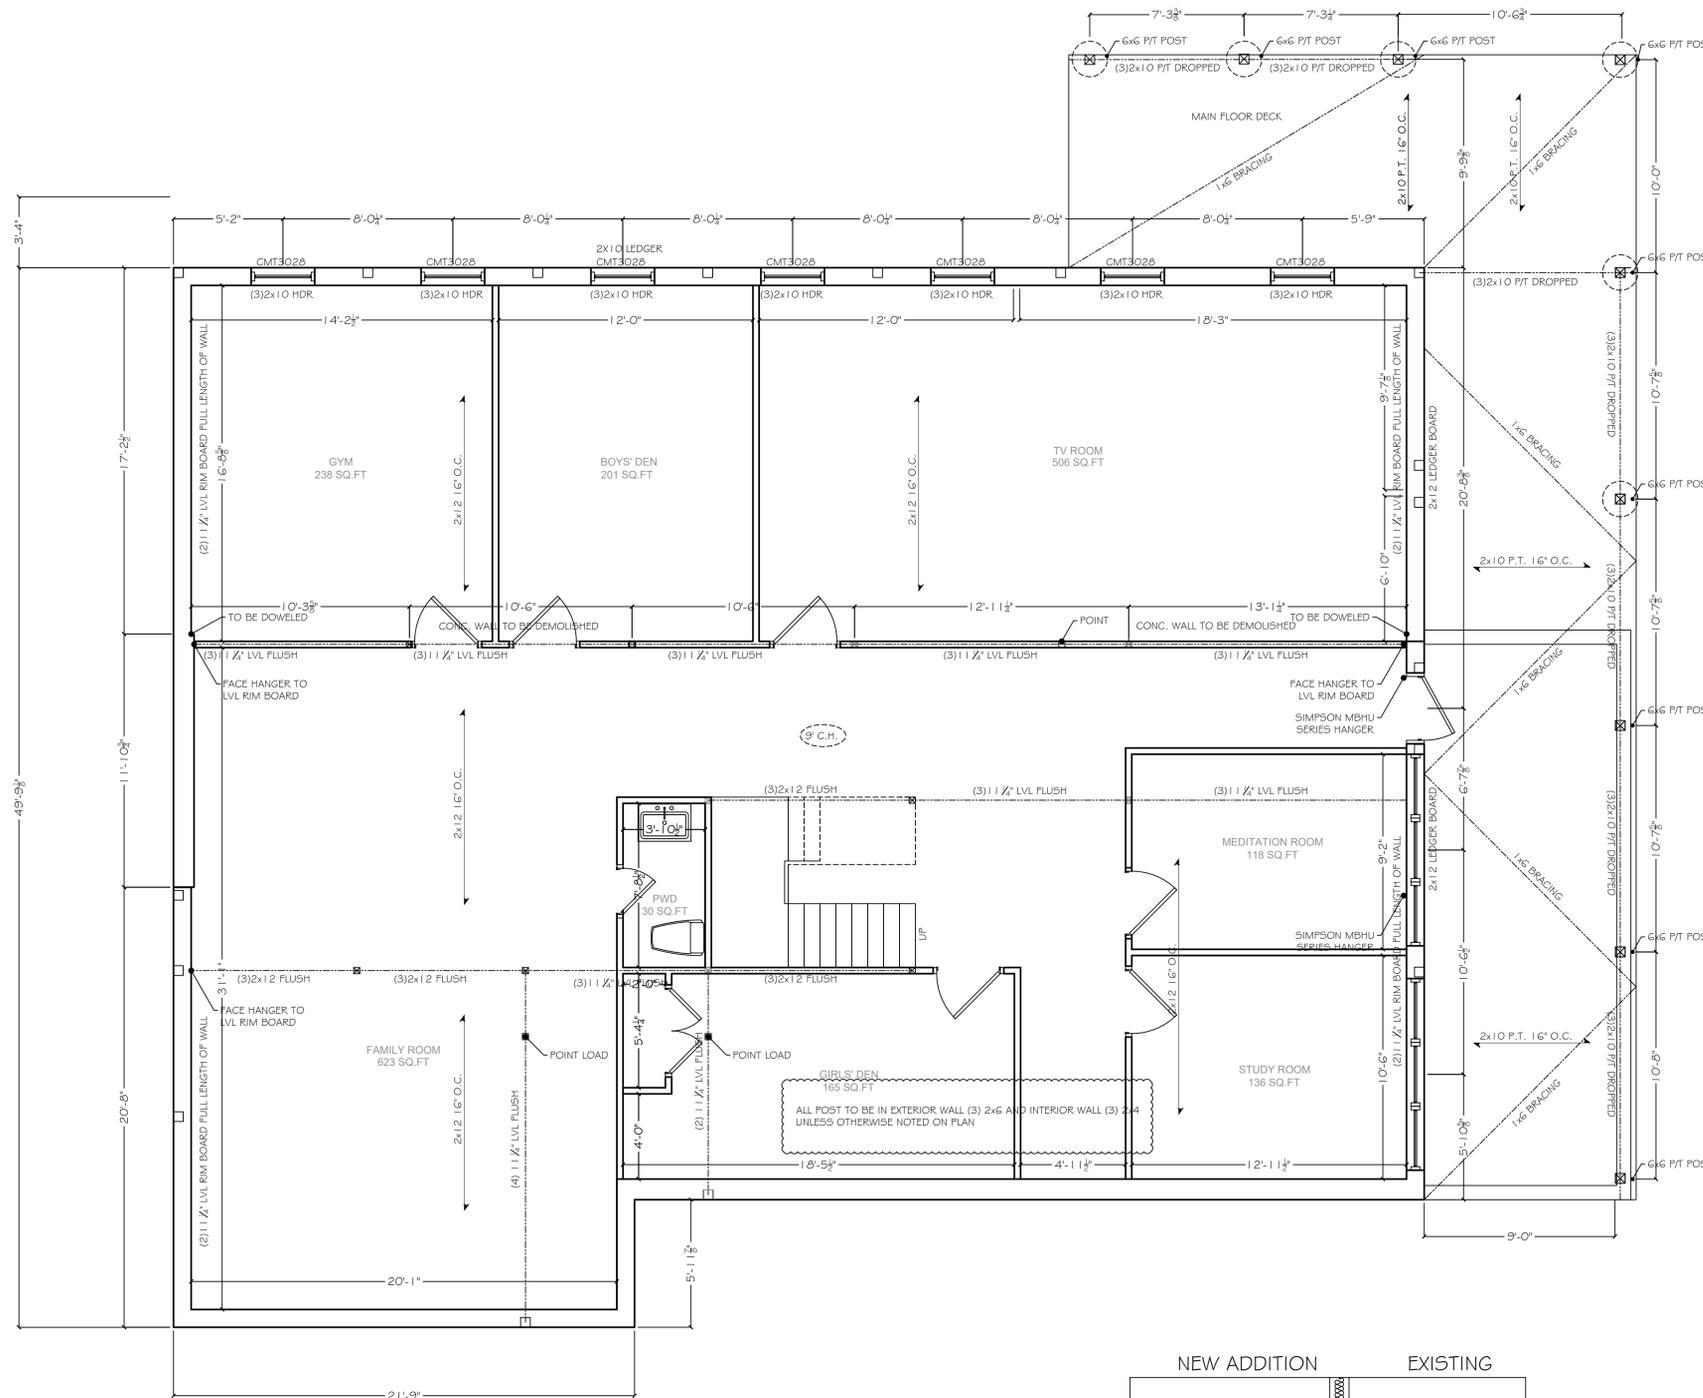


1 BASEMENT FLOOR PLAN  
SCALE: 1/4" = 1' 0"

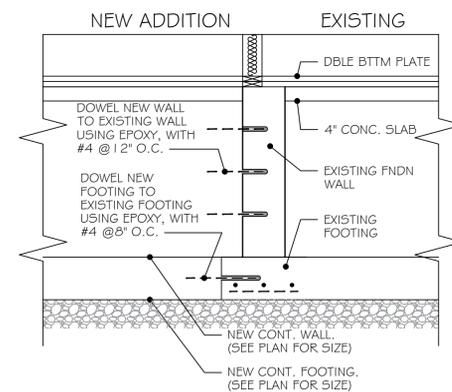

2 MASONRY DOWEL DETAIL  
SCALE: 1/2" = 1' 0"

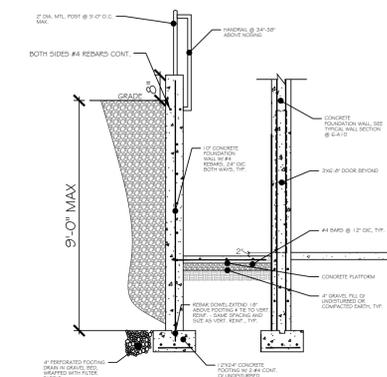


3 RETAINING WALL DETAIL  
SCALE: 1/4" = 1' 0"

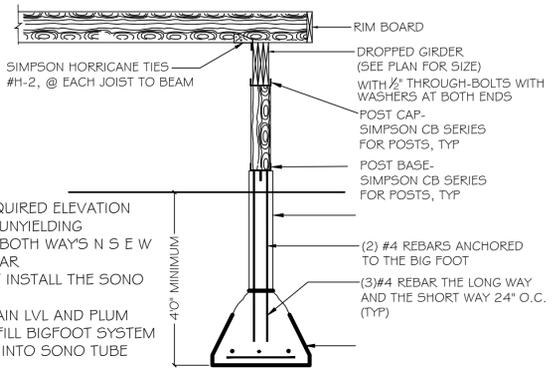


STEPS FOR BIG-FOOT

- EXCAVATE TO REQUIRED ELEVATION
- INSURE DRY AND UNYIELDING
- STOLE REBAR #4 BOTH WAY'S N S E W
- INSTALL VER. REBAR
- PUT THE BIGFOOT INSTALL THE SONO TUBE
- BRACE TO MAINTAIN LVL AND PLUM
- CAREFULLY BACKFILL BIGFOOT SYSTEM
- POOR CONCRETE INTO SONO TUBE AND BIG-FOOT

4 BIGFOOT DETAIL  
SCALE: 1/2" = 1' 0"

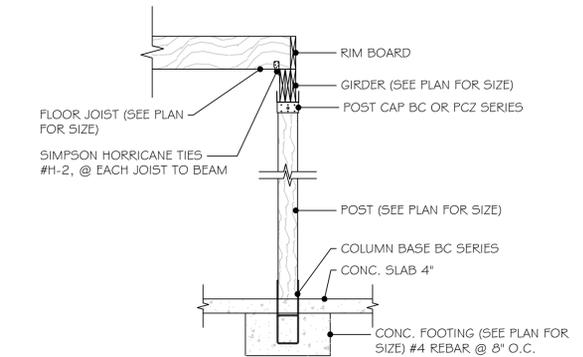

5 INTERIOR CONCRETE PIER  
SCALE: 1/2" = 1' 0"

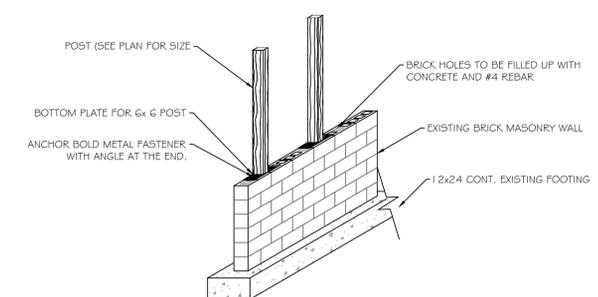

6 BIGFOOT DETAIL  
SCALE: 1/2" = 1' 0"

PROJECT:

Proposed New Addition For:  
**17 Sterling Forest Ln.**  
Montebello  
Rockland County, New York

DRAWN BY:	Shlome Glauber
DATE:	7/15/2024
DATE:	8/2/2024
DATE:	8/28/2024
DATE:	1/13/2025
DATE:	3/10/2025


**RODGER BRADLEY,**  
ARCHITECTS  
NYS LIC. NO. 013-832  
50 PLATT'S HILL ROAD  
NEWTOWN, CT 06470  
T: 203.426.9918  
Email: rbraley2@sbeglobal.net




DESCRIPTION:

**A-103**


SCALE AS NOTED

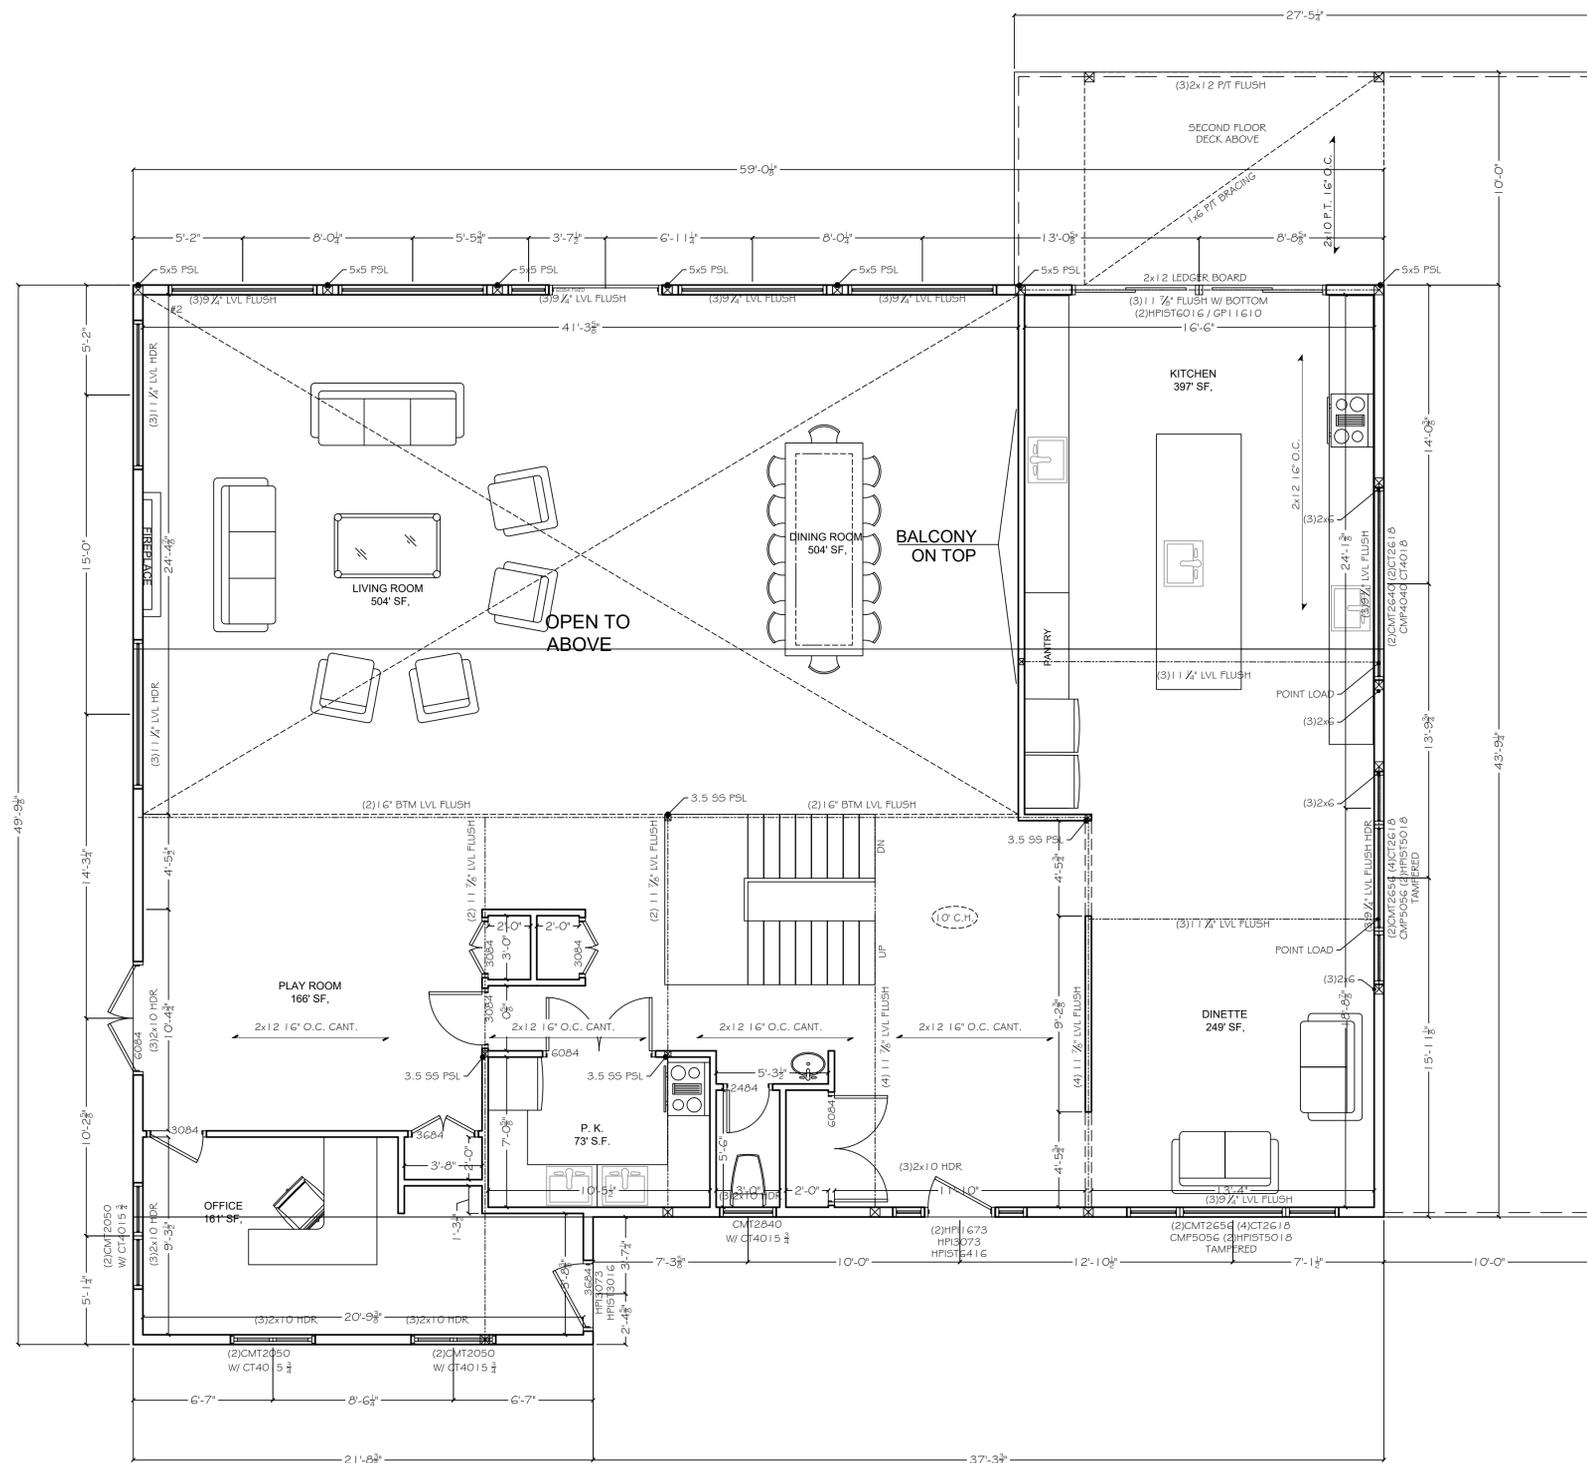


**1 FIRST FLOOR FRAMING PLAN**  
SCALE: 1/4" = 1' 0"

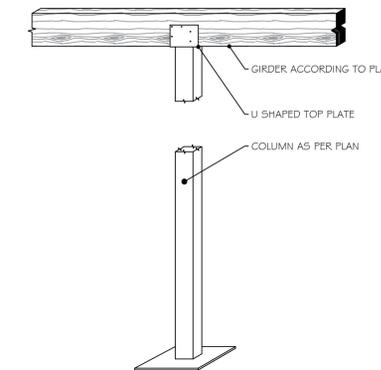


**2 ANGLE IRON SHELF**  
SCALE: 1/4" = 1' 0"

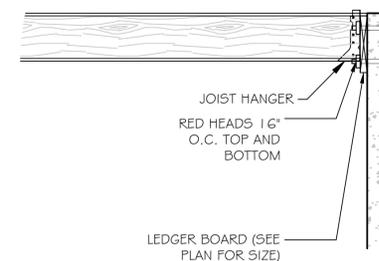


**3 LEDGER BOARD TO CONCRETE**  
SCALE: 1/4" = 1' 0"

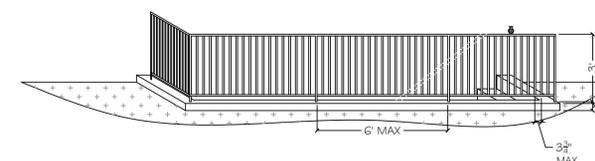


**4 STAIR WELL ELEVATION**  
SCALE: 1/4" = 1' 0"

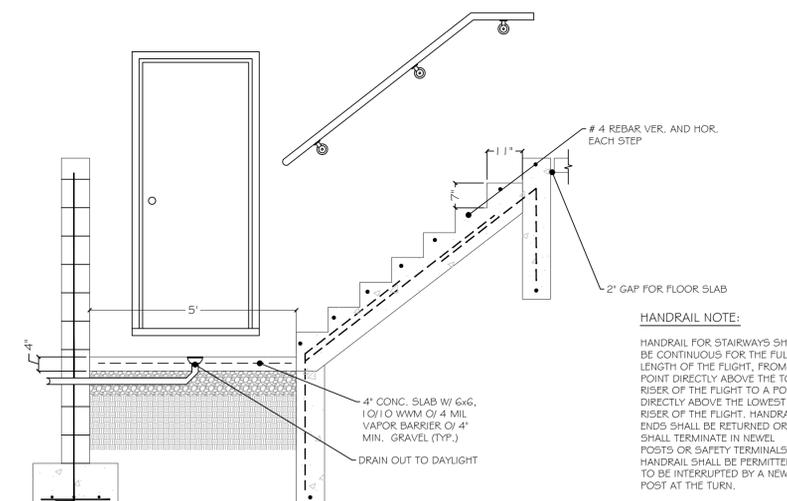


**5 CONC. STAIR DETAIL SIDE VIEW**  
SCALE: 1/4" = 1' 0"

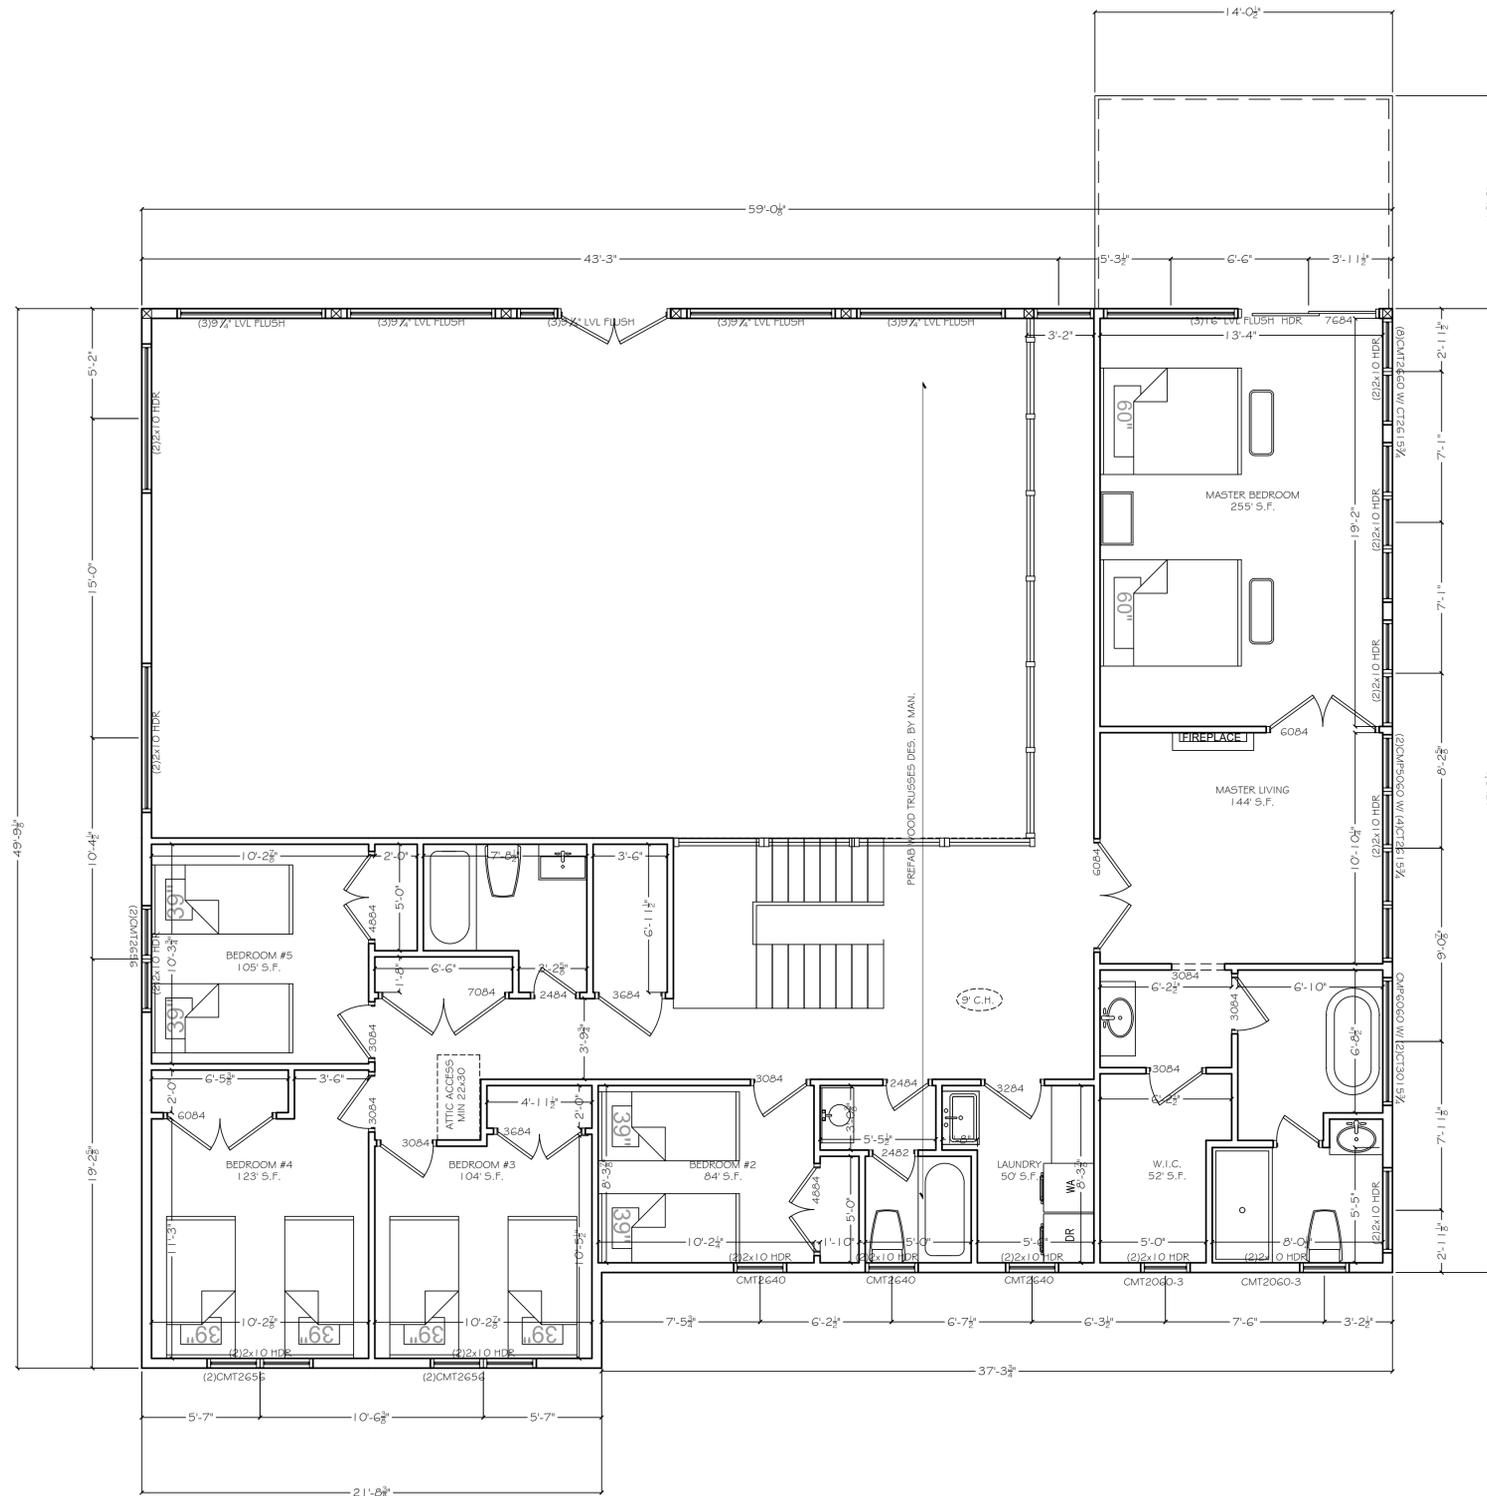

1 SECOND FLOOR FRAMING PLAN  
SCALE: 1/4" = 1' 0"

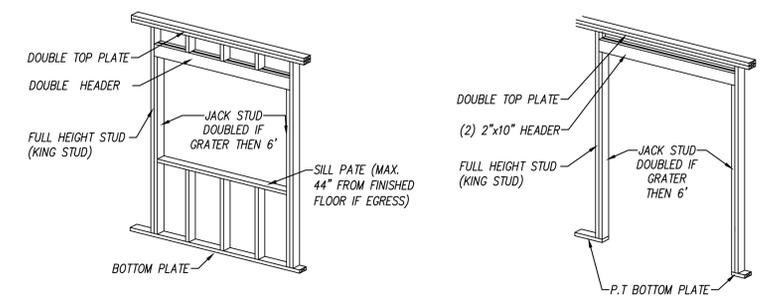


1 OPENINGS FRAMING DETAILS  
SCALE: 1/4" = 1' 0"



NOTES  
LVL'S ARE TO BE BOLTED TOGETHER @ EVERY 2'-0".  
BOLTS ARE TO BE STAGGERED FROM BOTTOM TO TOP AT MIN. OF 1" OFF BOTH TOP & BOTTOM EDGE OF GIRDER ASSEMBLY. PROVIDE A BOLT AT TOP & BOTTOM OF EACH END OF ASSEMBLY.

1 LVL BOLT DETAIL  
SCALE: 1/4" = 1' 0"

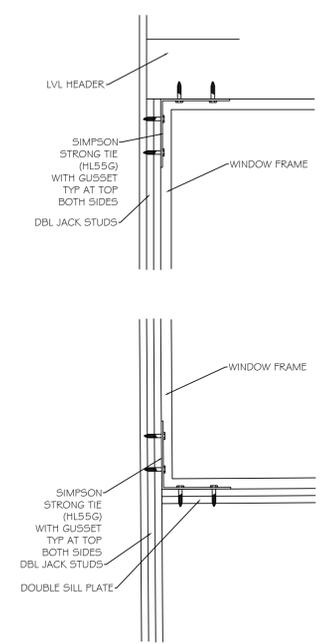

3 WINDOW TOP AND BOTTOM DETAIL  
SCALE: 1/4" = 1' 0"

PROJECT:

Proposed New Addition For:  
**17 Sterling Forest Ln.**  
Montebello  
Rockland County, New York

DRAWN BY:	Shlome Glauber
DATE:	7/15/2024
DATE:	8/2/2024
DATE:	8/28/2024
DATE:	1/13/2025
DATE:	3/10/2025

RODGER BRADLEY,  
ARCHITECTS  
NYS LIC. NO. 013-832  
50 PLATT'S HILL ROAD  
NEWTOWN, CT 06470  
T: 203.426.9918  
Email: rbraley2@sbcglobal.net



DESCRIPTION:

**A-104**

SCALE AS NOTED

**PROJECT:**

Proposed New Addition For:  
**17 Sterling Forest Ln.**  
Montebello  
Rockland County, New York

<b>DRAWN BY:</b>	Shlome Glauber
<b>DATE:</b>	7/15/2024
<b>DATE:</b>	8/2/2024
<b>DATE:</b>	8/28/2024
<b>DATE:</b>	1/13/2025
<b>DATE:</b>	3/10/2025

**RODGER BRADLEY,**  
ARCHITECTS  
NYS LIC. NO. 013-832  
50 PLATT'S HILL ROAD  
NEWTOWN, CT 06470  
T: 203.426.9918  
Email: rbraley2@sbcglobal.net



**DESCRIPTION:**

**A-105**


**SCALE** AS NOTED



**1 FRONT SIDE ELEVATION**  
SCALE: 3/16" = 1' 0"



**2 RIGHT SIDE ELEVATION**  
SCALE: 3/16" = 1' 0"

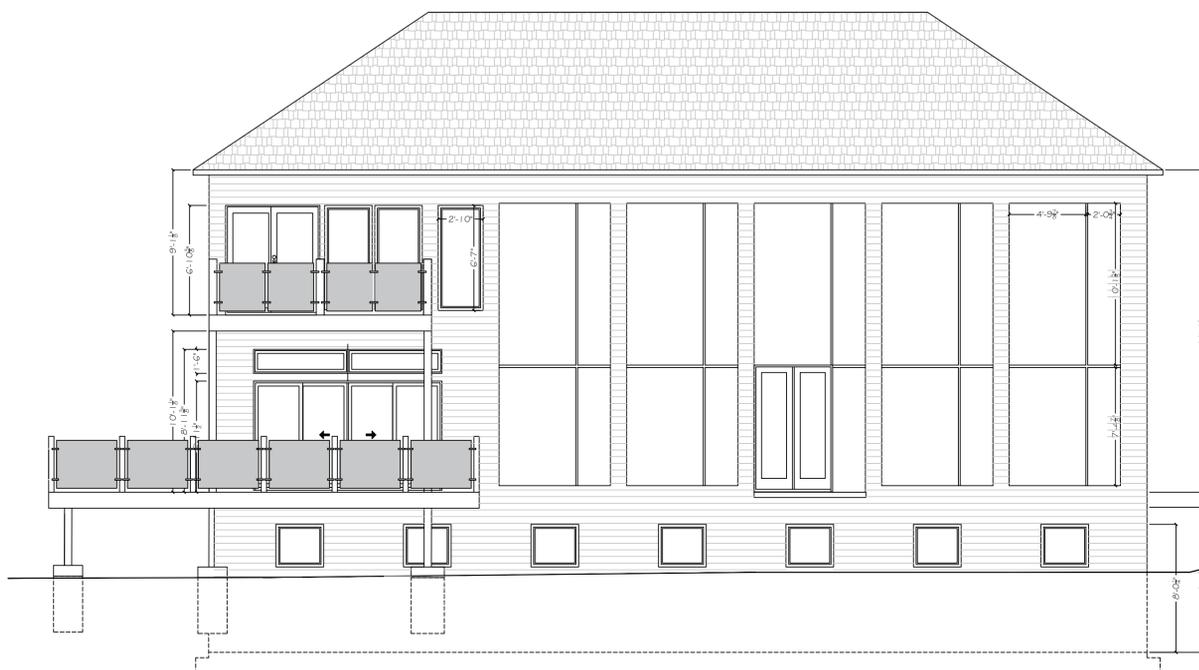

**3 REAR SIDE ELEVATION**  
SCALE: 3/16" = 1' 0"



**4 LEFT SIDE ELEVATION**  
SCALE: 3/16" = 1' 0"



**PROJECT:**

Proposed New Addition For:  
**17 Sterling Forest Ln.**  
Montebello  
Rockland County, New York

<b>DRAWN BY:</b>	Shlome Glauber
<b>DATE:</b>	7/15/2024
<b>DATE:</b>	8/2/2024
<b>DATE:</b>	8/28/2024
<b>DATE:</b>	1/13/2025
<b>DATE:</b>	3/10/2025


**RODGER BRADLEY,**  
ARCHITECTS  
NYS LIC. NO. 013-832  
50 PLATT'S HILL ROAD  
NEWTOWN, CT 06470  
T: 203.426.9918  
Email: rbraley2@sbcglobal.net



**DESCRIPTION:**


**A-107**

**SCALE** AS NOTED

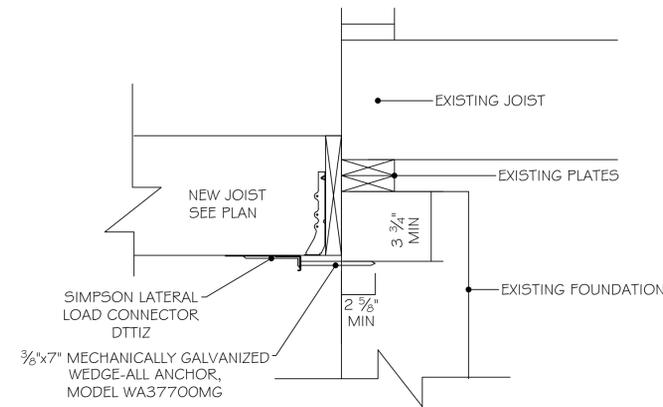

**OPTION A**


PROVIDE 4 CONNECTOR PER LEDGER EVENLY SPACED AND INSTALLED WITHIN 24" FROM THE EDGE OF THE DECK LEDGER BOARD.

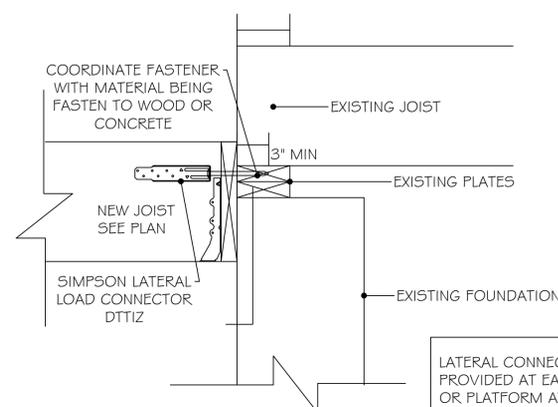

**OPTION B**


PROVIDE 4 CONNECTOR PER LEDGER EVENLY SPACED AND INSTALLED WITHIN 24" FROM THE EDGE OF THE DECK LEDGER BOARD.

LATERAL CONNECTOR SHALL BE PROVIDED AT EACH NEW DECK OR PLATFORM ATTACHED TO THE RESIDENCE

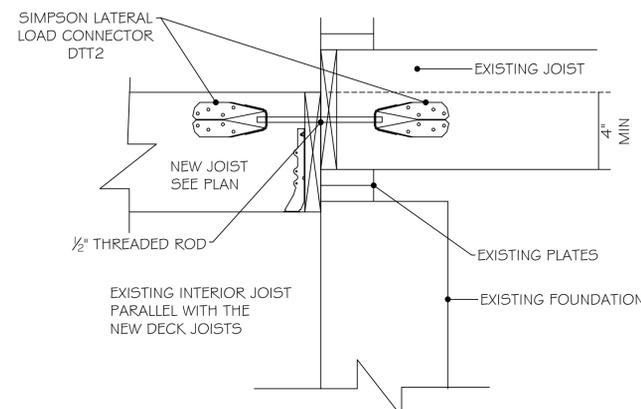

**OPTION C**


PROVIDE 4 CONNECTOR PER LEDGER EVENLY SPACED AND INSTALLED WITHIN 24" FROM THE EDGE OF THE DECK LEDGER BOARD.

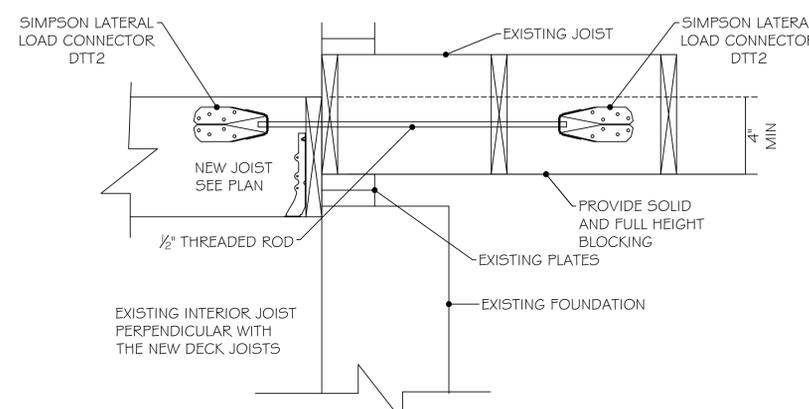


**OPTION D**

PROVIDE 4 CONNECTOR PER LEDGER EVENLY SPACED AND INSTALLED WITHIN 24" FROM THE EDGE OF THE DECK LEDGER BOARD.


**1 LATERAL BRACING DETAILS**  
SCALE: 1/4" = 1' 0"

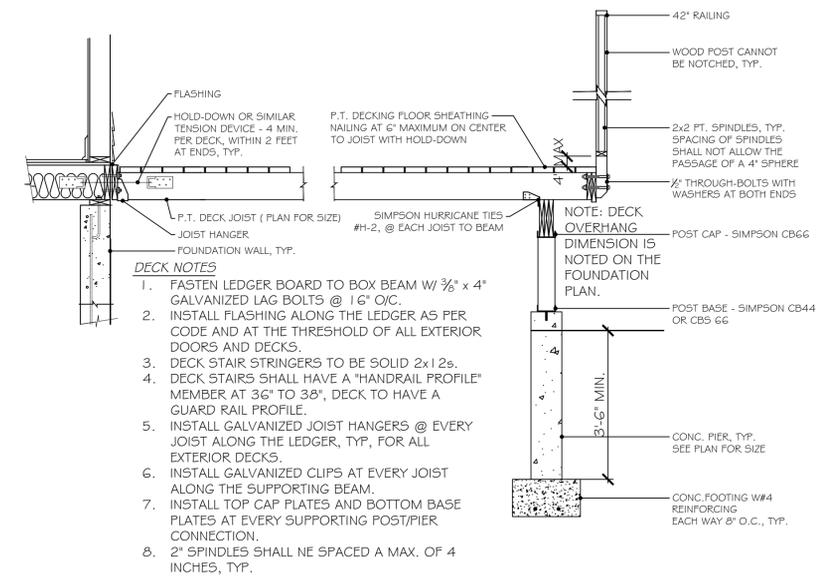


**3 TYPICAL DECK DETAIL**  
SCALE: 1/4" = 1' 0"

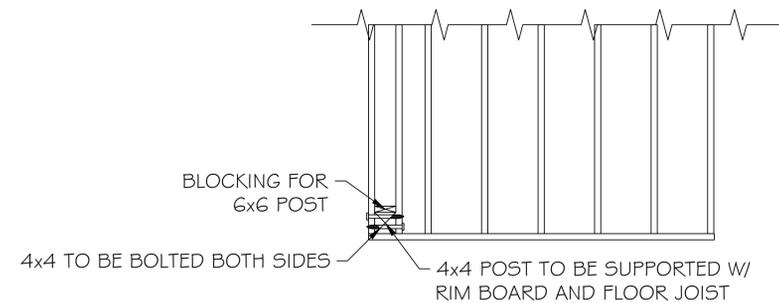


**4 RAILING POST SUPPORT DETAIL (TYP.)**  
SCALE: 1/4" = 1' 0"

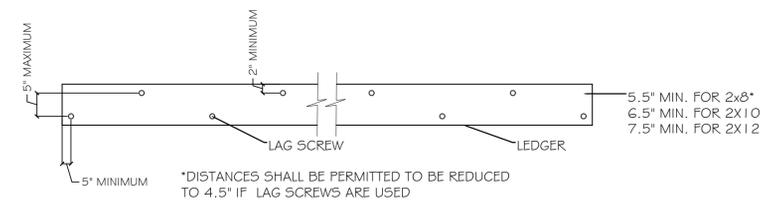


**2 FASTENING PATTERN FOR LEDGER BOARDS (TYP.)**  
SCALE: 1/4" = 1' 0"

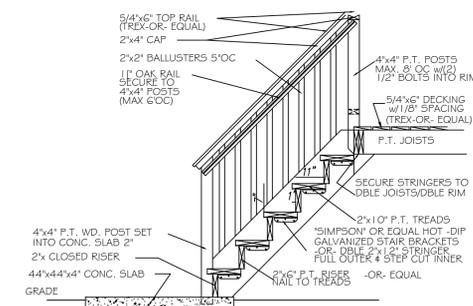

**5 EXTERIOR PRES. TRTD. STAIR DETAIL**  
SCALE: 1/4" = 1' 0"

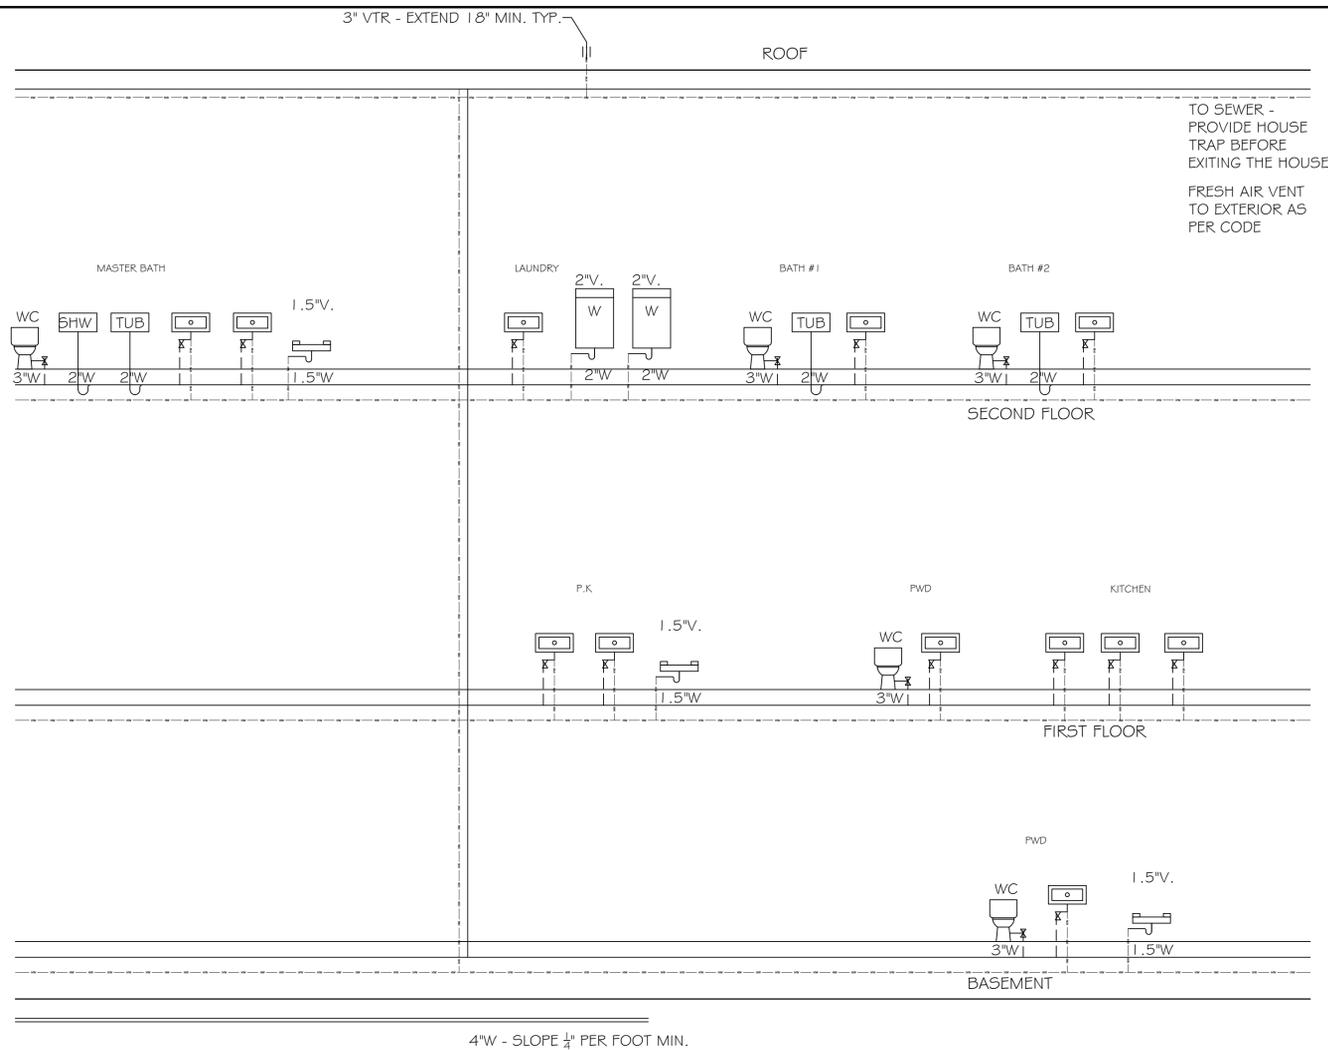

1 PLUMBING RISER DIAGRAM - VENT & WASTE  
SCALE: 1/4" = 1' 0"

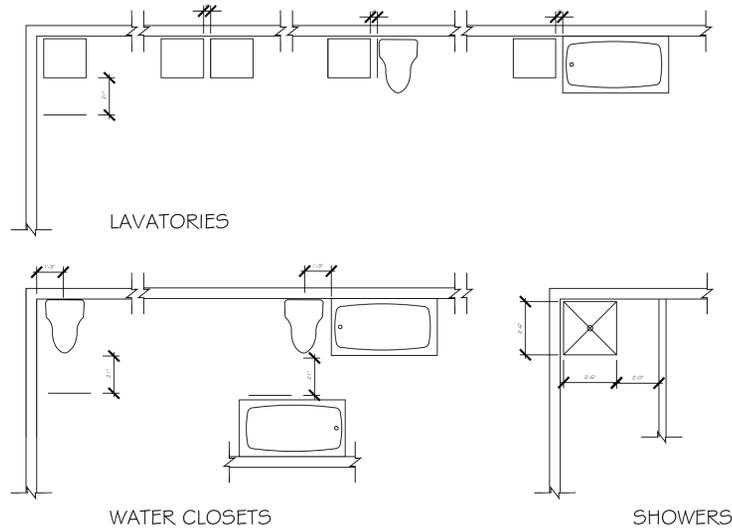

2 MINIMUM PLUMBING FIXTURE CLEARANCES  
SCALE: 1/4" = 1' 0"

BUILDING TO COMPLY WITH THE 2020 ENERGY CONSERVATION CONSTRUCTION CODE OF NEW YORK STATE (ECCCNYS), SECTION R401.3 CERTIFICATE

A PERMANENT CERTIFICATE SHALL BE COMPLETED BY THE BUILDER OR REGISTERED DESIGN PROFESSIONAL AND POSTED ON A WALL IN THE SPACE WHERE THE FURNACE IS LOCATED, A UTILITY ROOM OR AN APPROVED LOCATION INSIDE THE BUILDING. WHERE LOCATED ON AN ELECTRICAL PANEL, THE CERTIFICATE SHALL NOT COVER OR OBSTRUCT THE VISIBILITY OF THE CIRCUIT DIRECTORY LABEL, SERVICE DISCONNECT LABEL OR OTHER REQUIRED LABELS. THE CERTIFICATE SHALL LIST THE PREDOMINANT R-VALUES OF INSULATION INSTALLED IN OR ON CEILING/ROOF, WALLS, FOUNDATION (SLAB, BASEMENT WALL, CRAWLSPACE WALL AND FLOOR) AND DUCTS OUTSIDE CONDITIONED SPACES; U-FACTORS FOR FENESTRATION AND THE SOLAR HEAT GAIN COEFFICIENT (SHGC) OF FENESTRATION, AND THE RESULTS FROM ANY REQUIRED DUCT SYSTEM AND BUILDING ENVELOPE AIR LEAKAGE TESTING DONE ON THE BUILDING, WHERE THERE IS MORE THAN ONE VALUE FOR EACH COMPONENT, THE CERTIFICATE SHALL LIST THE VALUE COVERING THE LARGEST AREA. THE CERTIFICATE SHALL LIST THE TYPES AND EFFICIENCIES OF HEATING, COOLING AND SERVICE WATER HEATING EQUIPMENT, WHERE A GAS-FIRED UNVENTED ROOM HEATER, ELECTRIC FURNACE OR BASEBOARD ELECTRIC HEATER IS INSTALLED IN THE RESIDENCE, THE CERTIFICATE SHALL LIST 'GAS-FIRED UNVENTED ROOM HEATER,' 'ELECTRIC FURNACE' OR 'BASEBOARD ELECTRIC HEATER,' AS APPROPRIATE. AN EFFICIENCY SHALL NOT BE LISTED FOR GAS-FIRED UNVENTED ROOM HEATERS, ELECTRIC FURNACES OR ELECTRIC BASEBOARD HEATERS.

TO THE BEST OF MY KNOWLEDGE, BELIEF AND PROFESSIONAL JUDGMENT, THESE PLANS AND SPECIFICATIONS ARE IN COMPLIANCE WITH THE ENERGY CONSERVATION CONSTRUCTION CODE OF NEW YORK STATE.

SECTION 402 BUILDING THERMAL ENVELOPE

ALL VALUES INDICATED ARE THE PRESCRIPTIVE METHOD FOR CLIMATE ZONE 5. IF A RESCHECK IS PROVIDED WITH SUBSTITUTED VALUES, THAN THE RESCHECK SHALL BE FOLLOWED.

ALL R-VALUES ARE ACCORDING TO TABLE R402.1.2, AND U-FACTOR VALUES ARE ACCORDING TO TABLE R402.1.4. CEILING TO HAVE R-49 INSULATION

R-39 SHALL BE DEEMED TO SATISFY THE REQUIREMENT FOR R-49 WHEREVER THE FULL HEIGHT OF UNCOMPRESSED R-39 INSULATION EXTENDS OVER THE WALL TOP PLATE AT THE EAVES (100% OF THE CEILING AREA)

WOOD FRAMED WALLS OF BUILDING TO HAVE R-20 CAVITY INSULATION OR R-13 CAVITY INSULATION + R-5 CONTINUOUS INSULATION

MASS WALLS ABOVE GROUND (IF APPLICABLE) TO HAVE R-13 INSULATION OR R-17 IF MORE THAN HALF OF THE INSULATION IS ON THE INTERIOR OF THE MASS WALL

BASEMENT WALLS SHALL HAVE MINIMUM OF R-15 CONTINUOUS INSULATION ON THE INTERIOR OR EXTERIOR OF THE BASEMENT WALL, OR A MINIMUM OF R-19 CAVITY INSULATION AT THE INTERIOR OF THE BASEMENT WALL.

BASEMENT WALLS ASSOCIATED WITH CONDITIONED BASEMENTS SHALL BE INSULATED FROM THE TOP OF THE BASEMENT WALL DOWN TO 1.0 FEET BELOW GRADE OR TO THE BASEMENT FLOOR, WHICHEVER IS LESS. WALLS ASSOCIATED WITH UNCONDITIONED BASEMENTS SHALL MEET THIS REQUIREMENT UNLESS THE FLOOR OVERHEAD IS INSULATED

FLOORS TO HAVE R-30 INSULATION OR INSULATION SUFFICIENT TO FILL THE FRAMING CAVITY, R-19 MINIMUM

FENESTRATION OF BUILDING TO HAVE A U-FACTOR OF 0.30 (EXCLUDING SKYLIGHTS)

SLAB ON GRADE (IF APPLICABLE) TO HAVE R-10 INSULATION FOR A DEPTH OF 2 FEET.

SLAB-ON-GRADE FLOORS WITH A FLOOR SURFACE LESS THAN 12 INCHES (305 MM) BELOW GRADE SHALL BE INSULATED WITH R-10 INSULATION. THE INSULATION SHALL EXTEND DOWNWARD FROM THE TOP OF THE SLAB ON THE OUTSIDE OR INSIDE OF THE FOUNDATION WALL. INSULATION LOCATED BELOW GRADE SHALL BE EXTENDED 2'-0" BY ANY COMBINATION OF VERTICAL INSULATION,

CRAWL SPACE SHALL HAVE MINIMUM R-15 OF CONTINUOUS INSULATION ON THE INTERIOR OR EXTERIOR OF THE WALL OR MINIMUM OF R-19 OF CAVITY INSULATION AT THE INTERIOR OF THE BASEMENT WALL.

SKYLIGHTS TO HAVE A U FACTOR OF 0.55.

MAXIMUM FENESTRATION U-FACTOR AND SHGC

THE AREA-WEIGHTED AVERAGE MAXIMUM FENESTRATION U-FACTOR PERMITTED USING TRADEOFFS FROM SECTION R402.1.5 OR R405 SHALL BE 0.48, FOR VERTICAL FENESTRATION, AND 0.75 FOR SKYLIGHTS.

FIRE SEPARATION WALLS BETWEEN DWELLING UNITS IN TWO-FAMILY DWELLINGS AND MULTIPLE SINGLE-FAMILY DWELLINGS (TOWNHOUSES) SHALL BE INSULATED TO NO LESS THAN R-10 AND THE WALLS SHALL BE AIR SEALED IN ACCORDANCE WITH SECTION 402.4

THE BUILDING THERMAL ENVELOPE SHALL BE CONSTRUCTED TO LIMIT AIR LEAKAGE. THE SEALING METHODS BETWEEN DISSIMILAR MATERIALS SHALL ALLOW FOR DIFFERENTIAL EXPANSION AND CONTRACTION.

THE COMPONENTS OF THE BUILDING THERMAL ENVELOPE SHALL COMPLY WITH TABLE R402.4.1.1 OF THE 2020 ECCCNYS AND SHALL BE INSTALLED IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS AND THE CRITERIA INDICATED IN TABLE R402.4.1.1, AS APPLICABLE TO THE METHOD OF CONSTRUCTION.

WINDOWS, SKYLIGHTS AND SLIDING GLASS DOORS SHALL HAVE AN AIR INFILTRATION RATE OF NO MORE THAN 0.3 CM PER SQUARE FOOT (1.5 US/M<sup>2</sup>), AND SWINGING DOORS NO MORE THAN 0.5 CM PER SQUARE FOOT (2.6 US/M<sup>2</sup>), WHEN TESTED ACCORDING TO NFRC 400 OR AIAA/WDMA/CSA 101/1.5.2/A440 BY AN ACCREDITED, INDEPENDENT LABORATORY AND LISTED AND LABELED BY THE MANUFACTURER

VAPOR BARRIER TO BE ON HEATED OR LIVING SIDE IN FLOORS, WALLS AND CEILING (WHERE APPLICABLE)

FIBERGLASS SILL PLATE INSULATION TO BE USED UNDER ALL SILL PLATES, WHETHER ON CRAWL SPACE, WALLS OR SLABS.

TESTING BUILDING ENVELOPE SHALL BE TESTED ACCORDING TO SECTION R402.4.1.2

THE BUILDING OR DWELLING UNIT SHALL BE TESTED AND VERIFIED AS HAVING AN AIR LEAKAGE RATE NOT EXCEEDING THREE AIR CHANGES PER HOUR IN CLIMATE ZONES 3 THROUGH 8.

TESTING SHALL BE CONDUCTED IN ACCORDANCE WITH ASTM E 779 OR ASTM E 1827 AND REPORTED AT A PRESSURE OF 0.2 INCH W.G. (50 PASCALS). TESTING SHALL BE PERFORMED AT ANY TIME AFTER CREATION OF ALL

SECTION R403 SYSTEMS

BUILDING MECHANICAL SYSTEMS SHALL COMPLY WITH SECTION R403 OF THE ENERGY CONSERVATION CONSTRUCTION CODE OF NEW YORK STATE (ECCCNYS)

EACH UNIT TO HAVE AT LEAST ONE PROGRAMMABLE THERMOSTAT FOR EACH SEPARATE HEATING AND COOLING CONTROLLING THE PRIMARY HEATING OR COOLING SYSTEM OF THE DWELLING UNIT SHALL BE CAPABLE OF CONTROLLING THE HEATING AND COOLING SYSTEM ON A DAILY SCHEDULE TO MAINTAIN DIFFERENT TEMPERATURE SET POINTS AT DIFFERENT TIMES OF THE DAY. THIS THERMOSTAT SHALL INCLUDE THE CAPABILITY TO SET BACK OR TEMPORARILY OPERATE THE SYSTEM TO MAINTAIN ZONE TEMPERATURES DOWN TO 55°F (13°C) OR UP TO 85°F (29°C). THE THERMOSTAT SHALL INITIALLY BE PROGRAMMED BY THE MANUFACTURER WITH A HEATING TEMPERATURE SET POINT NO HIGHER THAN 70°F (21°C) AND A COOLING TEMPERATURE SET POINT NO LOWER THAN 78°F (26°C). HEAT PUMPS HAVING SUPPLEMENTARY ELECTRIC-RESISTANCE HEAT SHALL HAVE CONTROLS THAT, EXCEPT DURING DEFROST, PREVENT SUPPLEMENTAL HEAT OPERATION WHEN THE HEAT PUMP COMPRESSOR CAN MEET THE HEATING LOAD.

ALL SUPPLY AND RETURN DUCTS IN ATTICS SHALL BE INSULATED TO A MINIMUM OF R-6 WHERE 3 INCHES IN DIAMETER AND GREATER AND R-6 WHERE LESS THAN 3 INCHES IN DIAMETER. SUPPLY AND RETURN DUCTS IN OTHER PORTIONS OF THE BUILDING SHALL BE INSULATED TO A MINIMUM OF R-6 WHERE 3 INCHES IN DIAMETER OR GREATER AND R-4.2 WHERE LESS THAN 3 INCHES IN DIAMETER.

EXCEPTION: DUCTS OR PORTIONS THEREOF LOCATED COMPLETELY INSIDE THE BUILDING THERMAL ENVELOPE.

SEALING: DUCTS, AIR HANDLERS AND FILTER BOXES SHALL BE SEALED. JOINTS AND SEAMS SHALL COMPLY WITH EITHER THE INTERNATIONAL MECHANICAL CODE OR INTERNATIONAL RESIDENTIAL CODE, AS APPLICABLE.

EXCEPTIONS:

1. R-IMPERMEABLE SPRAY FOAM PRODUCTS SHALL BE PERMITTED TO BE APPLIED WITHOUT ADDITIONAL JOINT SEALS.

2. OR DUCTS HAVING A STATIC PRESSURE CLASSIFICATION OF LESS THAN 2 INCHES OF WATER COLUMN (500 PA), ADDITIONAL CLOSURE SYSTEMS SHALL NOT BE REQUIRED FOR CONTINUOUSLY WELDED JOINTS AND SEAMS, AND LOCKING-TYPE JOINTS AND SEAMS OF OTHER THAN THE SHIP-LOCK AND BUTTON-LOCK TYPES.

ALL DUCTS TO BE TESTED FOR LEAKAGE ACCORDING TO SECTION R403.3.3 OF THE ENERGY CONSERVATION CONSTRUCTION CODE OF NEW YORK STATE (ECCCNYS)

BUILDING FRAMING CAVITIES SHALL NOT BE USED AS DUCTS OR PLENUMS

ALL DUCTS TO COMPLY WITH SECTION R403.3 OF THE ENERGY CONSERVATION CONSTRUCTION CODE OF NEW YORK STATE (ECCCNYS)

ALL MECHANICAL SYSTEM PIPING INSULATION TO COMPLY WITH SECTION R403.4 OF THE ENERGY CONSERVATION CONSTRUCTION CODE OF NEW YORK STATE (ECCCNYS)

SERVICE HOT WATER SYSTEMS TO COMPLY WITH SECTION R403.5 OF THE ENERGY CONSERVATION CONSTRUCTION CODE OF NEW YORK STATE (ECCCNYS)

HEATED WATER CIRCULATION SYSTEMS SHALL BE IN ACCORDANCE WITH SECTION R403.5.1.1. HEAT TRACE TEMPERATURE MAINTENANCE SYSTEMS SHALL BE IN ACCORDANCE WITH SECTION R403.5.1.2. AUTOMATIC CONTROLS, TEMPERATURE SENSORS AND PUMPS SHALL BE ACCESSIBLE.

MANUAL CONTROLS SHALL BE READILY ACCESSIBLE.

R403.5.1.1 CIRCULATION SYSTEMS.

HEATED WATER CIRCULATION SYSTEMS SHALL BE PROVIDED WITH A CIRCULATION PUMP. THE SYSTEM RETURN PIPE SHALL BE A DEDICATED RETURN PIPE OR A COLD WATER SUPPLY PIPE.

GRAVITY AND THERMOSYPHON CIRCULATION SYSTEMS SHALL BE PROHIBITED. CONTROLS FOR CIRCULATING HOT WATER SYSTEM PUMPS SHALL START THE PUMP BASED ON THE IDENTIFICATION OF A DEMAND FOR HOT WATER WITHIN THE OCCUPANCY. THE CONTROLS SHALL AUTOMATICALLY TURN OFF THE PUMP WHEN THE WATER IN THE CIRCULATION LOOP IS AT THE DESIRED TEMPERATURE AND WHEN THERE IS NO DEMAND FOR HOT WATER.

R403.5.1.2 HEAT TRACE SYSTEMS.

ELECTRIC HEAT TRACE SYSTEMS SHALL COMPLY WITH IEEE 515.1 OR UL 515. CONTROLS FOR SUCH SYSTEMS SHALL AUTOMATICALLY ADJUST THE ENERGY INPUT TO THE HEAT TRACING TO MAINTAIN THE DESIRED WATER TEMPERATURE IN THE PIPING IN ACCORDANCE WITH THE TIMES WHEN HEATED WATER IS USED IN THE OCCUPANCY

MECHANICAL VENTILATION TO COMPLY WITH SECTION R403.6 OF THE ENERGY CONSERVATION CONSTRUCTION CODE OF NEW YORK STATE (ECCCNYS)

R403.7 EQUIPMENT SIZING AND EFFICIENCY RATING.

HEATING AND COOLING EQUIPMENT SHALL BE SIZED IN ACCORDANCE WITH ACCA MANUAL S BASED ON BUILDING LOADS CALCULATED IN ACCORDANCE WITH ACCA MANUAL J OR OTHER APPROVED HEATING AND COOLING CALCULATION METHODOLOGIES. NEW OR REPLACEMENT HEATING AND COOLING EQUIPMENT SHALL HAVE AN EFFICIENCY RATING EQUAL TO OR GREATER THAN THE MINIMUM REQUIRED BY FEDERAL LAW FOR THE GEOGRAPHIC LOCATION WHERE THE EQUIPMENT IS INSTALLED.

R403.8 SYSTEMS SERVING MULTIPLE DWELLING UNITS.

SYSTEMS SERVING MULTIPLE DWELLING UNITS SHALL COMPLY WITH SECTIONS C403 AND C404 OF THE ECCCNYS - COMMERCIAL PROVISIONS IN LIEU OF SECTION R403.

R403.9 SNOW MELT AND ICE SYSTEM CONTROLS.

SNOW- AND ICE-MELTING SYSTEMS, SUPPLIED THROUGH ENERGY SERVICE TO THE BUILDING, SHALL INCLUDE AUTOMATIC CONTROLS CAPABLE OF SHUTTING OFF THE SYSTEM WHEN THE PAVEMENT TEMPERATURE IS ABOVE 50°F (10°C), AND NO PRECIPITATION IS FALLING AND AN AUTOMATIC OR MANUAL CONTROL THAT WILL ALLOW SHUTOFF WHEN THE OUTDOOR TEMPERATURE IS ABOVE 40°F (4.8°C).

SECTION R404 ELECTRICAL POWER AND LIGHTING SYSTEMS

A MINIMUM OF 90 PERCENT OF THE LAMPS IN PERMANENTLY INSTALLED LIGHTING FIXTURES SHALL BE HIGH-EFFICIENCY LAMPS.

FUEL GAS SYSTEMS SHALL NOT HAVE CONTINUOUSLY BURNING PILOT LIGHTS.

IN ALL BUILDINGS HAVING INDIVIDUAL DWELLING UNITS, PROVISIONS SHALL BE MADE TO DETERMINE THE ELECTRICAL ENERGY CONSUMED BY EACH UNIT BY SEPARATELY METERING OR MONITORING INDIVIDUAL DWELLING UNITS.



MONROE, N.Y. 10950  
(845) 492-1783  
Email: office@szdrawings.com

PROJECT:  
Proposed New Addition For:  
**17 Sterling Forest Ln.**  
Montebello  
Rockland County, New York

DRAWN BY:	Shlome Glauber
DATE:	7/15/2024
DATE:	8/2/2024
DATE:	8/28/2024
DATE:	1/13/2025
DATE:	3/10/2025

RODGER BRADLEY,  
ARCHITECTS  
NYS LIC. NO. 013-832  
50 PLATT'S HILL ROAD  
NEWTOWN, CT 06470  
T: 203.426.9918  
Email: rbraley2@sbeglobal.net



DESCRIPTION:  
**PL-01**

SCALE AS NOTED

**PROJECT:**

Proposed New Addition For:  
**17 Sterling Forest Ln.**  
Montebello  
Rockland County, New York

**DRAWN BY:** Shlome Glauber

**DATE:** 7/15/2024

**DATE:** 8/2/2024

**DATE:** 8/28/2024

**DATE:** 1/13/2025

**DATE:** 3/10/2025

**RODGER BRADLEY,**  
ARCHITECTS  
NYS LIC. NO. 013-832  
50 PLATT'S HILL ROAD  
NEWTOWN, CT 06470  
T: 203.426.9918  
Email: rbraley2@sbeglobal.net



**DESCRIPTION:**

**E-101**

**SCALE:** AS NOTED

**ELECTRICAL SYMBOLS LEGEND**


- A 12 WATT LED BULB OR EQUIVALENT
- A 8 WATT LED BULB OR EQUIVALENT
- A 20 WATT LED BULB OR EQUIVALENT
- COMBINATION EXHAUST FAN / LIGHT (8W LED) - DIRECTLY VENTED TO EXTERIOR, MIN. 48" FROM WINDOW OR OPENING
- DUPLEX RECEPTACLE OUTLET
- GROUND FAULT PROTECTION RECEPTACLE OR CIRCUIT
- LIGHT SWITCH
- SMOKE DETECTOR INTERCONNECTED
- CARBON MONOXIDE DETECTOR INTERCONNECTED

LED Wattage Calculation (for Ambient Lighting)  
Assuming 20 lumens/sq. ft. for ambient lighting and 100 lumens/watt for LED lights:

		12W BULB	8W BULB	20W BULB	12W TOTAL FF+B WATT
GYM	(238sq. ft. x 20) ÷ 100 = 47.6	4	0	0	48
BOYS' DEN	(201 sq. ft. x 20) ÷ 100 = 40.2	0	5	0	40
TV ROOM	(506sq. ft. x 20) ÷ 100 = 101.2	9	0	0	108
MEDITATION ROOM	(118sq. ft. x 20) ÷ 100 = 23.6	0	3	0	24
STUDY ROOM	(136sq. ft. x 20) ÷ 100 = 27.2	0	4	0	32
FAMILY ROOM	(623sq. ft. x 20) ÷ 100 = 124.6	0	0	10	120
STAIR LOBBY	(323sq. ft. x 20) ÷ 100 = 64.6	5	0	0	60
LOBBY 1	(62sq. ft. x 20) ÷ 100 = 12.4	1	0	0	12
LOBBY 2	(49sq. ft. x 20) ÷ 100 = 9.8	0	1	0	8
		12W BULB	20W BULB	12W TOTAL FF+B WATT	
DINING (double height)	(504 sq. ft. x 20) ÷ 100 = 100.8 x 2 = 201.6	0	10	0	200
LIVING (double height)	(504 sq. ft. x 20) ÷ 100 = 100.8 x 2 = 201.6	0	11	0	210
PLAYROOM	(166 sq. ft. x 20) ÷ 100 = 33.2	3	0	0	36
KITCHEN	(397 sq. ft. x 20) ÷ 100 = 79.4	7	0	0	84
DINETTE	(249 sq. ft. x 20) ÷ 100 = 49.8	4	0	0	48
OFFICE	(161 sq. ft. x 20) ÷ 100 = 32.2	3	0	0	36
MASTER BED	(255 sq. ft. x 20) ÷ 100 = 51	4	0	0	48
MASTER LOUNGE	(144 sq. ft. x 20) ÷ 100 = 28.8	3	0	0	36
BEDROOM 2	(84 sq. ft. x 20) ÷ 100 = 16.8	2	0	0	24
BEDROOM 3	(104 sq. ft. x 20) ÷ 100 = 20.8	2	0	0	24
BEDROOM 4	(123 sq. ft. x 20) ÷ 100 = 24.6	2	0	0	24
BEDROOM 5	(105 sq. ft. x 20) ÷ 100 = 21	2	0	0	24
LAUNDRY	(50 sq. ft. x 20) ÷ 100 = 10	1	0	0	12

**LIGHT AND VENT CALCULATIONS**

ROOM	SF	LIGHT REQUIRED	LIGHT PROVIDED	VENT REQUIRED	VENT PROVIDED
BASEMENT					
GYM	238	19.04	10.8	9.52	12.44
BOYS' DEN	201	16.08	5.4	8.04	6.22
TV ROOM	506	20.24	45	40.48	49.76
MEDITATION ROOM	118	4.72	56.25	9.44	61.33
STUDY ROOM	136	10.88	56.25	5.44	61.33
FAMILY ROOM	623	49.84	.	24.92	**
GROUND FLOOR					
DINING/ LIVING/ PLAYROOM	1174	93.9	874	46.9	70.6
KITCHEN / DINETTE	646	51.7	177.8	25.8	69.8
OFFICE	161	12.88	52	6.44	53.16
FIRST FLOOR					
MASTER BEDROOM	255	20.4	111.5	10.2	119
MASTER LIVING	144	11.52	57	5.76	12.1
BEDROOM #2	84	6.7	6.83	3.4	7.76
BEDROOM #3	104	8.3	18.6	4.2	21.1
BEDROOM #4	123	9.8	18.6	4.9	21.1
BEDROOM #5	105	8.4	18.6	4.2	21.1
LAUNDRY	50	4	6.83	2	7.76

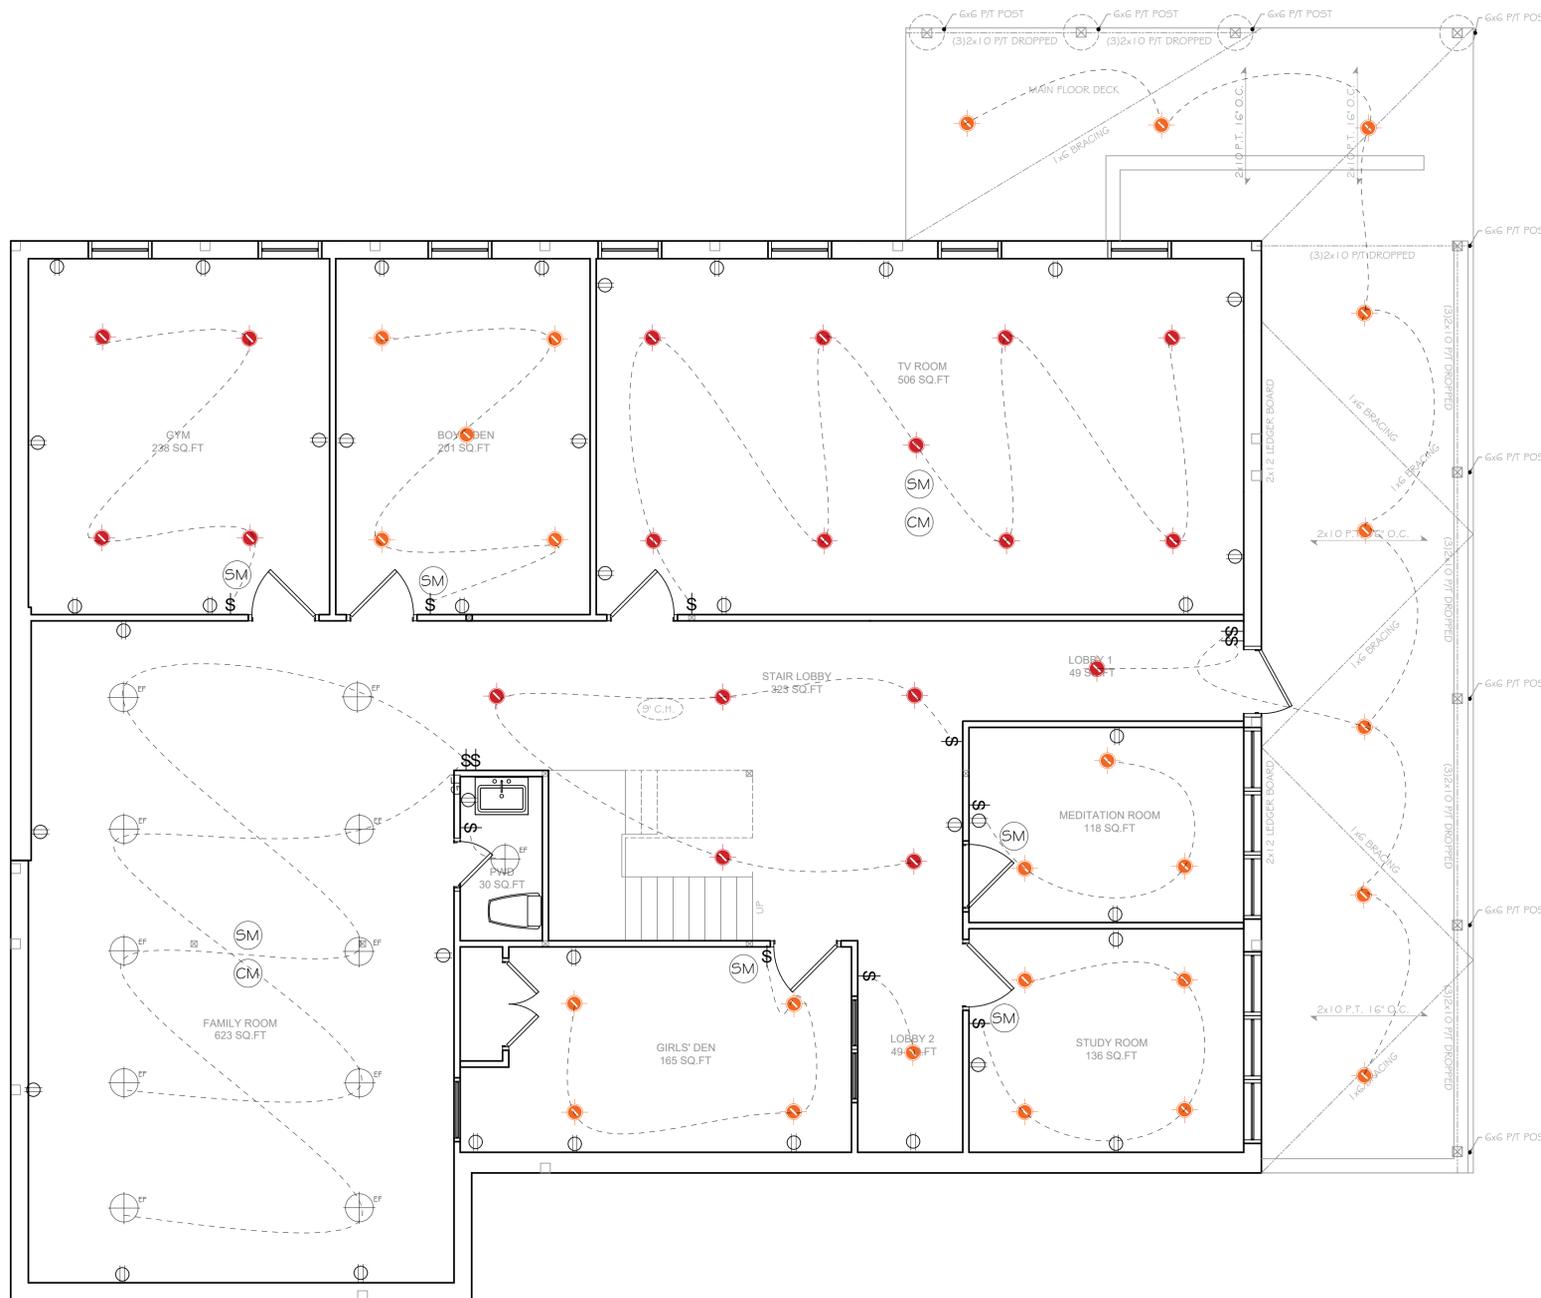

**BASEMENT FLOOR ELECTRIC PLAN**  
SCALE: 1/4" = 1'-0"

PROJECT:

Proposed New Addition For:  
**17 Sterling Forest Ln.**  
Montebello  
Rockland County, New York

DRAWN BY:	Shlome Glauber
DATE:	7/15/2024
DATE:	8/2/2024
DATE:	8/28/2024
DATE:	1/13/2025
DATE:	3/10/2025


**RODGER BRADLEY,**  
ARCHITECTS  
NYS LIC. NO. 013-832  
50 PLATT'S HILL ROAD  
NEWTOWN, CT 06470  
T: 203.426.9918  
Email: rbraley2@sbeglobal.net



DESCRIPTION:

**E-102**

SCALE AS NOTED

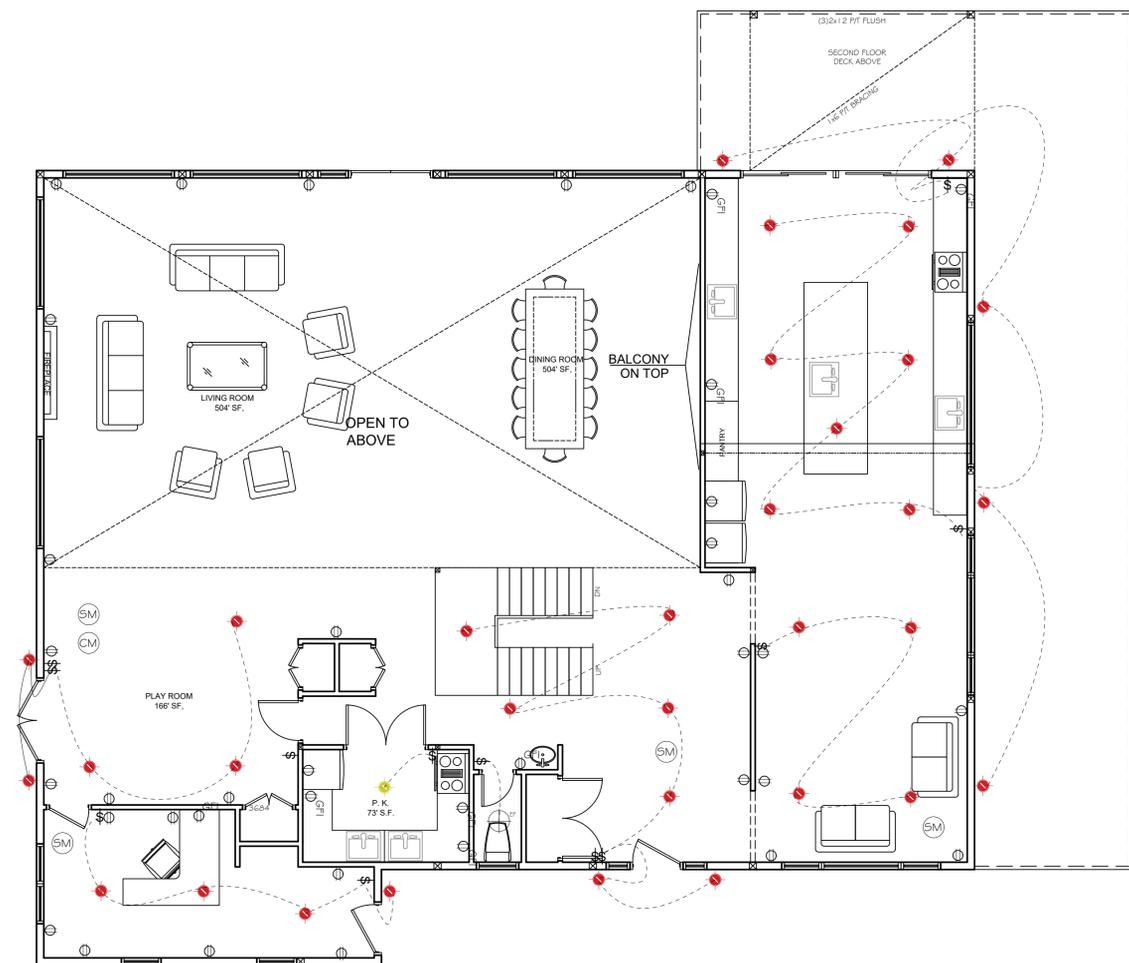

**1** FIRST FLOOR ELECTRIC PLAN  
SCALE: 3/16" = 1'-0"



**2** SECOND FLOOR ELECTRIC PLAN  
SCALE: 3/16" = 1'-0"

**GENERAL NOTES**

ALL WORK SHALL BE IN ACCORDANCE WITH ALL PREVALING CODES, LAWS AND ORDINANCES OF THE 2020 BUILDING & ENERGY CONSERVATION CODES OF NYS, AND THE LOCAL ZONING LAWS OF WHICH THE PROJECT IS LOCATED.

THE CONTRACTOR AND ALL SUBCONTRACTORS SHALL CARRY PRIOR, DURING AND AFTER CONSTRUCTION ALL NECESSARY LICENSES AND INSURANCES PER THE N.Y.S., LOCAL AND ALL GOVERNING REGULATIONS.

THE OWNER SHOULD READ AND REVIEW HIS/HER ENTIRE SET OF CONTRACT DOCUMENTS (PLANS & SPECIFICATIONS) PRIOR TO GIVING IT TO THE CONTRACTOR. OWNER SHALL CONFIRM THAT ALL INFORMATION IS CORRECT. SHOULD THE OWNER FIND ANYTHING THAT WASN'T WHAT THEY INTENDED TO BE DONE, THEN THEY SHALL HAVE THE ARCHITECT AMEND IT AS REQUIRED.

THE ARCHITECT IS NOT RESPONSIBLE FOR CONSTRUCTION, AND/OR PROJECT SITE. THE GENERAL PUBLIC, PROSPECTIVE BUYERS AND ALL OTHER NON-CONSTRUCTION RELATED PERSONS ARE NOT TO ENTER THE CONSTRUCTION WORK AREA UNTIL A VALID CERTIFICATE OF OCCUPANCY IS ISSUED BY THE LOCAL BUILDING DEPARTMENT.

THE PROJECT SITE SHALL BE PROPERLY FENCED AND TAPED AND/OR FENCED OFF TO ENSURE PUBLIC SAFETY AND SAFEGUARD THE PUBLIC AT ALL TIMES. THE CONTRACTOR SHALL VERIFY ALL DIMENSIONS AND FAMILIARIZE HIMSELF WITH THE CONTRACT DOCUMENTS (PLANS & SPECIFICATIONS) PRIOR TO ANY ERECTION/CONSTRUCTION.

ALL DIMENSIONS SHALL BE FIELD VERIFIED BY THE CONTRACTOR AND THE CONTRACTOR SHALL REPORT ANY DISCREPANCIES, ERRORS OR OMISSIONS TO THE ARCHITECT IMMEDIATELY. ALWAYS USE DIMENSIONS AS SHOWN AND THE CONTRACTOR SHOULD REPORT ANY DISCREPANCIES IMMEDIATELY TO THE ARCHITECT.

DRAWINGS ARE NOT TO BE SCALED.

ALL CHANGES MADE BY THE CONTRACTOR SHALL FIRST BE APPROVED BY THE ARCHITECT AND OWNER PRIOR TO STARTING THE WORK INVOLVED. ANY UNAUTHORIZED CHANGES MADE BY THE CONTRACTOR AND ULTIMATELY NOT BEING APPROVED BY THE OWNER AND ARCHITECT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR AND TO BE CORRECTED AT HIS OWN EXPENSE.

THE ARCHITECT HAS NOT BEEN RETAINED FOR ANY MECHANICAL DESIGN SYSTEMS, DUCTS, CHASE OPENINGS, SIZE OF FURNACE AND FRESH AIR REQUIREMENTS ETC. THESE ARE NOT SHOWN AND SHALL BE DETERMINED BY A MECHANICAL ENGINEER PRIOR TO COMMENCING THE WORK.

THE ARCHITECT HAS NOT BEEN RETAINED FOR SUPERVISION, AND CONSTRUCTION INSPECTIONS AND/OR THE REVIEW OF SHOP DRAWINGS. THE ARCHITECT HAS ONLY BEEN RETAINED FOR DESIGN PURPOSES. THEREFORE, THE ARCHITECT ASSUMES NO LIABILITY FOR WORKMANSHIP, CODE AND/OR PLANNING COMPLIANCE. THE ARCHITECT'S RESPONSIBILITY IS STRICTLY LIMITED TO THESE PLANS AND RELATED SPECIFICATIONS ONLY.

THE ARCHITECT SHALL NOT BE RESPONSIBLE FOR ANY CONSTRUCTION MEANS, METHODS, DEVIATIONS, TECHNIQUES, SEQUENCES, OR PROCEDURES, OR FOR ANY SAFETY PRECAUTIONS AND PROGRAMS IN CONNECTION WITH THE WORK, FOR THE OMISSIONS OF THE CONTRACTOR, SUBCONTRACTORS OR ANY OTHER PERSONS PERFORMING ANY OF THE WORK, OR FOR THE FAILURE OF ANY OF THEM TO CARRY OUT THE WORK IN ACCORDANCE WITH THESE DOCUMENTS. THE ARCHITECT ASSUMES NO RESPONSIBILITY FOR ANY EXISTING STRUCTURES AND/OR ANY UNFORESEEN PROBLEMS PRIOR TO NEW CONSTRUCTION.

THE ARCHITECT ASSUMES NO RESPONSIBILITY FOR ANY DEMOLITION, SITE WORK, NEW CONSTRUCTION, OPERATIONAL AND METHOD.

ALL AREAS THAT ARE AFFECTED BY ALL ADDITIONS SHALL BE REPAIRED AND/OR PATCHED TO A LIKE NEW CONDITION, UNLESS NOTED OTHERWISE.

THE CONTRACTOR IS TO OBTAIN ALL NECESSARY PERMITS AND APPROVALS BY THE LOCAL AND STATE AS REQUIRED AND TO DELIVER TO THE OWNER A C.O. UPON COMPLETION OF THE PROJECT.

THE CONTRACTOR SHALL PROVIDE A CONTAINER FOR THE REMOVAL OF DEBRIS DURING CONSTRUCTION.

THE CONTRACTOR AND ALL SUBCONTRACTORS WORKING WITH THIS PROJECT SHALL KEEP THE SITE CLEAN AND HAZARD FREE AT ALL TIMES AND TO OBTAIN ALL OSHA AND ALL OTHER SAFETY REGULATIONS.

THE CONTRACTOR SHALL LEAVE PREMISES BROOM CLEAN DAILY.

THE CONTRACTOR SHALL GUARANTEE ALL WORK SPECIFIED AND/OR DESCRIBED BY THESE DRAWINGS AND IS TO FOLLOW ALL NATIONALLY ACCEPTED TRADE PRACTICES.

**SITE NOTES**

THESE PLANS ARE BASED ACCORDANCE TO THE SURVEY INFORMATION PROVIDED TO THE ARCHITECT BY THE OWNER. THEY SHOULD BE REVIEWED BY A LICENSED LAND SURVEYOR AND/OR ENGINEER TO VERIFY ALL BUILDING LINES, AND SET BACKS PRIOR TO CONSTRUCTION.

THE ELEVATION SHOWN ON THE PLAN MAY NOT BE ACCURATE IN EVERY DETAIL. THE OWNER SHALL REVIEW THE PLANS WITH THE CONTRACTOR TO INSURE ACCURACY OF DETAILS AND METHODS PROVIDED BY THE CONTRACTOR.

THE CONTRACTOR SHALL BE RESPONSIBLE FOR NOTIFYING ALL UTILITY COMPANIES, AND VERIFYING THE LOCATION OF THE SAME. UTILITY COMPANIES, SERVICES AND ALL OTHER POSSIBLE EQUIPMENTS OF UTILITY COMPANIES, THE CONTRACTOR SHALL LOCATE AND IDENTIFY THE LOCATIONS OF ALL EXISTING UNDERGROUND UTILITIES, AND PROVIDE UNDERGROUND CONNECTIONS TO THEM.

THE CONTRACTOR SHALL NOTIFY THE ARCHITECT IMMEDIATELY OF ANY GROUND WATER, EXCESSIVE ORGANIC MATERIAL OR ANY OTHER UNSUITABLE CONDITIONS DISCOVERED DURING SITE PREPARATION AND/OR EXCAVATION.

THE CONTRACTOR SHALL PROVIDE ONE PROPERLY MAINTAINED, PORTABLE TOILET FOR THE ENTIRE DURATION OF THE CONSTRUCTION.

THE CONTRACTOR SHALL PROVIDE FROM A REGISTERED LAND SURVEYOR A WRITTEN CERTIFICATE THAT THE LARGEST PORTION OF THE FIRST FLOOR MEET OR EXCEED THE REQUIRED FLOOR ELEVATION.

ALL DRIVEWAYS AND WALKWAYS FORM WORK SHALL BE APPROVED BY DEVELOPMENT REVIEW REPRESENTATIVE BEFORE ANY WORK CONTINUES. THE CONTRACTOR SHALL REMOVE AND DISPOSE ALL RUBISH, VEGETATION, STUMPS, ROOTS, AND TREES AS SHOWN ON THE PLANS.

ALL AREAS TO BE COVERED WITH FILL AND GRADED DOWN.

THE CONTRACTOR SHALL PROTECT ALL EXISTING TREES SHOWN TO REMAIN AS REQUIRED.

EXTREME CAUTION SHALL BE TAKEN DURING DEMOLITION OF EXISTING BUILDINGS. THE CONTRACTOR SHALL OBSERVE ANY VARIATIONS AND OR ANY UNFORESEEN DISCREPANCIES WITH THE PLANS, AND SHOULD REPORT IMMEDIATELY TO THE ARCHITECT.

THE CONTRACTOR SHALL BE RESPONSIBLE FOR ALL SHORING, BRACING AND ALL TEMPORARY SUPPORTS PRIOR TO REMOVING THE EXISTING WALLS, CEILINGS, FLOORS AND ROOFS AS PER ALL LOCAL AND OSHA REGULATIONS.

THE CONTRACTOR SHALL PROVIDE WEATHERPROOFING AT THE END OF EACH WORK DAY AS REQUIRED TO PREVENT WEATHER DAMAGE. THE ARCHITECT IS NOT RESPONSIBLE FOR FROZEN PIPES AND/OR MOLD CONDITIONS CREATED BY THE CONTRACTOR'S NEGLIGENCE.

BACKFILL SHALL NOT BE PLACED UNTIL THE MAIN FLOOR SYSTEM AND BASEMENT CONCRETE INTERIOR FLOOR SLABS ARE INSTALLED. FOOTING DRAINS SHALL BE PROVIDED AS SHOWN, AND APPROPRIATE. THEY SHOULD BE LAID IN GRAVEL BED AND PROTECTED AT THE TOP WITH FILTER FABRIC AND 6" OF 1/2" GRAVEL AROUND & PROVIDE POSITIVE OUTFALL TO A STORM DRAIN OR A DRY-WELL.

THE FINISHED GRADE AND DRIVEWAY SHOULD BE PITCHED AWAY FROM THE BUILDING SUCH THAT ALL THE SURFACE WATER FLOWS AWAY FROM BUILDING. THE FINISHED GRADE HEIGHT SHALL BE A MINIMUM OF 8" BELOW THE ADJACENT FURNISHING, OR AS INDICATED ON PLANS.

THE TOP OF ANY FOUNDATION SHALL EXTEND ABOVE THE ELEVATION OF THE STREET CUTTERS AT POINT OF DISCHARGE OR THE INLET OF AN APPROVED DRAINAGE DEVICE A MINIMUM OF 12" MINUS 2 PERCENT.

INSTALLATION OF GAS AND ELECTRIC METERS SHOULD BE IN STRICT ACCORDANCE WITH THE LOCAL UTILITY COMPANY SPECIFICATIONS.

**FOUNDATION NOTES**

IT'S THE RESPONSIBILITY OF THE CONTRACTOR TO CHECK AND COORDINATE DIMENSIONS BETWEEN FOUNDATION AND FLOOR PLANS PRIOR TO CONSTRUCTION. ALL EXCAVATIONS SHOULD BE SUBSTANTIALLY FREE OF WATER DURING FOUNDATION CONSTRUCTION WORK.

THIS PROJECT HAS BEEN DESIGNED BY ASSUMING THAT ALL THE SOIL BEARING IS 2 KIPS/SQ. FT. (2008#).

ALL STRUCTURAL CONCRETE SHALL BE A STONE CONCRETE WITH A 1:3:5 MIX AND HAVE A MINIMUM STRENGTH OF 3,500 PSI AT THE END OF 28 DAYS.

ALL FOOTINGS TO REST ON UNDISTURBED SOIL CAPABLE OF SUPPORTING 2 TONS PER SQ. FT.

REFERENCE THE PLANS FOR SIZE AND QUANTITY OF REINFORCING BARS.

ALL FOOTINGS SHALL BE BELOW THE FINISHED GRADE MINIMUM OF 3'-6" IN ROCKLAND COUNTY, 3'-6" IN ORANGE COUNTY OR OTHERWISE SHOWN ON THE PLAN.

PROVIDE EXPANDED JOINTS AT PERIMETERS OF ALL CONCRETE SLABS.

ALL INTERIOR FOOTINGS SHALL STEP DOWN TO PERIMETER WALL FOOTING DEPTH AT ALL FLOOR INTERSECTIONS.

ALL SUB GRADE FILL MATERIAL SHALL BE COMPACTED TO A DENSITY OF 96. ALL CONCRETE SLABS SHALL BE A MINIMUM OF 4" THICK - REINFORCED WITH 6#6/10x10 WELDED WIRE MESH ON 6" MAX VAPOR BARRIER ON 4" OF 3/4" GRAVEL, UNLESS SHOWN OTHERWISE AND TO RECEIVE A SMOOTH FINISH.

ALL CONCRETE PAVING SHALL RECEIVE A FINE BROOM FINISH UNLESS SHOWN OTHERWISE.

ALL CONCRETE SLABS TO RECEIVE CONTROL JOINTS (1/2" SAW CUTS) AT A MAXIMUM OF 25'-2" TO CONTROL CRACKING WITH SHRINKAGE.

SLOPE ALL CONCRETE SLABS TO DRAIN TO EXTERIOR. SLOPES IN GARAGES SHALL BE A MINIMUM OF 1/8"-1"-0" UNLESS SHOWN OTHERWISE.

MASONRY AND CONCRETE CONTRACTOR SHALL INSTALL ALL ANCHOR BOLTS, PLATES, CHASES, SLOTS, SLEEVES, ETC. AS REQUIRED BY TRADES.

CALKY WEATHER-TIGHT ALL OPENINGS.

EXTERIOR OF THE CONCRETE WALLS TO BE COATED WITH RUB-B-R-WALL COATING OR EQUAL. INTERIOR COLUMNS TO BE 4" DIAM. STANDARD STEEL - PROVIDE BASE & TOP PLATES. INTERIOR COLUMNS OVER 9'-0" IN HEIGHT TO BE 5" DIAM. STANDARD STEEL COLUMNS. EXTREME CAUTION TO BE USED IN DELIVERY OF THE STEEL COLUMNS. MUST NOT BE DROPPED AT ANY TIME.

DOMELS MUST BE TIED INTO FOOTING RE-BARS PRIOR TO POURING FOOTINGS.

CONCRETE AIR-ENTRAINED TO NOT LESS THAN 5% OR NO MORE THAN 7% WHERE REQUIRED.

FOUNDATION ANCHOR BOLTS SHALL BE LOCATED IN THE MIDDLE THIRD OF WIDTH OF SILL > AND SUPPLIED WITH NUT & WASHER TIGHTENED TO EACH BOLT.

**FRAMING NOTES**

ALL STANDARD FRAMING LUMBER TO BE HEMLOCK #2 OR BETTER UNLESS OTHERWISE NOTED.

ALL ENGINEERED BEAMS INDICATED ON THE PLANS ARE DESIGNED USING THIS SPECIFIC MANUFACTURER AND SHALL BE INSTALLED PER THE MANUFACTURER'S SPECIFICATIONS ONLY.

WHEN USING MULTIPLE MEMBER ENGINEERED BEAMS, THE FRAMER SHALL REFERENCE WITH THE SPECIFIC MANUFACTURER'S MARKING GUIDE.

PROVIDE METAL FLASHING AT ALL EXTERIOR DOORS, WINDOWS AND OPENINGS UNLESS SHOWN OTHERWISE.

INSTALL 36" WIDE ICE & WATER SHIELD ? AT ALL ROOF EDGES, IN VALLEYS, UP AGAINST WALL JUNCTIONS, OVER HP'S AND WRAP OVER ALL FACIAS. THE SHIELD SHALL COVER MINIMUM 24" TOP OF EXTERIOR SIDE OF EXTERIOR WALLS. PROVIDE OPTIONAL SNOW-GUARDS IF REQUIRED WITH THE STANDARD SPACING ALONG THE BOTTOM EDGE OF THE ROOF.

FRAMING NOTES DIMENSIONS ARE TO THE NEAREST INCH, ACTUAL ROOM SIZES MAY VARY DUE TO GYPSUM BOARD.

ALL WOOD FRAMING IN DIRECT CONTACT WITH SOIL, CONCRETE, MASONRY OR WEATHER SHALL BE PRESSURE TREATED (AWPA STANDARD C2, C3).

ALL FRAMING BELOW THE REQUIRED FLOOR ELEVATION AS SET FORTH BY FEMA AND LOCAL BUILDING OFFICIALS SHALL BE PRESSURE TREATED.

SECURE ALL TEMPORARY RAILINGS WITH GUARDS TO BE INSTALLED AROUND ALL FLOOR OPENINGS AND OPEN DOOR OPENINGS. PROVIDE TEMPORARY RAMPS AND/OR STAIRS TO BE INSTALLED AT ALL LEVELS.

ALL LUMBER TO BE SOUND, DRY AND FREE FROM ROT, KNOTS, AND SPLITS.

ALL FRAMING SHALL BE FRAMED AT 16" O.C. UNLESS SHOWN OTHERWISE.

FOR ALL CONVENTIONAL FLOOR FRAMING PROVIDE A MINIMUM OF ONE ROW OF 5/4 CROSS BRIDGING FOR ALL JOISTS WITH SPANS OVER 12'-0" ? OR SHOWN OTHERWISE ON THE PLANS.

PROVIDE A MINIMUM OF DOUBLE JOISTS BELOW ALL PARALLEL PARTITIONS, MAJOR APPLIANCES, BATH FIXTURES, AND AT ALL CANTILEVERS, UNLESS SHOWN OTHERWISE.

PROVIDE A MINIMUM OF DOUBLE ALL JOISTS AT OPENINGS IN FLOORS, CEILINGS AND ROOFS.

PROVIDE A MINIMUM OF DOUBLE WALL STUDS AROUND ALL WALL OPENINGS, JACK STUDS UNDER ALL MEMBERS, TRIPLE STUDS AT ALL CORNERS.

PROVIDE POSTS AT ALL CEILING, HIP AND VALLEY INTERSECTIONS DOWN TO A MINIMUM OF TRIPLE 2x8'S CEILING JOISTS.

ALL FRAMING SHALL BE FRAMED CROWN UP UNLESS AT CANTILEVERS OR SHOWN OTHERWISE.

SOLID BLOCKING SHALL BE PROVIDED UNDER ALL POSTS THAT DON'T REST DIRECTLY ON JOISTS.

ALL INTERIOR WOOD POSTS SHALL BE SOLID STUDS, AND TO BE A MINIMUM OF THE WIDTH OF THE BEAM SUPPORTING IT AND PROVIDE MINIMUM ONE KING STUD AT EITHER SIDE.

BRACE ALL WALLS DURING CONSTRUCTION.

ALL WALL FRAMING OF 9'-0" AND GREATER SHALL HAVE CATS (SOLID BLOCKING) AT MIDHEIGHT ALL DOORS, WINDOWS AND OPENINGS SHALL HAVE A MINIMUM HEADER TO BE AS FOLLOWS UNLESS SHOWN OTHERWISE ON PLANS. UP TO 5'-0" USE (2)2"x10", UP TO 8'-0" USE (3)2"x10" OR (2)2"x12" MEMBERS GREATER THAN 8'-0" SEE PLANS FOR SIZES.

PROVIDE FASTENER NAILS AS FOLLOWS: 10d AT ALL GENERAL FRAMING AND 8d AT ALL PLYWOOD, 4" SPACING MAX. - TABLES R602.3(1) THROUGH R602.3(4).

**FIRE BLOCKING SHALL BE PROVIDED AS FOLLOWS**

1. IN CONCEALED SPACES OF STUD WALLS AND PARTITIONS, INCLUDING FURRED SPACES, AT THE CEILING & FLOOR LEVELS, CONCEALED HORIZ. FURRED SPACES SHALL ALSO BE FIRE BLOCKED AT INTERVAL NOT EXCEEDING 10 FEET. BATTIS OR BLANKETS OF MINERAL OR GLASS FIBER SHALL BE ALLOWED AS FIRE BLOCKING IN WALLS CONSTRUCTED USING ROWS OF STUDS OR STAGGERED STUDS.
2. AT ALL INTERCONNECTIONS BET. CONCEALED VERT. & HORIZ. SPACES SUCH AS OCCUR AT SOFFITS, DROP CEILINGS AND COVE CEILINGS.
3. IN CONCEALED SPACES BET. STAIR STRINGERS AT TOP & BOTTOM OF THE RUN. ENCLOSED SPACES UNDER STAIRS SHALL COMPLY W/SECTION R311.2.2.
4. AT OPENINGS AROUND VENTS, PIPES AND DUCTS AT CEILING AND FLOOR LEVEL, W/ AN APPROV. MATERIAL TO RESIST THE FREE PASSAGE OF FLAME AND PRODUCTS OF COMBUSTION.
5. FOR THE FIRE BLOCKING OF CHIMNEYS & FIREPLACES, SEE SECTION R1001.16.
6. FIRE BLOCKING OF CORNICES OF A FAMILY DWELLING IS REQ'D AT THE LINE OF DWELLING UNIT SEPARATION.

**ROOFING & SIDING**

ROOFING, SIDING, TRIM, AND OTHER MATERIALS SHALL BE INSTALLED IN STRICT ACCORD WITH THEIR RESPECTIVE MANUFACTURERS SPECIFICATIONS AND INDUSTRY STANDARDS.

PROVIDE ALUMINUM GUTTERS & ROOF DRAIN LEADERS (ROLS) AS REQUIRED. ROLS AT OUTLET TO BE CONNECTED TO SITE STORM DRAINAGE SYSTEM.

PROVIDE APPROVED SNOW GUARDS AT ROOF EDGES WITH PITCH EXCEEDING 7:12 OVER ALL DOORWAYS, DECKS & WALKWAYS WITHIN 36" OF DWELLING ROOFING, SIDING, TRIM AND OTHER MATERIALS COLORS TO BE DETERMINED FROM BUILDERS SELECTION PRIOR TO ORDERING. ARCHITECT IS NOT RESPONSIBLE FOR COLOR AND/OR MATERIAL SELECTIONS.

**DOOR & WINDOW NOTES**

ALL WINDOWS AND EXTERIOR DOORS SHALL COMPLY WITH THE ENERGY CONSERVATION CODE OF N.Y.S. AND FOR THE COUNTY THIS PROJECT IS LOCATED.

ALL DOORS SHALL CONFORM TO THE STATE CODE SIZE REQUIREMENTS. WINDOW SCHEDULE IS FOR DESIGN INTENT ONLY. THE CONTRACTOR SHALL VERIFY WITH OWNER ALL WINDOWS, DOOR, AND ADDITIONAL OPTIONS SUCH AS, COLOR, HARDWARE PRIOR TO ORDERING.

ALL WINDOWS AND DOORS SHALL BE INSTALLED WITH STRICT ACCORDANCE TO THEIR PARTICULAR MANUFACTURERS SPECIFICATIONS AND TO VERIFY WINDOW ROUGH OPENINGS WITH THE MANUFACTURER.

ALL HEADER HEIGHTS TO BE 6"-9" ABOVE THE FINISHED FLOOR, UNLESS NOTED OTHERWISE.

ALL WINDOWS IN HABITABLE SPACES SHALL COMPLY WITH THE RESIDENTIAL CODE OF THE N.Y.S. EGRESS REQUIREMENTS. THESE WINDOWS SHALL HAVE A SILL HEIGHT OF NOT GREATER THAN 44" ABOVE FINISHED FLOOR. THESE WINDOWS SHALL HAVE A MIN. OF 5.7 SQ. FT. CLEAR OPENING AND 10.3 SQ. FT. OF GLASS AREA FOR NATURAL LIGHT.

AT ALL EGRESS BASEMENT WINDOWS THAT ARE BELOW THE FINISHED GRADE SHALL BE PROVIDED WITH AN APPROVED WINDOW WELL AND DRAINAGE AS PER THE N.Y.S. AND LOCAL CODES.

ALL GLAZING LESS THAN 18" ABOVE FINISHED FLOOR/SURFACE AND ALL GLASS TUB AND/OR SHOWER ENCLOSURES SHALL BE TEMPERED GLASS.

ALL FIXED GLASS SHALL BE IN FRAMES TO MATCH THE MANUFACTURER OF OPERABLE WINDOWS.

ALL WINDOWS SHALL BE MANUFACTURED BY ANDERSEN OR EQUAL UNLESS SHOWN OTHERWISE.

ALL SPLYLIGHTS, METAL FLUES, VENTS, STACKS OR ANY OTHER ROOF ACCESSORIES THAT REQUIRE FLASHING SHALL BE INSTALLED AS PER THE MANUFACTURER'S SPECIFICATIONS.

PROVIDE ADDITIONAL ALUMINUM BLIND FLASHING WHERE REQUIRED TO INSURE WATER TIGHT CONDITIONS.

INSTALL FLASHING AT ALL ENTRANCE SLABS ADJACENT TO WALL CONSTRUCTION. PROVIDE ADEQUATE AIR SPACE BEHIND BRICK, STONE AND OTHER SIDINGS AS REQUIRED.

ALL BEADS, STOPS AND TRIM SHALL BE MANUFACTURED FROM RUST RESISTANT ALL EXTERIOR SWING DOORS SHALL BE MANUFACTURED BY THERMA-TRU OR EQUAL UNLESS SHOWN OTHERWISE.

ALL WINDOW & DOOR JAMBS TO BE FOAM SEALED & WEATHER STRIPPED ON EXTERIOR AS PER THE 2015 INTERNATIONAL ENERGY CONSERVATION CODE.

**DRYWALL NOTES**

ALL GYPSUM BOARD DRYWALL CUT JOINTS SHALL BE ADJACENT TO CORNERS. NO BUTT JOINTS IN WALL SHALL BE PERMITTED.

ALL CORNERS AND JOINTS SHALL RECEIVE TWO COATS OF JOINT COMPOUND FEATHERED SMOOTH AND ALL DIMPLES CREATED BY FASTENERS SHALL RECEIVE THREE COATS OF JOINT COMPOUND FEATHERED SMOOTH.

ALL GYPSUM BOARD SHALL BE IN ACCORDANCE WITH THE GYPSUM CONSTRUCTION HANDBOOK, PUBLISHED BY THE UNITED STATES GYPSUM COMPANY.

ALL MATERIALS SHALL BE FURNISHED BY THE UNITED STATES GYPSUM COMPANY, NATIONAL GYPSUM COMPANY, CELOTEX CORP., OR OTHER APPROVED MANUFACTURER.

USE WATERPROOF GYPSUM BOARD AT ALL TUBS, SHOWER SURROUNDS AND OTHER WET LOCATIONS. (DUR-0-ROCK OR EQUAL)

**STAIR & RAILING NOTES**

ALL STAIRS AND RAILINGS SHALL COMPLY WITH THE 2020 NYS RESIDENTIAL CODE ALL STAIRWAYS SHALL NOT BE LESS THAN 36" IN CLEAR WIDTH AT ALL POINTS ABOVE THE PERMITTED HANDRAIL HEIGHT AND BELOW THE REQUIRED HEADROOM HEIGHT.

HANDRAILS SHALL NOT PROJECT INTO THE STAIRWAY MORE THAN 4 COMBINED CLEAR WIDTH OF 27" ? IF THERE IS TWO HANDRAILS AND 31" THERE IS ONLY ONE HANDRAIL WITH A MINIMUM WALL CLEARANCE OF 1" THE MINIMUM HEADROOM IN ALL PARTS OF STAIRWAYS SHALL BE LESS THAN 6'-8" MEASURED VERTICALLY FROM THE SLOPED PLANE ADJOINING THE TREAD NOSING OR FROM THE FLOOR SURFACE OF THE LANDING OR PLATFORM.

ENCLOSED ACCESSIBLE SPACE UNDER STAIRS SHALL HAVE WALLS, UNDER STAIR SURFACE AND SOFFITS PROTECTED ON THE ENCLOSED SIDE W/ 1" GYP. BD. THE MAXIMUM RISER HEIGHT IS 8 3/4" THE GREATEST RISER HEIGHT SHALL NOT EXCEED THE SMALLEST BY MORE THAN 3/8".

THE MINIMUM TREAD DEPTH IS 9" ? THE GREATEST TREAD DEPTH SHALL NOT EXCEED THE SMALLEST BY MORE THAN 3/8".

WINDER TREADS ARE PERMITTED PROVIDED THAT THE WIDTH OF THE TREAD AT A POINT IS NOT MORE THAN 12" AND FROM THE NARROW SIDE IS NOT LESS THAN 10". WINDER TREADS SHALL HAVE A MINIMUM TREAD DEPTH OF 6" AT ANY POINT.

THE GREATEST WINDER TREAD DEPTH AT THE 12" WALK LINE SHALL NOT EXCEED THE SMALLEST BY MORE THAN 1/4".

A NOSING NOT LESS OF 3/4" AND NOT GREATER THAN 1" ON STAIRWAYS WITH SOLID RISERS.

THE GREATEST NOSING PROJECTION SHALL NOT EXCEED THE SMALLEST BY MORE THAN 3/8".

OPEN RISERS ARE PERMITTED, PROVIDED THAT THE OPENING BETWEEN TREADS DOES NOT PERMIT THE PASSAGE OF A 4" DIAMETER SPHERE.

HANDRAIL HEIGHT SHALL BE A MINIMUM OF 34" \* AND 38" OPEN RAILINGS AND GUARDS SHALL NOT BE GREATER THAN 4".

IF DECKS OR PLATFORMS ARE 8'-0" AND GREATER ABOVE THE FINISHED GRADE THAN THE HANDRAIL SHALL BE 42" IN HEIGHT.

**TRIM & PAINTING NOTES**

ALL CLOSETS SHALL HAVE AS A MINIMUM OF ONE (1) HIGH SHELF AND ONE (1) ROOF HANGING CLOTHING. PROVIDE FIVE (5) SHELVES IN LINEN CLOSET.

THE CONTRACTOR SHALL DOUBLE CHECK AND VERIFY ALL AS BUILT DIMENSIONS AND CONDITIONS PRIOR TO ORDERING CABINETS, COUNTER TOPS AND VANITIES.

ALL EXPOSED BASED CABINET SIDES SHALL HAVE TOE SPACE UNLESS SHOWN OTHERWISE.

ALL PAINTS AND STAINS SHALL BE OF A MANUFACTURER AS SCHEDULED OR AS DIRECTED BY BUILDER.

ALL INTERIOR GYPSUM BOARDS, WALLS AND CEILINGS, SHALL RECEIVE ONE COAT PRIMER AND TWO COATS OF PAINT OF BENJAMIN MOORE OR EQUAL.

ALL INTERIOR WOOD, TRIM, SHELING AND OAK FLOORS SHALL BE FINISHED AS SCHEDULED OR AS DIRECTED BY BUILDER.

ALL INTERIOR DOORS, TRIM AND EXPOSED WOOD SHALL BE SANDED COMPLETELY SMOOTH PRIOR TO APPLYING FINISH.

ALL EXPOSED FERROUS METAL SHALL BE PAINTED WITH A RUST INHIBITOR AND TWO COATS OF ENAMEL.

**PUMBING NOTES**

ALL PLUMBING WORK EQUIPMENT AND FIXTURES SHALL BE PLACED AND INSTALLED PER THE 2020 PLUMBING CODE OF NEW YORK STATE AND INDUSTRY STANDARDS.

THE CONTRACTOR SHALL VERIFY WITH THE OWNER ALL FIXTURES, MODELS, COLORS ETC. PRIOR OF ORDERING INSTALL.

IRON PIPING UNDER ALL CONCRETE SLABS. GAS LINES TO BE GROUNDED TO BLACK PIPE AT SERVICE ENTRY VENT STACK SHALL EXTEND ABOVE ROOF 18" ABOVE 12" ABOVE AND SNOWFALL.

THE PLUMBING CONTRACTOR SHALL PROVIDE DRYER VENTS AS PER THE RESIDENTIAL CODE OF N.Y.S.

THE PLUMBING CONTRACTOR SHALL NOT DRILL OR CUT ANY STRUCTURAL ORDERS, HEADERS, BEAMS WITHOUT PRIOR CONSENT FROM THE ARCHITECT.

DRILLING AND CUTTING OF FLOOR JOISTS SHALL BE IN STRICT ACCORDANCE WITH THE CODE AND/OR SAID JOIST MANUFACTURERS SPECIFICATIONS.

THE PLUMBING CONTRACTOR SHALL VERIFY FIXTURE AND PIPE LOCATIONS WITH OTHER TRADES INVOLVED WITH THIS JOB PRIOR TO INSTALLATION.

THE PLUMBING CONTRACTOR SHALL PROVIDE SHOWER PANS UNDER CLOTHES WASHER WITH A DRAIN CONNECTED TO THE WASTE PLUMBING SYSTEM.

THE PLUMBING CONTRACTOR SHALL PROVIDE WHOLE HOUSE BACK-FLOW PREVENTION VALVES AND ADEQUATE WHIRLPOOL TUB MOTOR AND SMULAR EQUIPMENT.

THE PLUMBING CONTRACTOR SHALL PROVIDE AND INSTALL EQUIPMENT FLUES AS REQUIRED BY THE RESIDENTIAL CODE OF N.Y.S.

ALL HOSE BIBS SHALL BE FREEZE PROOF TYPE.

LOCATIONS AND QUANTITY SHALL BE AS PER OWNERS INSTRUCTIONS. UNLESS SHOWN OTHERWISE A MINIMUM OF TWO (2) HOSE BIBS SHALL BE PROVIDED; ONE (1) LOCATED AT THE FRONT AND ONE (1) LOCATED AT REAR.

**MECHANICAL NOTES**

ALL MECHANICAL WORK (FURNACE, BOILERS, HVAC, HOT WATER, ETC.) SYSTEMS, AND INSTALLATION SHALL COMPLY IN ACCORDANCE WITH THE 2020 PLUMBING, MECHANICAL, AND FUEL CODES OF NEW YORK STATE AND INDUSTRY STANDARDS.

THE SYSTEMS SHALL BE DESIGNED AND GUARANTEED BY THE MECHANICAL SUBCONTRACTOR TO MEET AND/OR EXCEED THE FOLLOWING REQUIREMENTS: MAINTAIN 70 °F INSIDE WHEN THE OUTSIDE TEMPERATURE IS 100°F AND MAINTAIN 70°F INSIDE WHEN THE OUTSIDE TEMPERATURE IS 0 °F.

ALL HEATING LINES SHALL CONTAIN ANTIFREEZE.

LOCATE ATTIC MECHANICAL UNITS ON GALVANIZED DRIP PANS, DRAINED. ALL DUCTS SHALL BE FIBERGLASS INSULATED TYPE (EXCEPT GALVANIZED UNDERSLAB DUCTWORK).

THE MECHANICAL SUBCONTRACTOR SHALL SUBMIT SHOP DRAWINGS TO THE BUILDER FOR APPROVAL PRIOR TO ANY EACH SYSTEM SHALL BE SEPARATE AND COMPLETE WITH EACH SYSTEM HAVING SUPPLEMENTAL STRIP HEAT.

CARRIER, TRANE, LENOX, AND YORK ARE APPROVED MANUFACTURERS FOR THE MECHANICAL UNIT, ANY SUBSTITUTES MUST BE APPROVED IN WRITING BY THE ARCHITECT OR OWNER.

ALL MECHANICAL UNITS IN ATTIC SHALL BE LOCATED IN SUCH MANNER THAT THEY SHALL NOT CAUSE AN OBSTRUCTION TO FUTURE ATTIC FLOORING.

PROVIDE THE PROPER FIRE RATED SEPARATION AT THE MECHANICAL ROOM (FURNACE, HVAC, HOT WATER, ETC. AS PER THE BUILDING CODE PROVIDE BACKDRAFT DAMPER EXHAUST DUCTS TO BE MIN. 0.016 INCHES RIGID METAL. AMX HORIZ. LENGTH NOT TO EXCEED 25 FT. PROVIDE BOOSTER FAN IF GREATER THAN 25 FT.

BATHS & LAVS WITHOUT OPERABLE WINDOWS OR DOORS WITH LESS THAN 1.5 S.F. OPENING SHALL BE MECHANICALLY VENTED TO EXTERIOR.

INTERMITTENT VENTILATION TO BE MIN. 50 CFM, CONTINUOUS VENTING TO BE MIN. 20 CFM.

**ELECTRICAL NOTES**

ALL OUTLETS, FIXTURES AND ALL OTHER ELECTRICAL WORK SHALL BE PLACED, AND INSTALLED AS PER THE 2018 NFPA LATEST EDITION, THE LATEST EDITION OF THE N.E.C., N.B.F.U., AND THE LOCAL UTILITY CO. ELECTRICAL PANELS SHALL BE FULLY RECESSED AND HAVE ALL CIRCUITS CLEARLY LABELED.

A MINIMUM OF 20% OF CIRCUITS SHALL BE FOR FUTURE USE FOR EACH PANEL USED.

TELEPHONE AND TELEVISION OUTLETS SHALL BE WIRED TO LOCAL PROVIDERS SPECIFICATIONS TO A POINT OF ENTRY APPROVED BY OWNER UNLESS SHOWN ON PLANS OTHERWISE.

THE ELECTRICAL CONTRACTOR SHALL PROVIDE MECHANICAL EXHAUST FANS; FOR ALL RANGES, AND IN ALL LAUNDRY, TOILET, TUB, AND SHOWER AREAS. ALL FAN FIXTURES SHALL BE SWITCHED SEPARATELY AND VENTED TO THE EXTERIOR.

THE ELECTRICAL CONTRACTOR SHALL PROVIDE A SWITCH FOR THE DISHWASHER LOCATED IN SINK CAB.

ALL RECEPTACLES SHOWN ABOVE THE COUNTER SHALL HAVE THE BOTTOM FLUSH WITH TOP OF THE BACK SPLASH.

THE ELECTRICAL CONTRACTOR SHALL NOT DRILL OR CUT ANY STRUCTURAL ORDERS, HEADERS AND BEAMS WITHOUT PRIOR CONSENT FROM THE ARCHITECT.

THE CONTRACTOR SHALL CONSULT AND COORDINATE WITH OTHER TRADES INVOLVED WITH THIS PROJECT PRIOR TO INSTALLATION.

THE ELECTRICAL CONTRACTOR SHALL VERIFY WITH THE OWNER ALL ELECTRICAL DEVICE AND FIXTURE LOCATIONS.

THE ELECTRICAL CONTRACTOR SHALL VERIFY WITH THE OWNER ALL ELECTRICAL DEVICE AND FIXTURE OPTIONS SUCH AS COLOR, AND STYLE PRIOR OF ORDERING.

ALL SMOKE AND CARBON MONOXIDE DETECTORS SHALL BE HARROWED AND INTERCONNECTED WITH BATTERY.

PROVIDE ONE SMOKE DETECTORS AS INDICATED ON PLANS AND AS PER ALL CODE REQUIREMENTS AND PROVIDE A MINIMUM OF ONE CARBON MONOXIDE DETECTOR ON EVERY FLOOR.

LOCATE SMOKE DETECTORS ON FLAT CEILING NO CLOSER THAN 16" FROM WALL.

ALL OUTLETS TO BE TAMPERPROOF.

ARC-FAULT OUTLETS IN ALL ROOMS EXCEPT KITCHEN AND BATHS. ALL RECESSED LIGHTS TO MEET 10" REQUIREMENTS FOR AIR INFILTRATION.

50% OF LAMPS TO BE HIGH EFFICIENCY.

OUTDOOR RECEPTACLES MUST BE GFCI PROTECTED AS PER LATEST NEC RECEPTACLES MUST BE ON A MINIMUM OF 2 BRANCH CIRCUITS AS PER LATEST NEC BATHROOM GFCI OUTLETS TO BE ON STANDALONE BRANCH CIRCUIT AS PER LATEST NEC ALL ELECTRICAL WORK TO BE TAMPER RESISTANT.

ALL ELECTRICAL WORK TO COMPLY WITH THE NYS AND INTERNATIONAL ELECTRIC CODE.

**ADDITIONAL NOTES**

ALL THERMOSTATS TO BE PROGRAMMABLE - DIGITAL AS MFG. BY WHITE ROEERS OR EQUAL.

ALL SUPPLY PIPING AND/OR DUCT WORK TO RECEIVE R-8 INSULATION WHEN IN UNCONDITIONED SPACES.

ALL HEATING AND/OR COOLING PUMPS TO BE VARIABLE SPEED OF [HP].

ALL PLUMBING & PIPING TO COMPLY WITH APPLICABLE 2020 PLUMBING CODE OF NYS.

TABLE R502.3.1(2) FLOOR JOIST SPANS FOR COMMON LUMBER SPECIES (RESIDENTIAL LIVING AREAS, LIVE LOAD=40 psf, L/A =360)

JOIST SPACING (inches)	SPECIES AND GRADE	DEAD LOAD = 10 psf				DEAD LOAD = 20 psf			
		2x6	2x8	2x10	2x12	2x6	2x8	2x10	2x12
		(ft.-in.)	(ft.-in.)	(ft.-in.)	(ft.-in.)	(ft.-in.)	(ft.-in.)	(ft.-in.)	(ft.-in.)
12	DOUGLAS FIR-LARCH #2	11-10	15-7	19-10	23-4	11-8	14-9	18-0	20-11
	HEM-FIR #2	11-0	14-6	18-6	22-6	11-0	14-4	17-6	20-4
	SPRUCE-PINE-FIR #2	11-3	14-11	19-0	23-0	11-3	14-7	17-9	20-7
16	DOUGLAS FIR-LARCH #1	10-11	14-5	18-5	21-4	10-8	13-6	16-5	19-1
	DOUGLAS FIR-LARCH #2	10-9	14-2	17-5	20-3	10-1	12-9	15-7	18-1
	HEM-FIR #1	10-6	13-10	17-8	21-1	10-6	13-4	16-3	18-10
19.2	HEM-FIR #1	10-0	13-2	16-10	19-8	9-10	12-5	15-2	17-7
	SPRUCE-PINE-FIR #1	10-3	13-6	17-2	19-11	9-11	12-7	15-5	17-10
	SPRUCE-PINE-FIR #2	10-3	13-6	17-2	19-11	9-11	12-7	15-5	17-10
24	DOUGLAS FIR-LARCH #2	10-1	13-0	15-11	18-6	9-3	11-8	14-3	16-6
	HEM-FIR #2	9-5	12-5	15-6	17-1	8-11	11-4	13-10	16-1
	SPRUCE-PINE-FIR #2	9-8	12-9	15-8	18-3	9-1	11-6	14-1	16-3

NOTE: CHECK SOURCES FOR AVAILABILITY OF LUMBER IN LENGTHS GREATER THAN 20 FEET.

TABLE R502.3.1(2) FLOOR JOIST SPANS FOR COMMON LUMBER SPECIES (RESIDENTIAL LIVING AREAS, LIVE LOAD=40 psf, L/A =360)

JOIST SPACING (inches)	SPECIES AND GRADE	DEAD LOAD = 10 psf				DEAD LOAD = 20 psf			
		2x6	2x8	2x10	2x12	2x6	2x8	2x10	2x12
		(ft.-in.)	(ft.-in.)	(ft.-in.)	(ft.-in.)	(ft.-in.)	(ft.-in.)	(ft.-in.)	(ft.-in.)
12	DOUGLAS FIR-LARCH #2	10-9	14-2	18-0	20-11	10-8	13-6	16-5	19-1
	HEM-FIR #2	10-0	13-2	16-10	20-4	10-0	13-1	16-0	18-6
	SPRUCE-PINE-FIR #2	10-3	13-6	17-3	20-7	10-3	13-3	16-3	18-10
16	DOUGLAS FIR-LARCH #1	9-11	13-1	16-5	19-1	9-8	12-4	15-0	17-5
	DOUGLAS FIR-LARCH #2	9-9	12-9	15-7	18-1	9-3	11-8	14-3	16-6
	HEM-FIR #1	9-6	12-7	16-0	18-10	9-6	12-2	14-10	17-2
19.2	HEM-FIR #1	9-1	12-0	15-2	17-7	8-11	11-4	13-10	16-1
	SPRUCE-PINE-FIR #1	9-4	12-3	15-5	17-10	9-1	11-6	14-1	16-3
	SPRUCE-PINE-FIR #2	9-4	12-3	15-5	17-10	9-1	11-6	14-1	16-3
24	DOUGLAS FIR-LARCH #2	9-2	11-8	14-3	16-6	8-5	10-8	13-0	15-11
	HEM-FIR #2	8-7	11-3	13-10	16-1	8-2	10-4	12-8	14-8
	SPRUCE-PINE-FIR #2	8-9	11-6	14-1	16-3	8-3	10-6	12-10	14-10
24	DOUGLAS FIR-LARCH #2	8-3							

**PROJECT:**

Proposed New Addition For:  
**17 Sterling Forest Ln.**  
Montebello  
Rockland County, New York

<b>DRAWN BY:</b>	Shlome Glauber
<b>DATE:</b>	7/15/2024
<b>DATE:</b>	8/2/2024
<b>DATE:</b>	8/28/2024
<b>DATE:</b>	1/13/2025
<b>DATE:</b>	3/10/2025


**RODGER BRADLEY,**  
ARCHITECTS  
NYS LIC. NO. 013-832  
50 PLATT'S HILL ROAD  
NEWTOWN, CT 06470  
T: 203.426.9918  
Email: rbraley2@sbeglobal.net



**DESCRIPTION:**

**PLOT -01**

**SCALE** AS NOTED

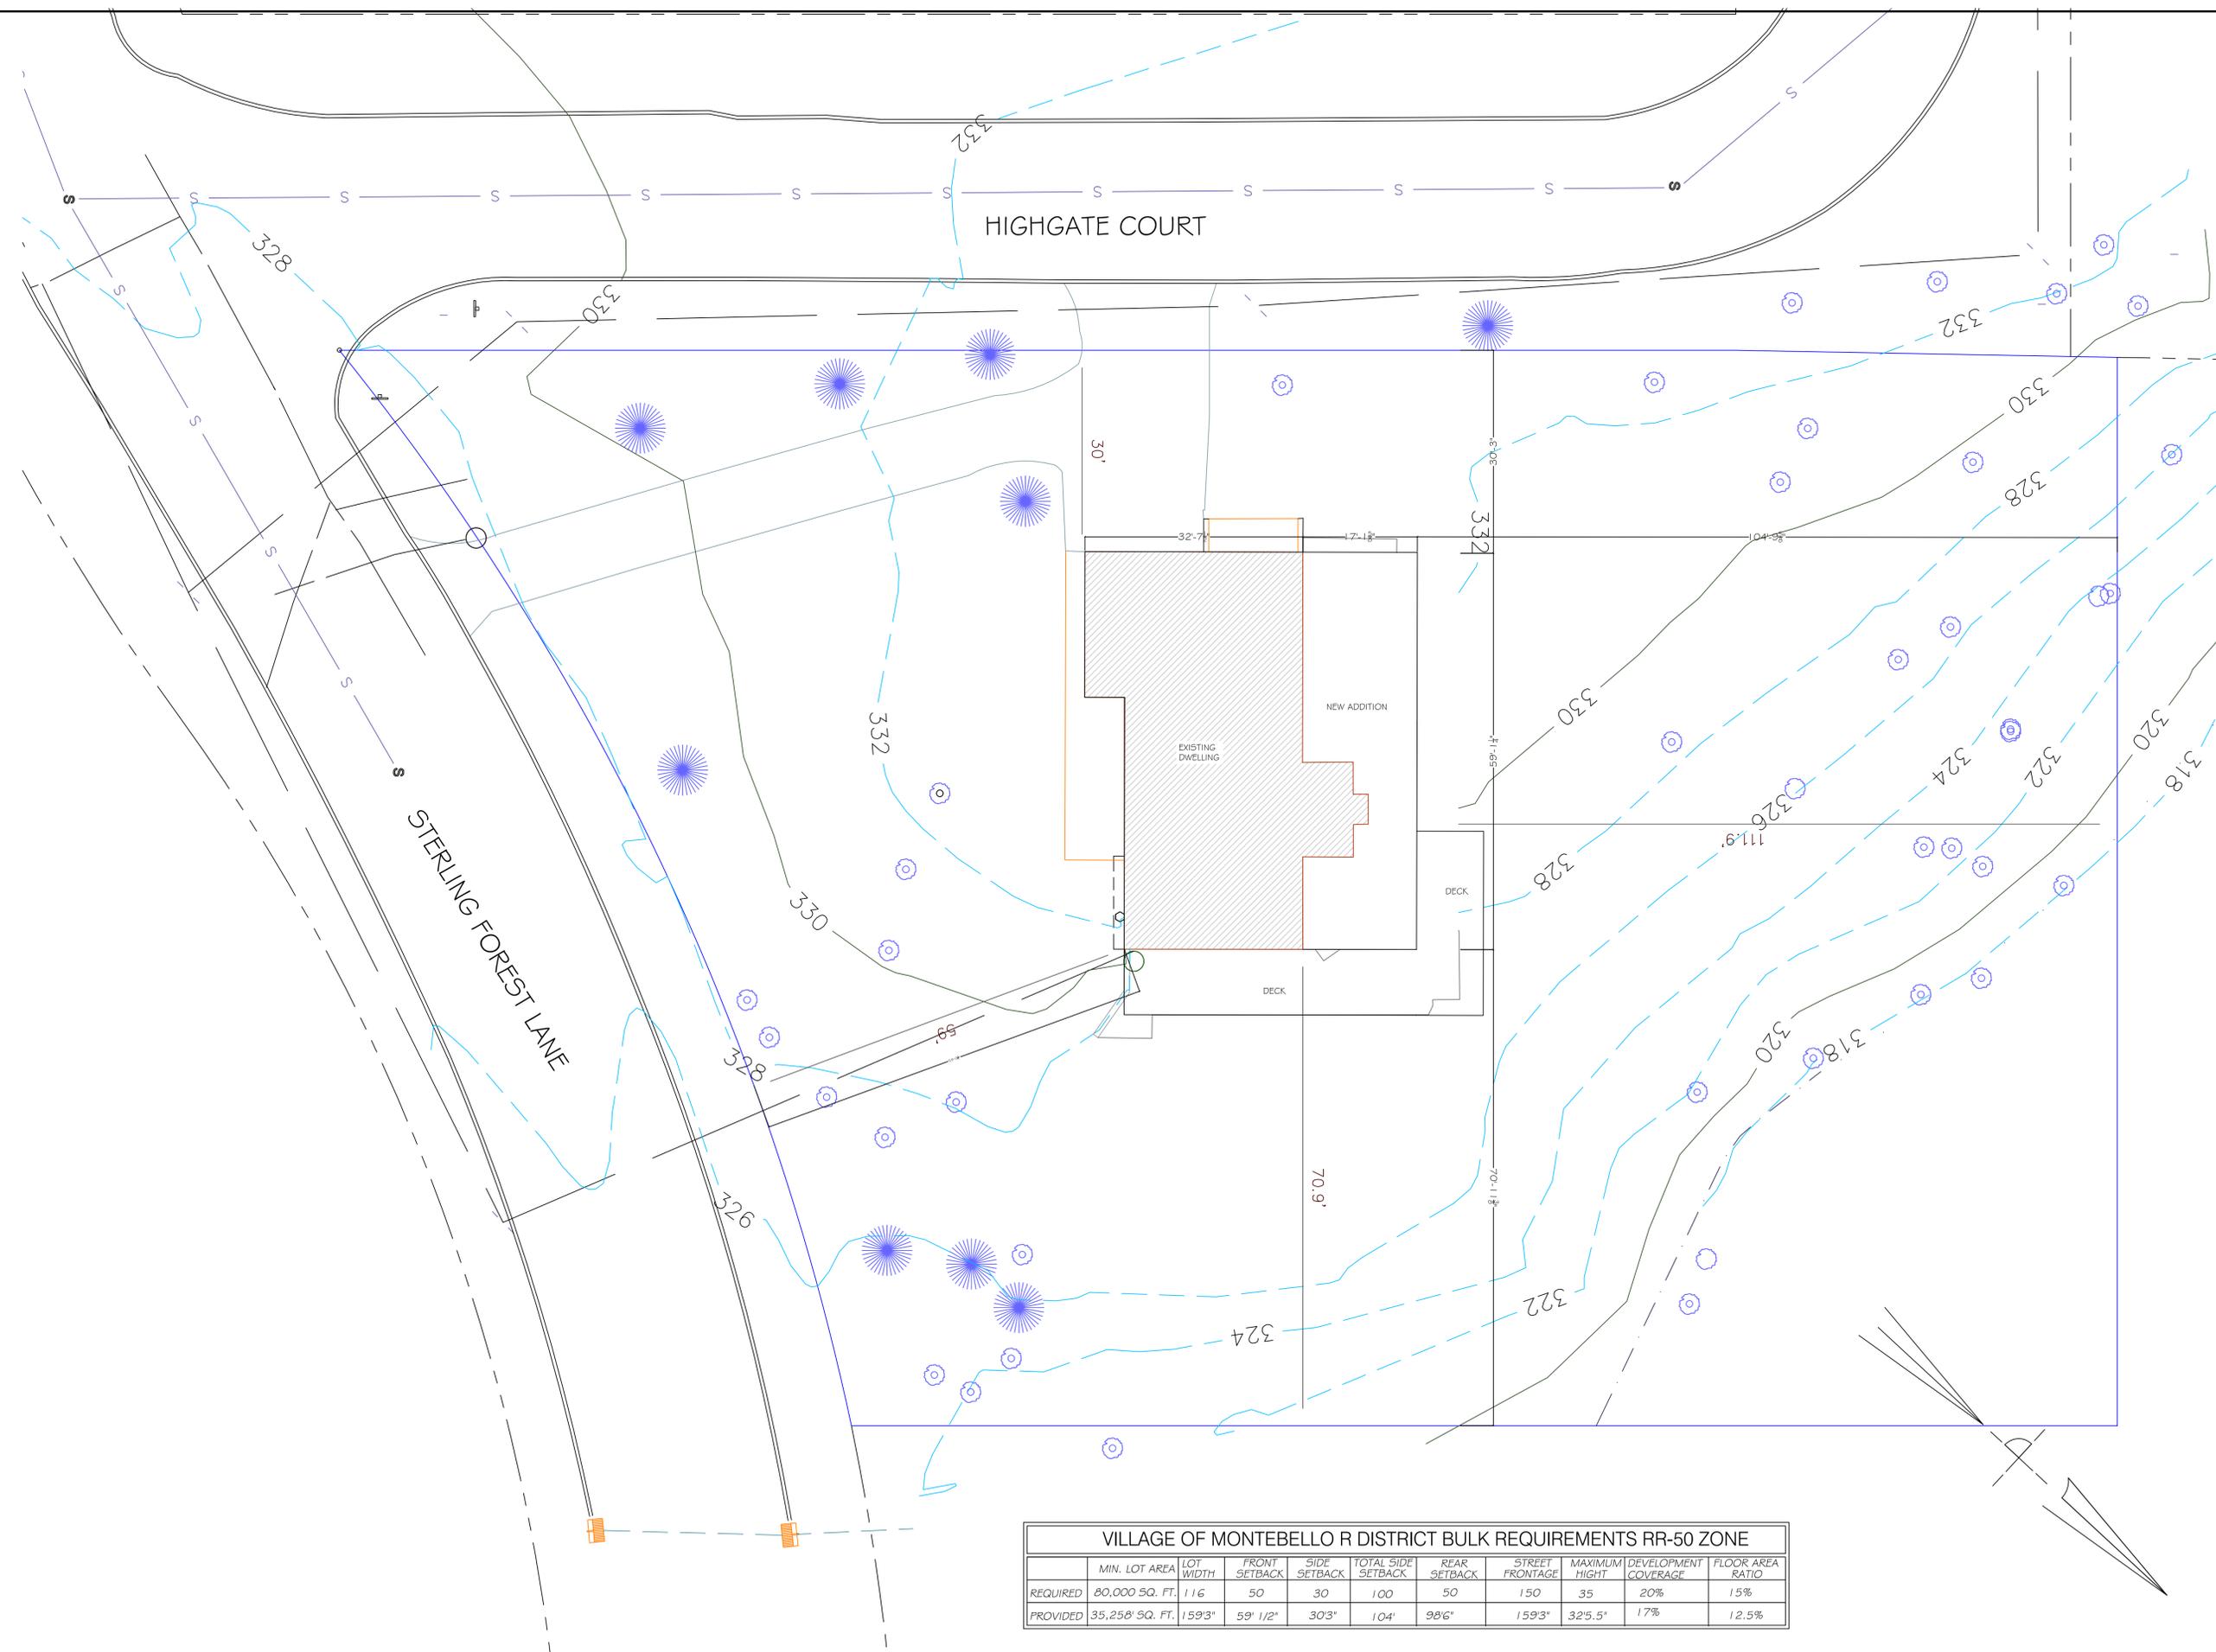

VILLAGE OF MONTEBELLO R DISTRICT BULK REQUIREMENTS RR-50 ZONE										
	MIN. LOT AREA	LOT WIDTH	FRONT SETBACK	SIDE SETBACK	TOTAL SIDE SETBACK	REAR SETBACK	STREET FRONTAGE	MAXIMUM HEIGHT	DEVELOPMENT COVERAGE	FLOOR AREA RATIO
REQUIRED	80,000 SQ. FT.	116	50	30	100	50	150	35	20%	15%
PROVIDED	35,258 SQ. FT.	159'3"	59' 1/2"	30'3"	104'	98'6"	159'3"	32'5.5"	17%	12.5%