

Proposed New Addition For:

17 Sterling Forest Ln.

Montebello

Rockland County, New York

INDEX

- A-101 FOUNDATION AND FOOTING PLAN
- A-102 BASEMENT FLOOR PLAN
- A-103 FIRST FLOOR PLAN WITH DETAILS
- A-104 SECOND FLOOR PLAN
- A-105 NORTH SOUTH WEST EAST SIDES ELEVATION
- A-106 ROOF PLAN WITH TRUSS SIGN AND TYP. WALL SECTION
- A-107 TYPICAL DECK AND BRACING DETAILS
- E-101 BASEMENT LEVEL ELECTRIC PLAN
- E-102 FIRST AND SECOND FLOORS ELECTRIC PLAN
- PL-01 PLUMBING RISER DIAGRAM AND REQUIREMENTS
- SP-01 GENERAL NOTES AND TABLES
- PLOT PLOT PLAN



MONROE, N.Y. 10950
(845) 492-1783
Email: office@szdrawings.com

PROJECT:

Proposed New Addition For:
17 Sterling Forest Ln.
Montebello
Rockland County, New York

DRAWN BY:	Shlome Glauber
DATE:	7/15/2024
DATE:	8/2/2024
DATE:	8/28/2024
DATE:	1/13/2025
DATE:	10/29/2025


RODGER BRALEY,
ARCHITECTS
NYS LIC. NO. 013-832
50 PLATT'S HILL ROAD
NEWTOWN, CT 06470
T: 203.426.9918
Email: rbraley2@sbeglobal.net




DESCRIPTION:

COVER


SCALE	AS NOTED
-------	----------

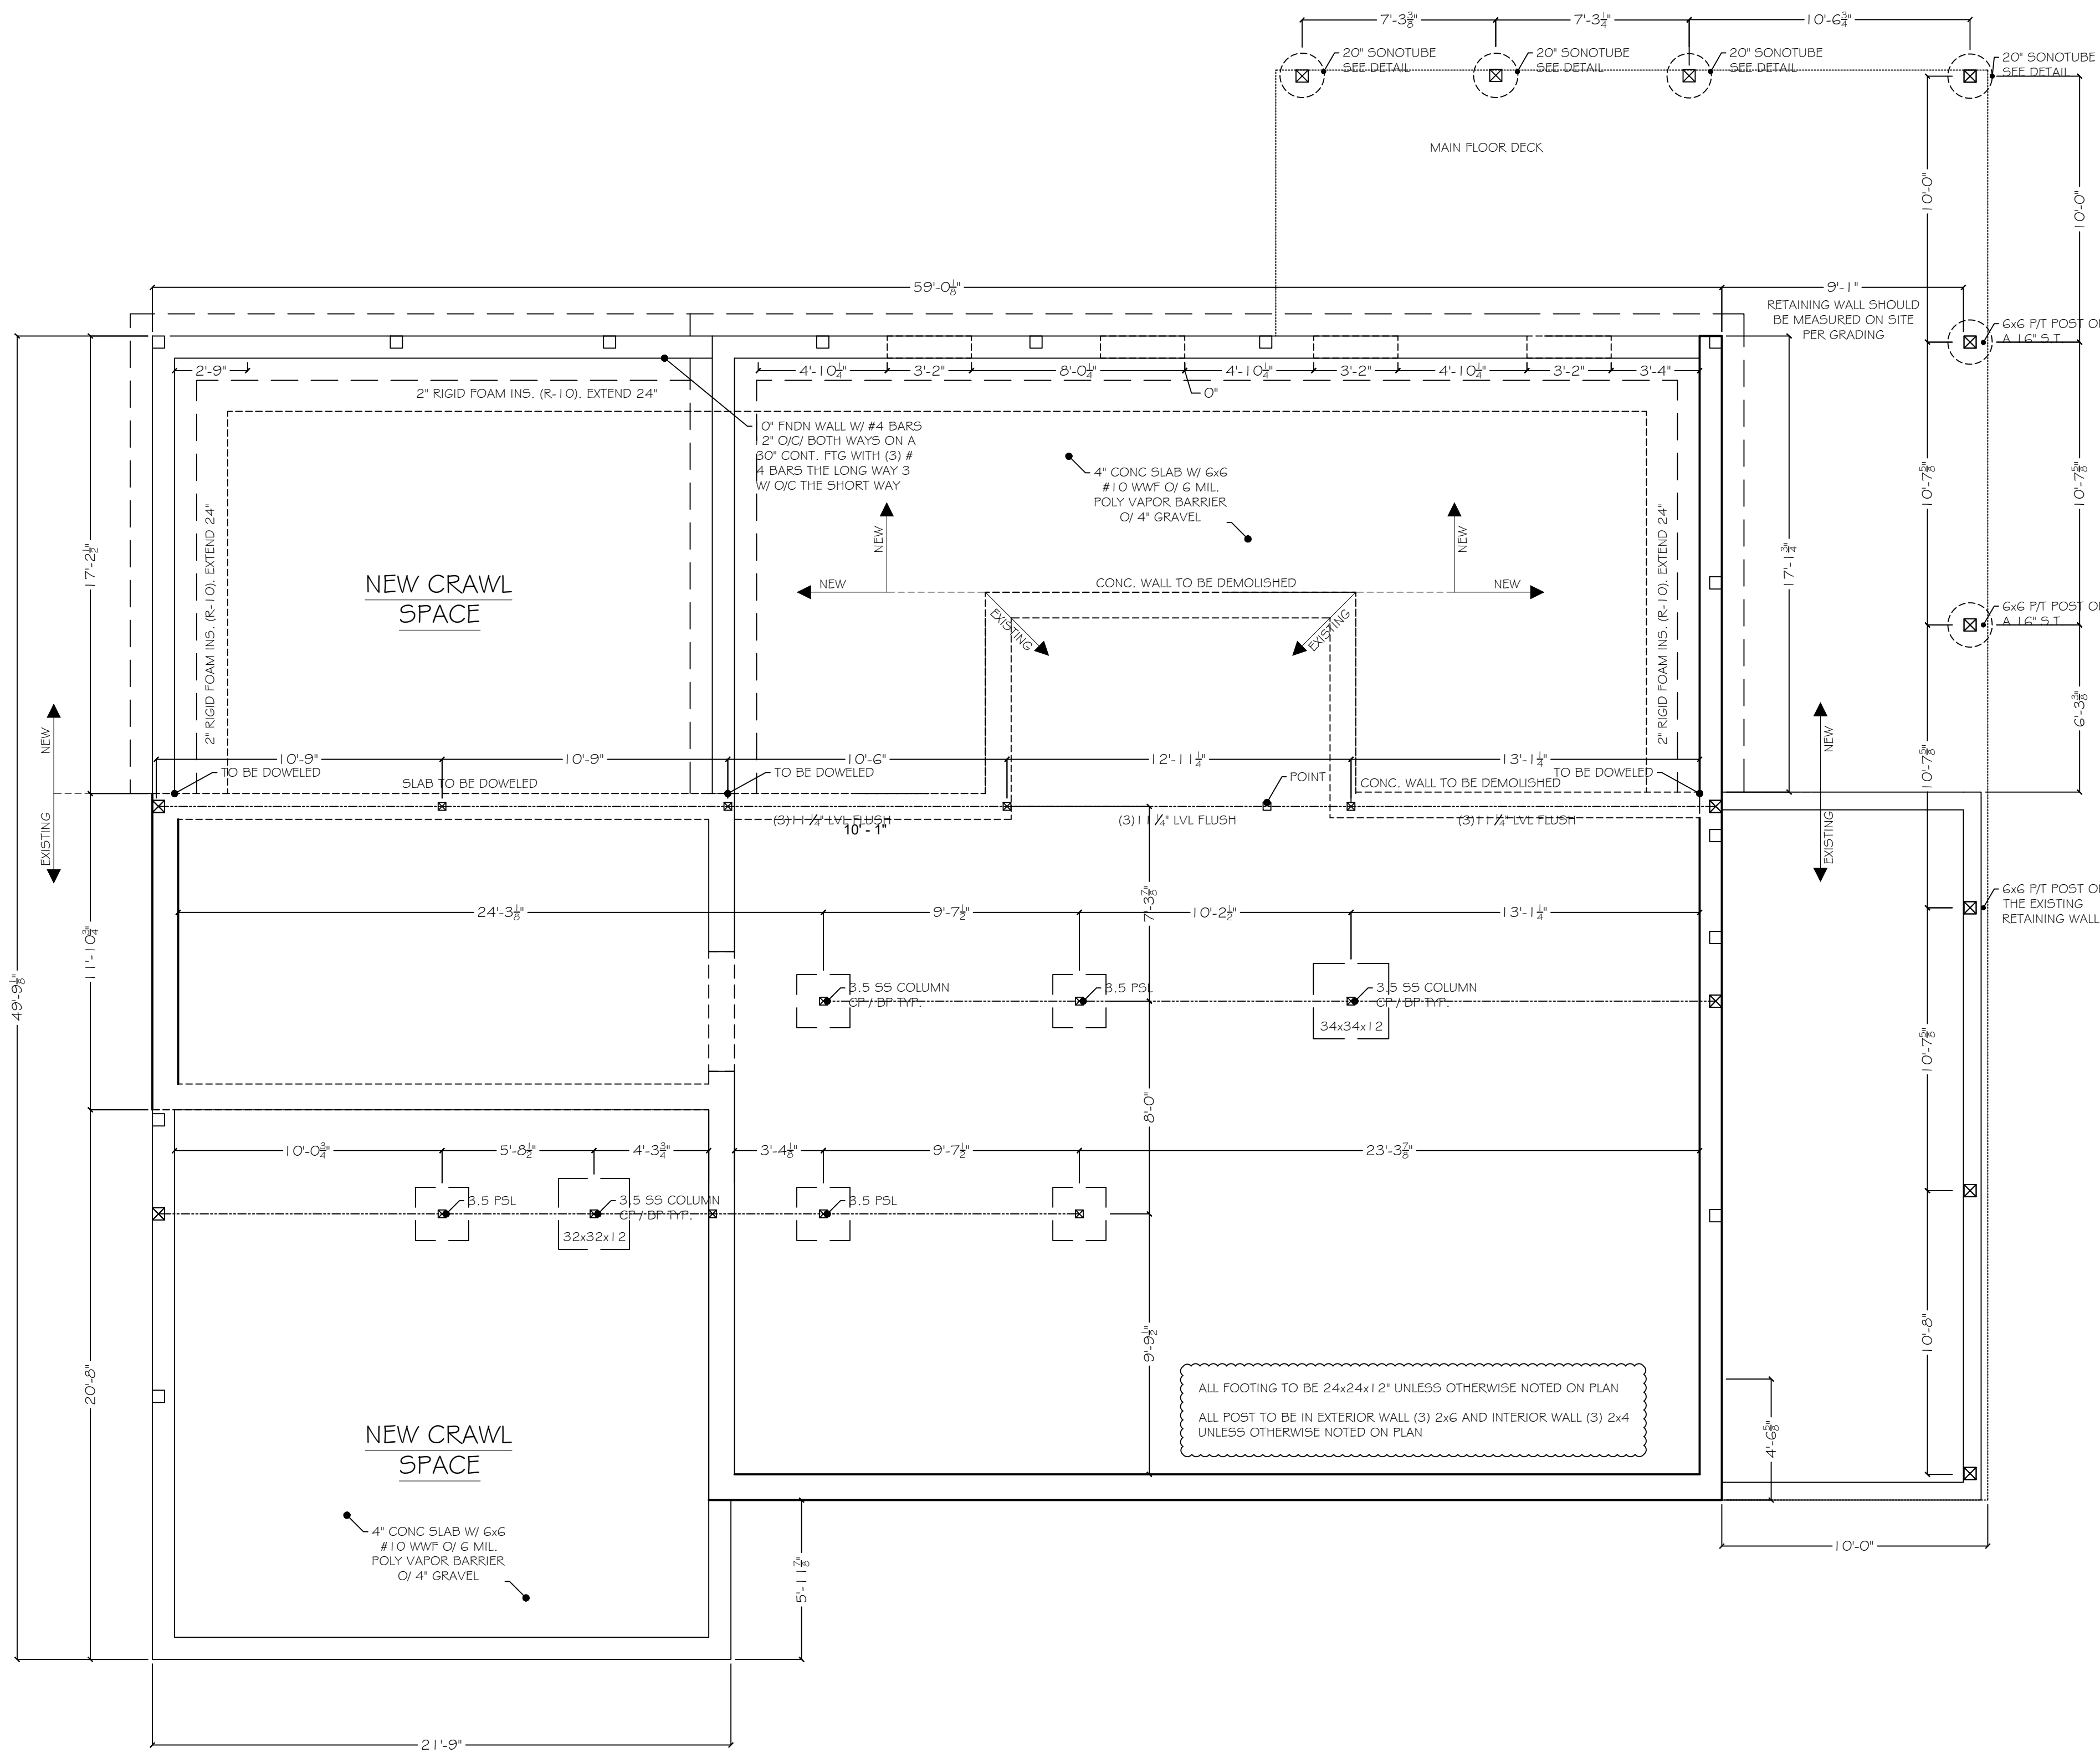


1 FOUNDATION FOOTING PLAN
SCALE: 1/4" = 1' 0"

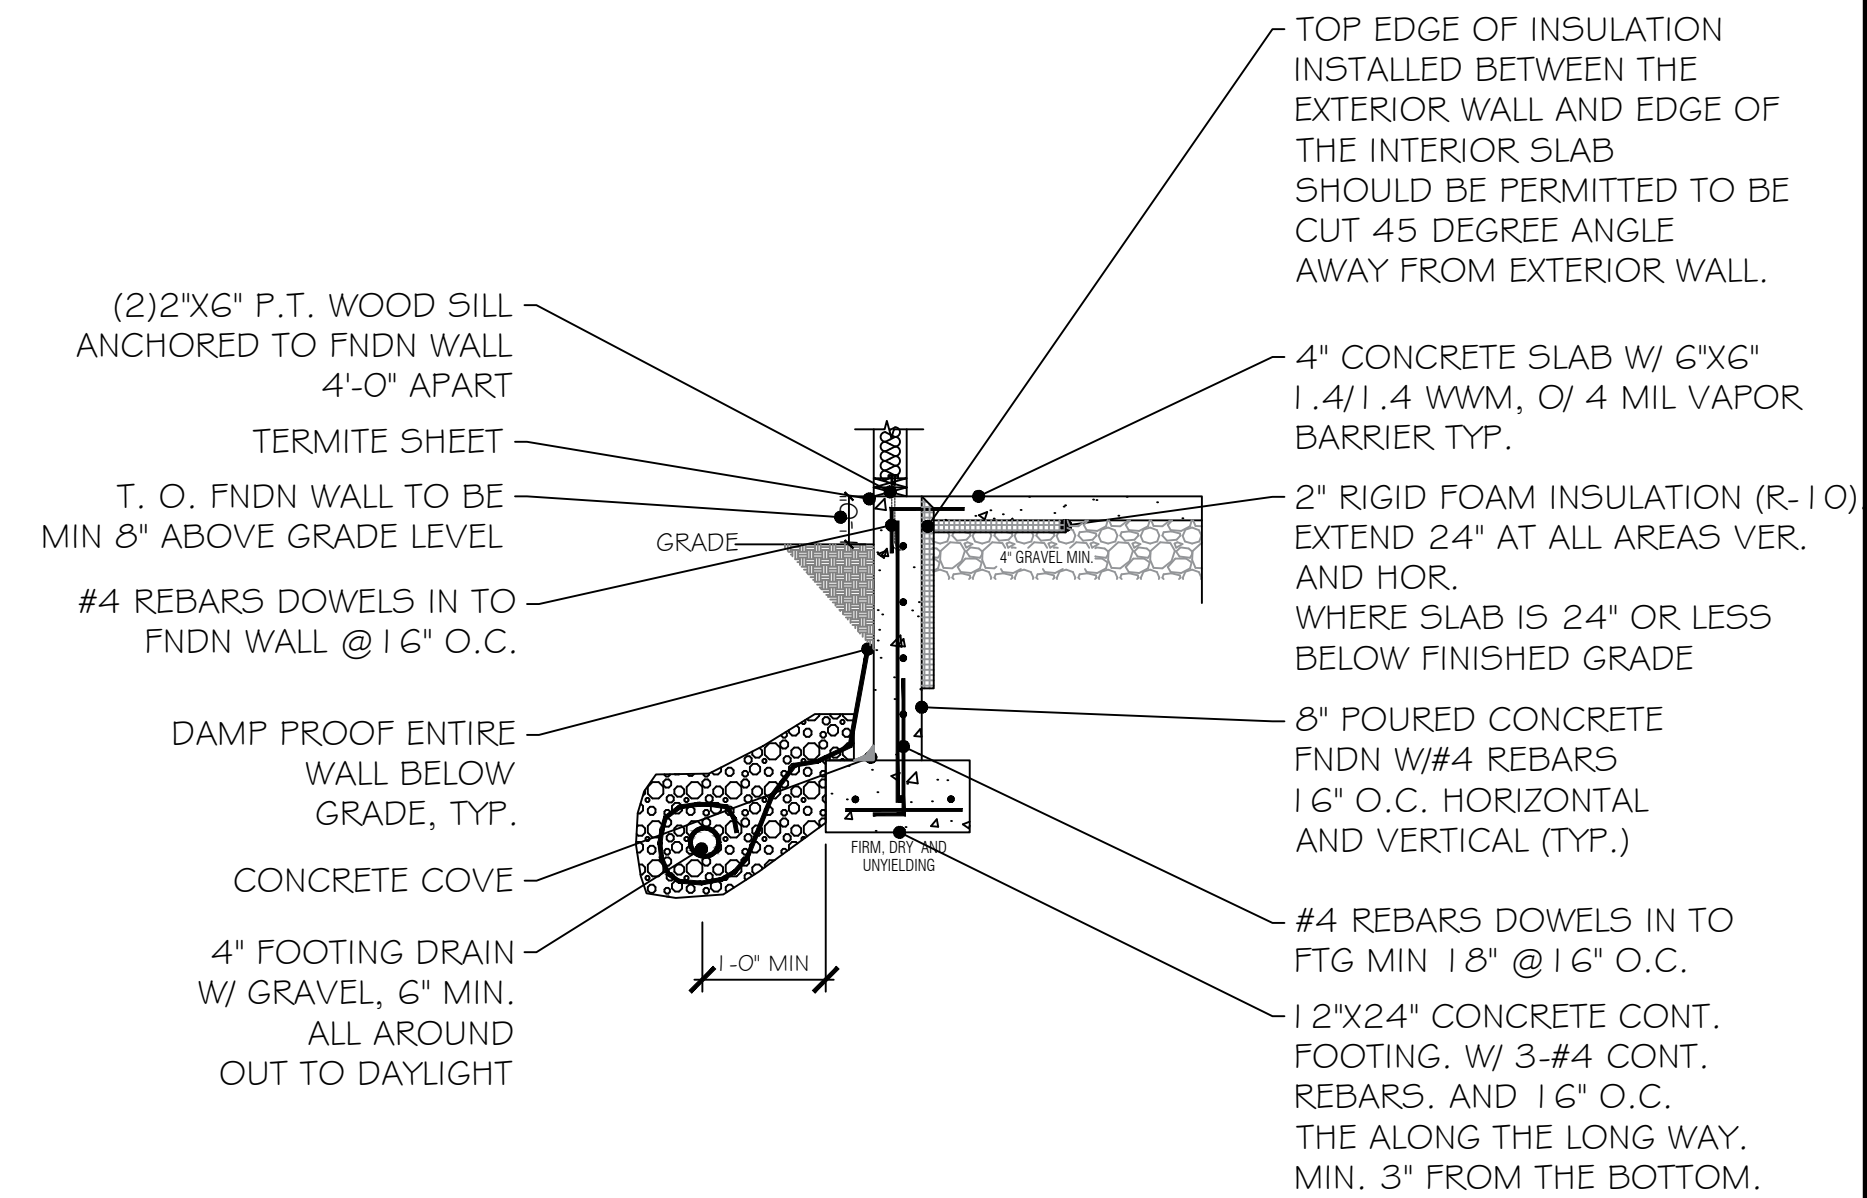


2 FOUNDATION / FOOTING DETAIL
SCALE: N.T.S.

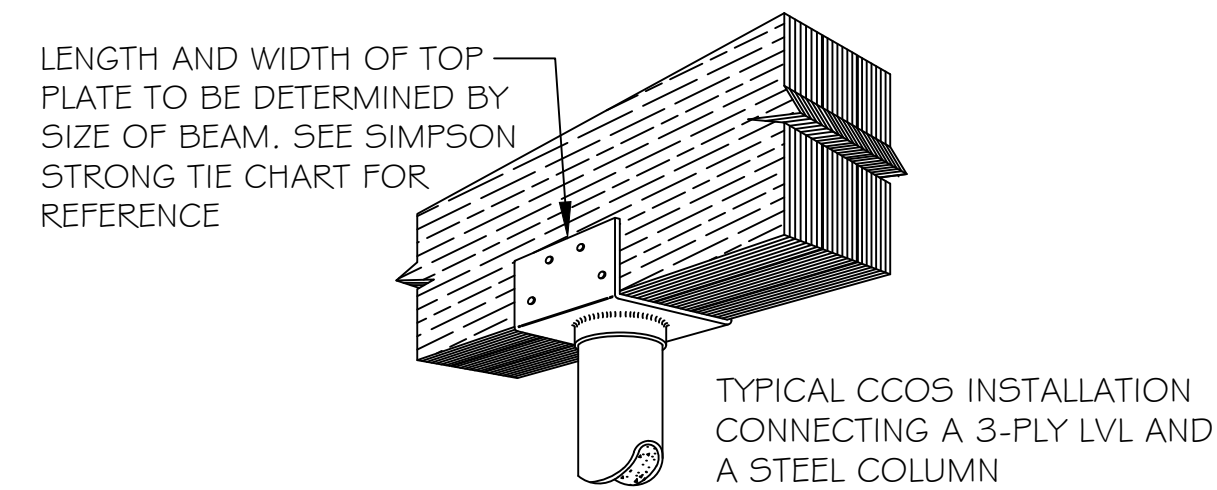

3 POST CAP DETAIL
SCALE: 1/4" = 1' 0"

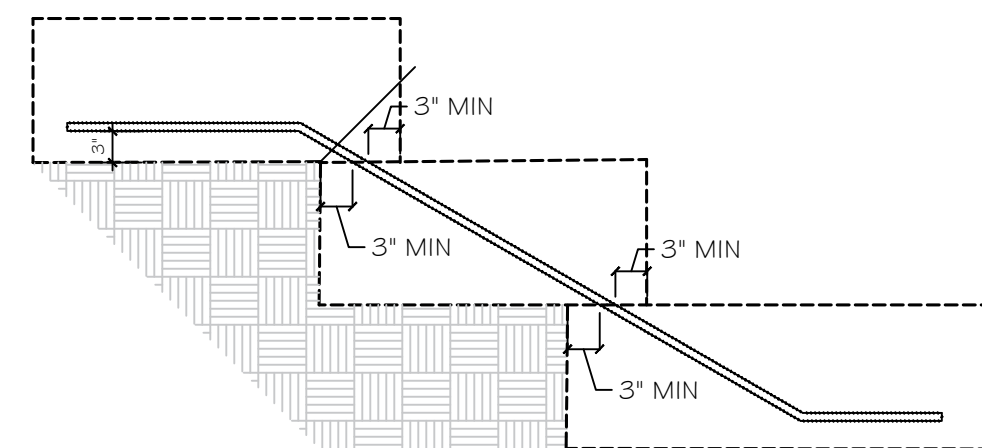

4 STEP FOOTING DETAIL
SCALE: 1/4" = 1' 0"



MONROE, N.Y. 10950
(845) 492-1783
Email: office@szdrawings.com

PROJECT:
Proposed New Addition For:
17 Sterling Forest Ln.
Montebello
Rockland County, New York

DRAWN BY: Shlome Glauber

BATE: 7/15/2024


DATE: 8/2/2024

DATE: 8/28/2024


DATE: 1/13/2025

DATE: 10/29/2025


RODGER BRALEY,
ARCHITECTS
NYS LIC. NO. 013-832
50 PLATT'S HILL ROAD
NEWTOWN, CT 06470
T: 203.426.9918
Email: rbraley2@sbcglobal.net

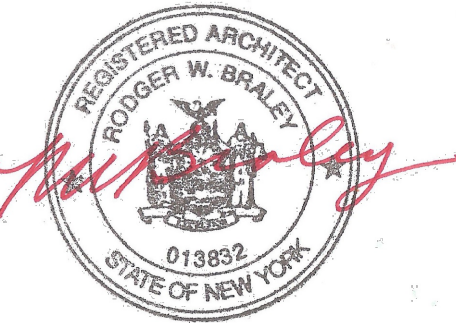

DESCRIPTION:
A-101
SCALE AS NOTED

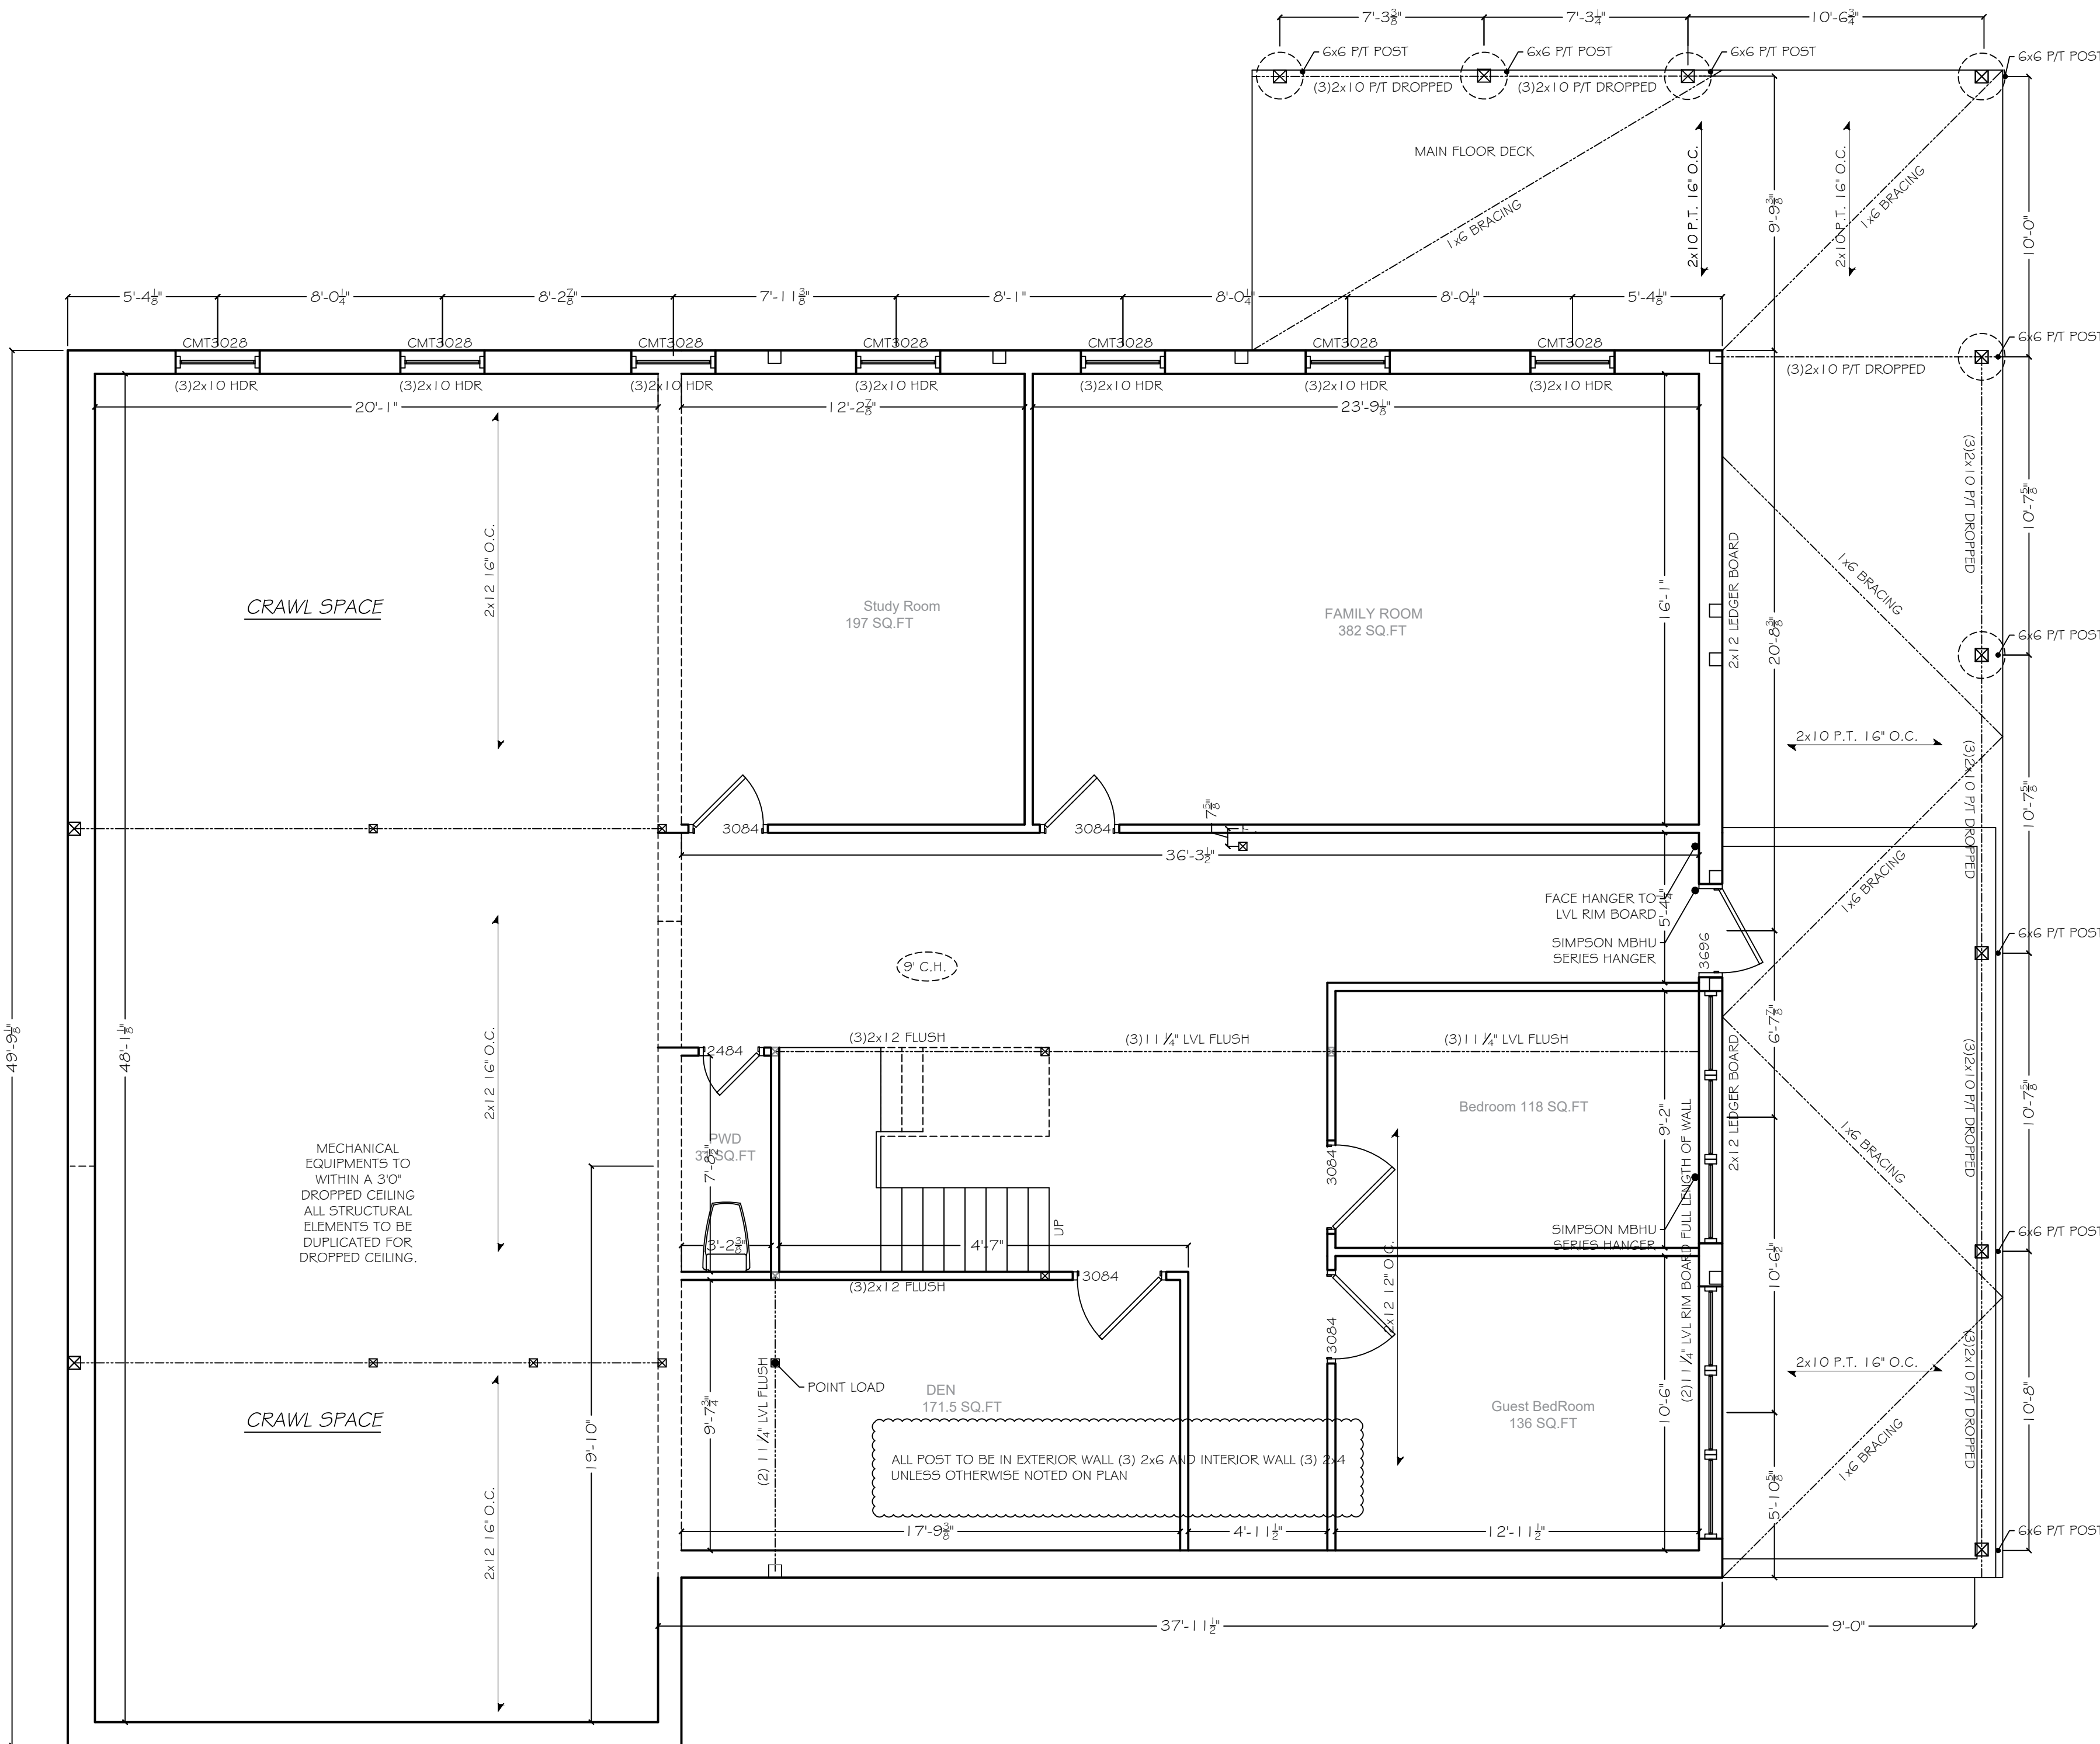


1 BASEMENT FLOOR PLAN
SCALE: 1/4" = 1' 0"

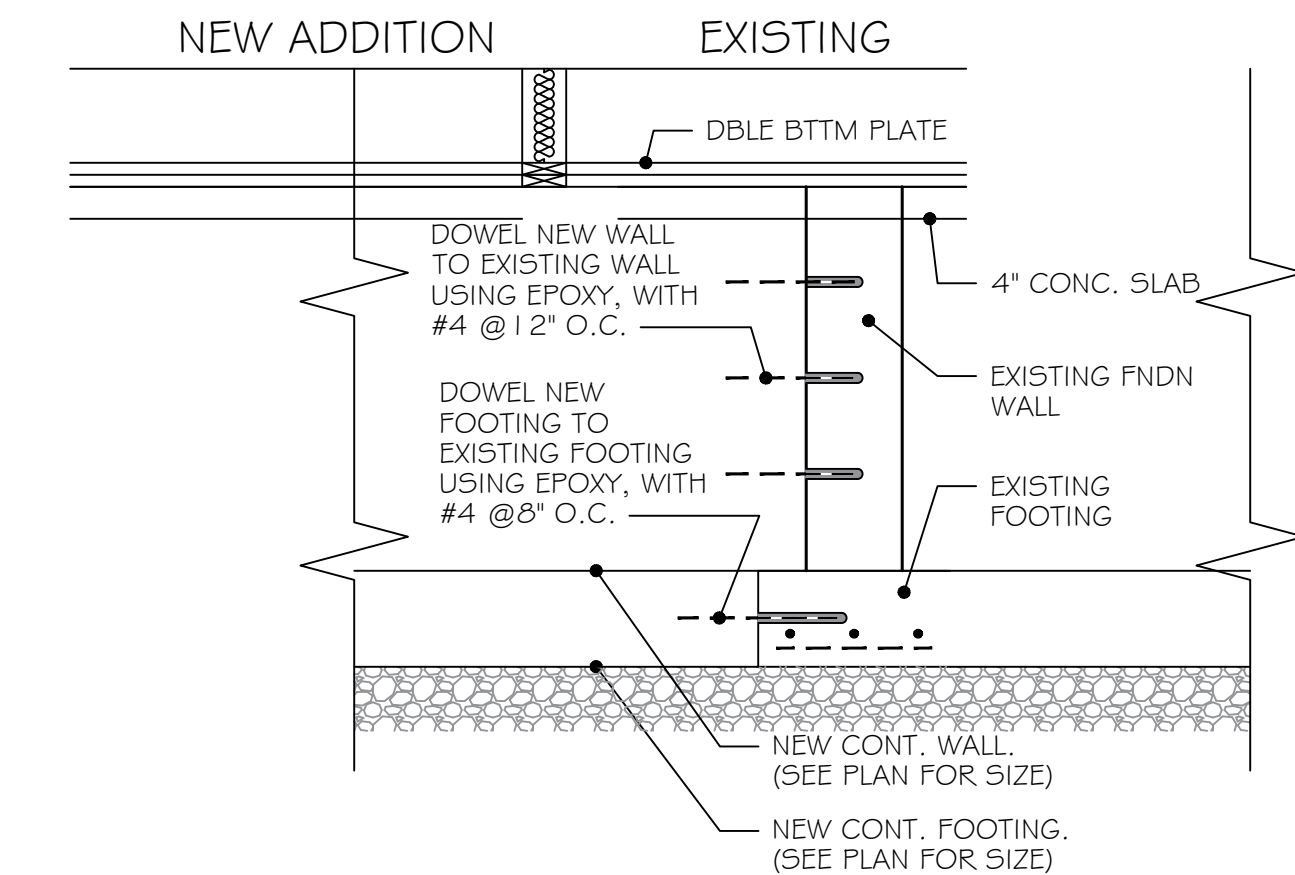

2 MASONRY DOWEL DETAIL
SCALE: 1/2" = 1' 0"


3 RETAINING WALL DETAIL
SCALE: 1/4" = 1' 0"

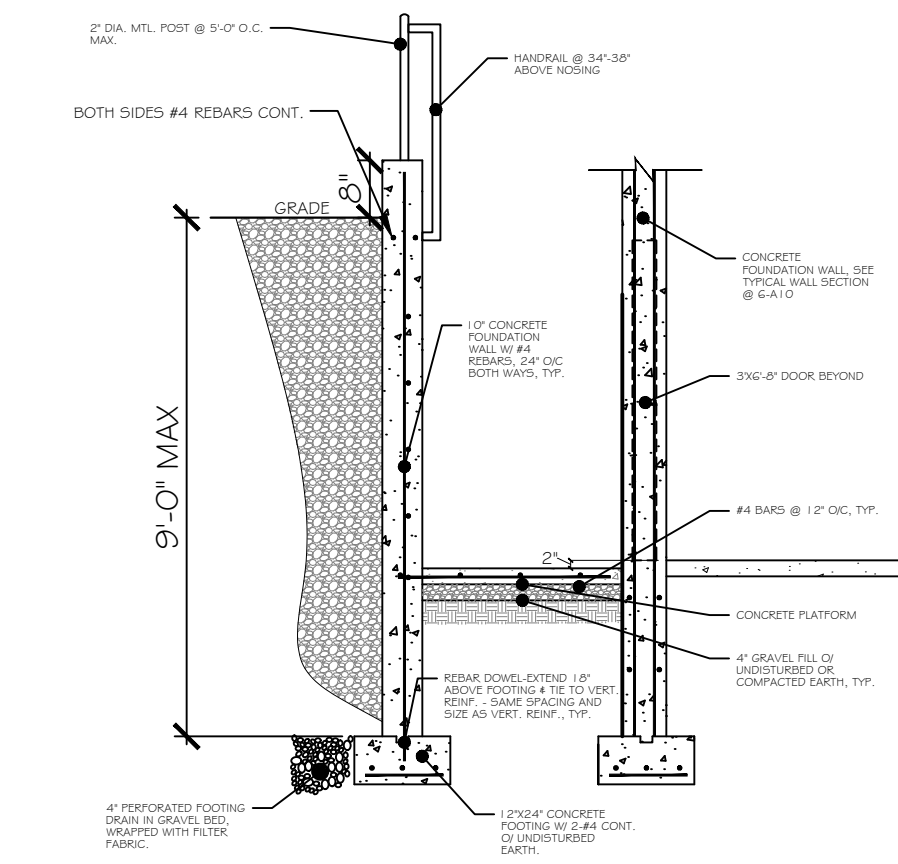


STEPS FOR BIG-FOOT

- EXCAVATE TO REQUIRED ELEVATION
- INSURE DRY AND UNYIELDING
- STOLE REBAR #4 BOTH WAY'S N S E W
- INSTALL VER. REBAR
- PUT THE BIGFOOT INSTALL THE SONO TUBE
- BRACE TO MAINTAIN LVL AND PLUM
- CAREFULLY BACKFILL BIGFOOT SYSTEM
- POOR CONCRETE INTO SONO TUBE AND BIG-FOOT

4 BIGFOOT DETAIL
SCALE: 1/2" = 1' 0"

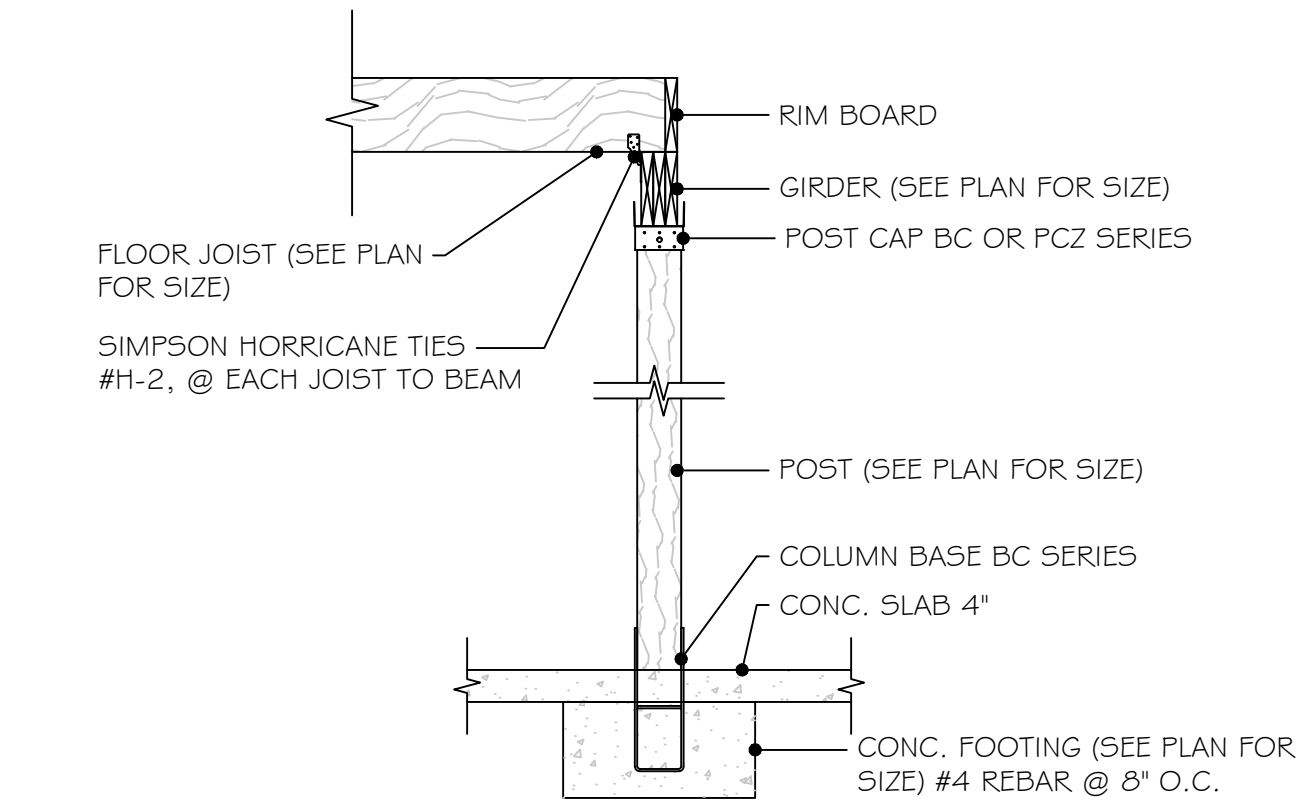

5 INTERIOR CONCRETE PIER
SCALE: 1/2" = 1' 0"

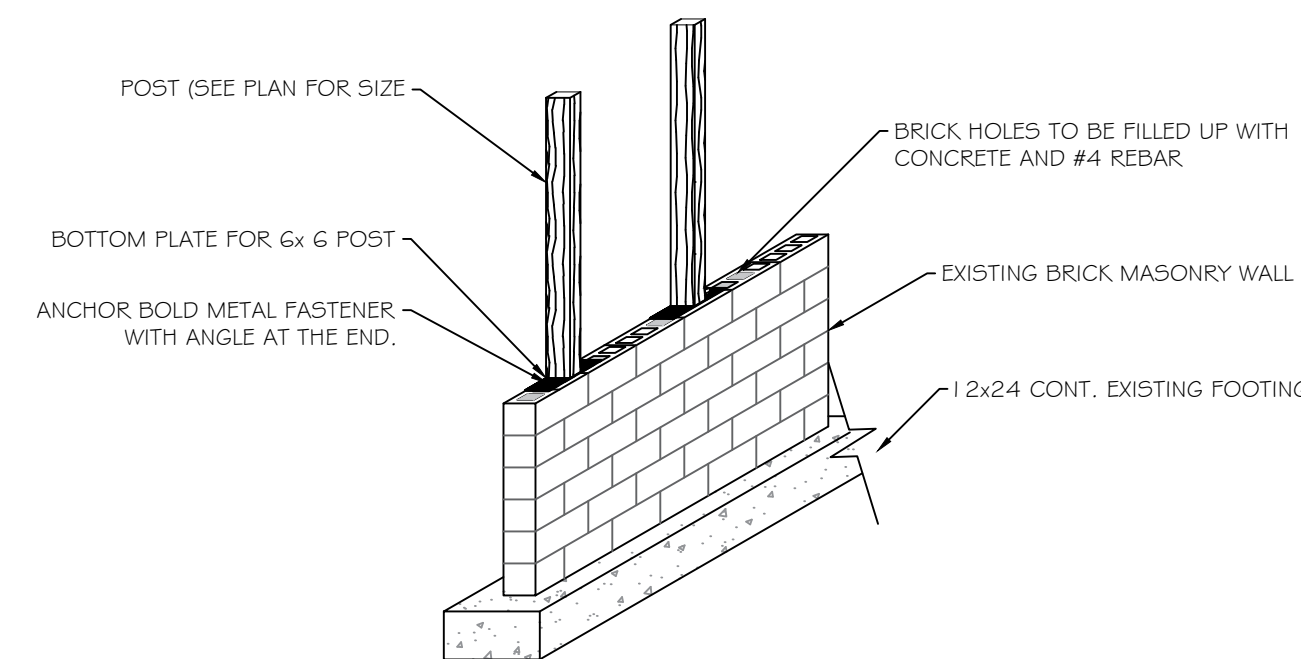


6 BIGFOOT DETAIL
SCALE: 1/2" = 1' 0"

PROJECT:

Proposed New Addition For:
17 Sterling Forest Ln.
Montebello
Rockland County, New York

DRAWN BY:	Shlome Glauber
DATE:	7/15/2024
DATE:	8/2/2024
DATE:	8/28/2024
DATE:	1/13/2025
DATE:	10/29/2025


RODGER BRALEY,
ARCHITECTS
NYS LIC. NO. 013-832
50 PLATT'S HILL ROAD
NEWTOWN, CT 06470
T: 203.426.9918
Email: rbraley2@sbcglobal.net

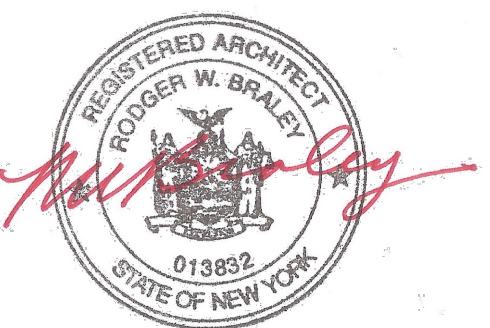

DESCRIPTION:


A-102

SCALE AS NOTED

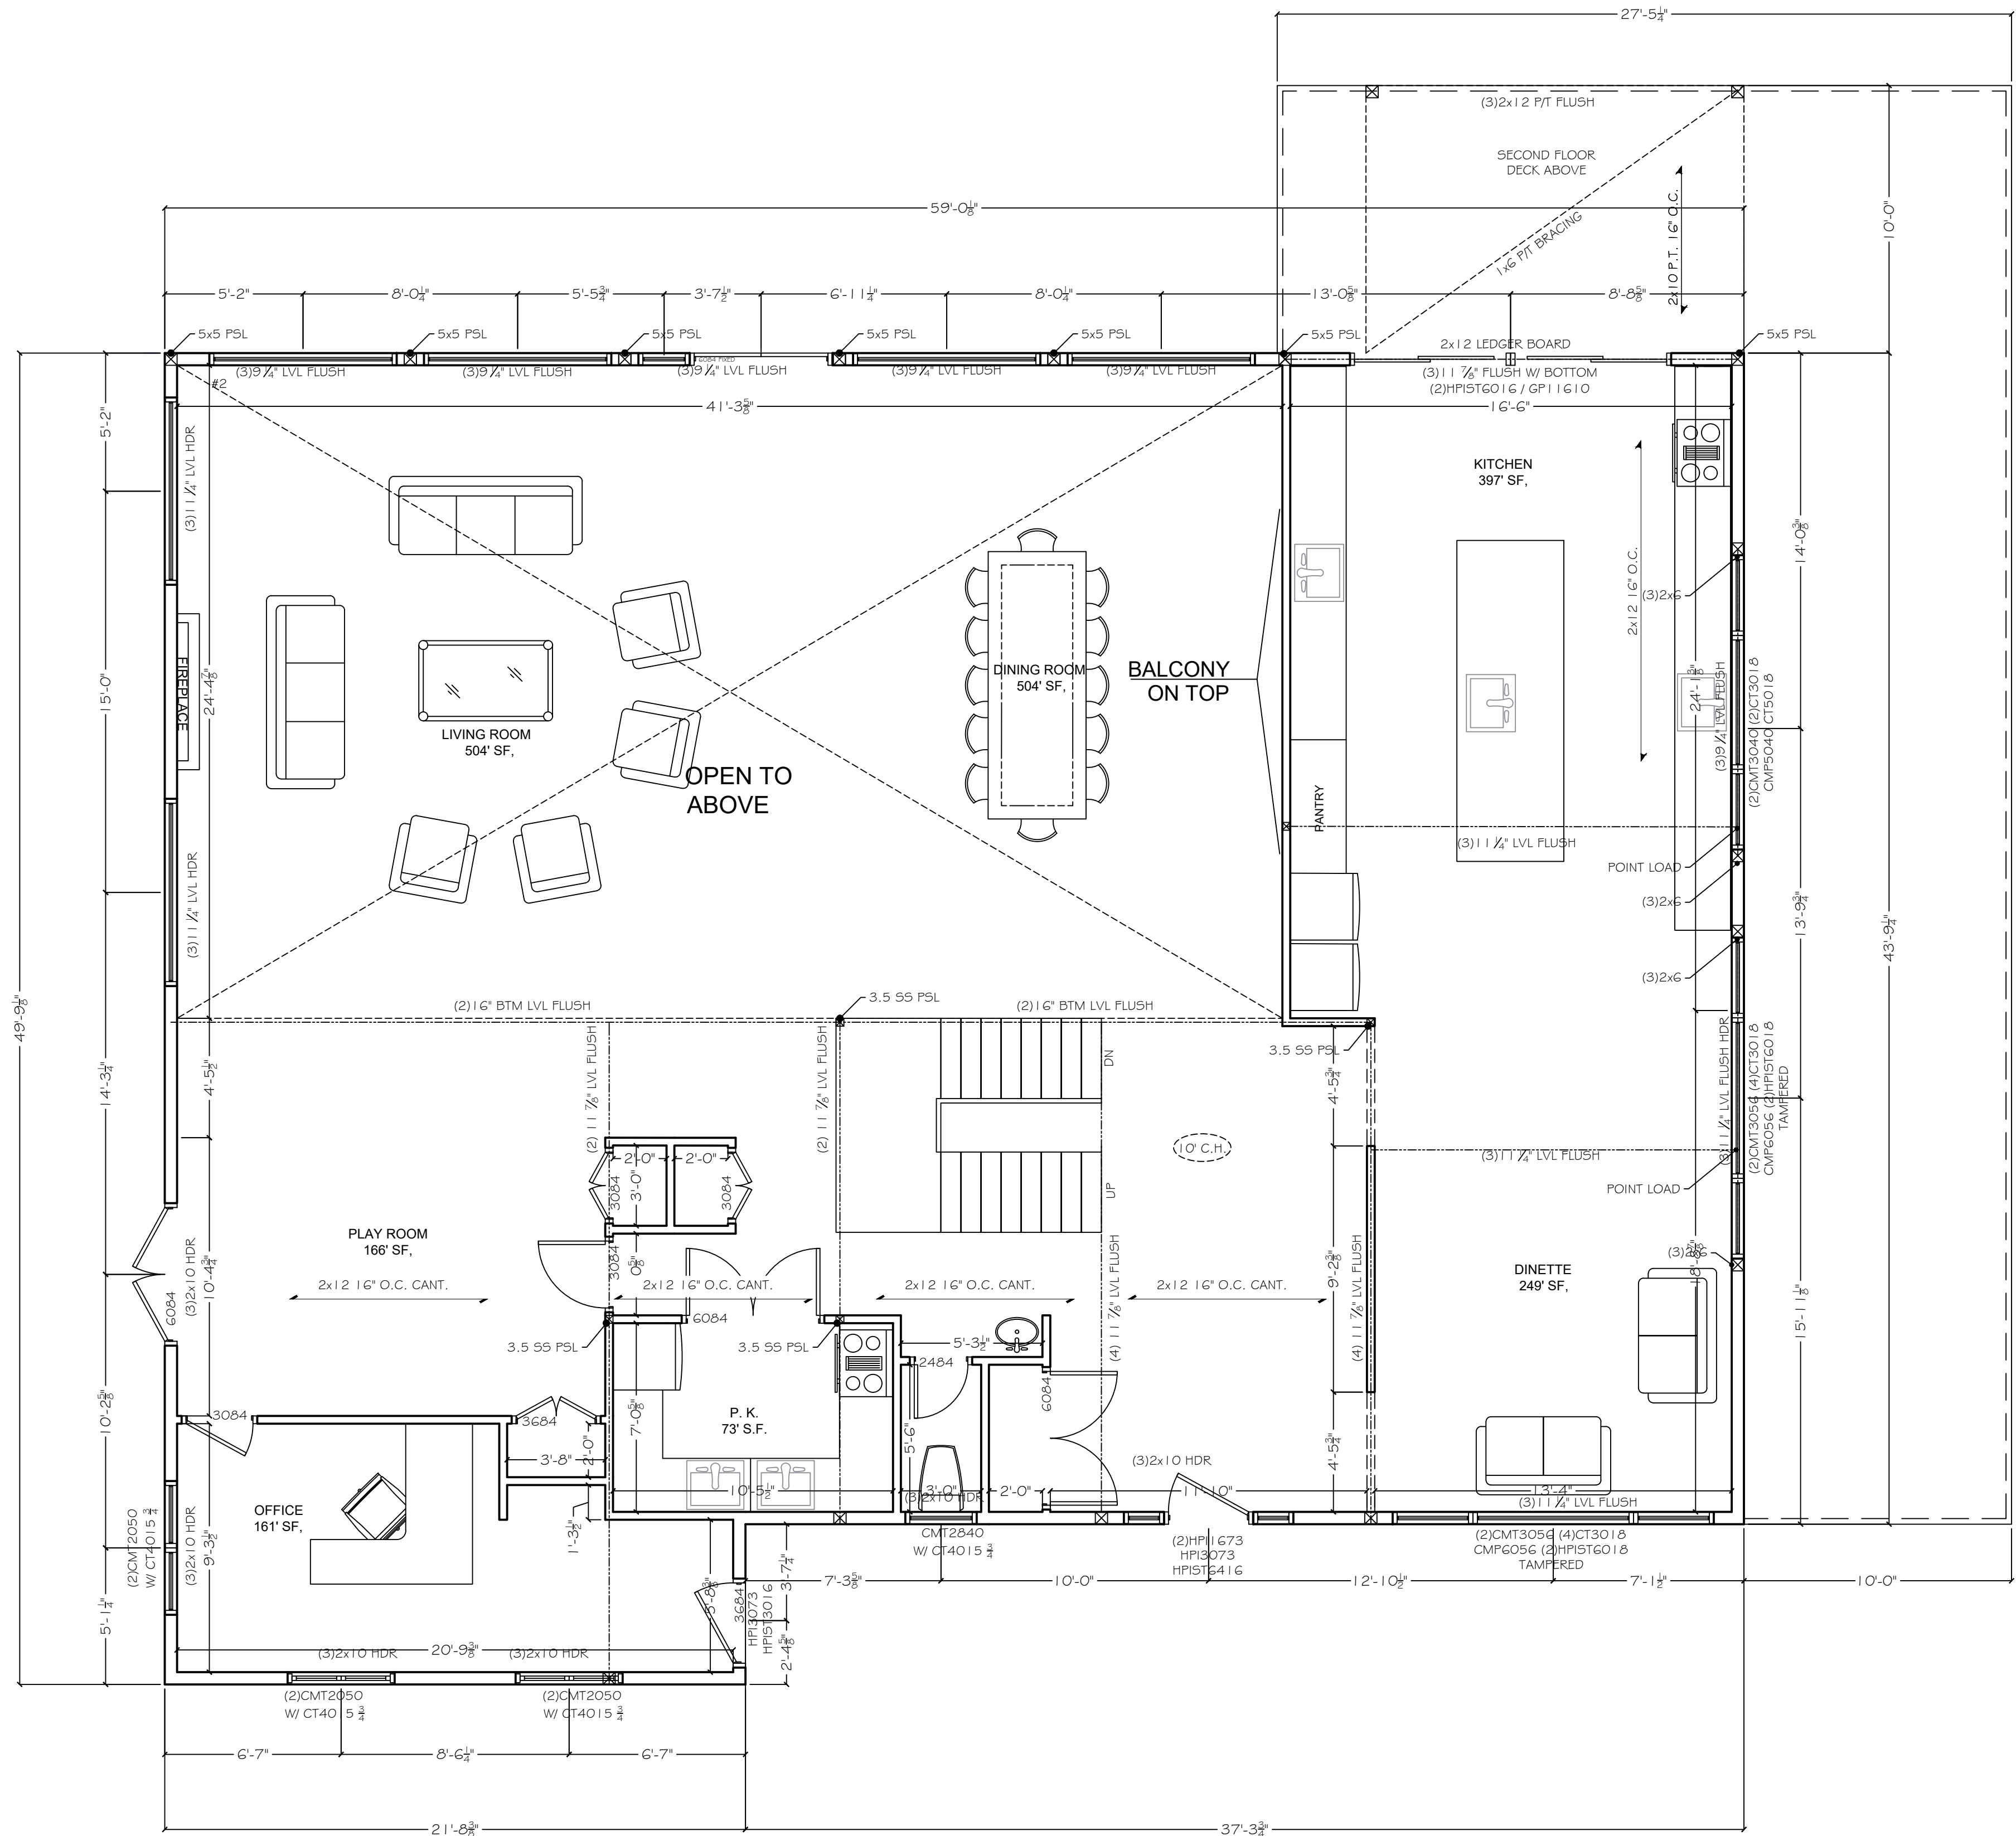


1 FIRST FLOOR FRAMING PLAN
SCALE: 1/4" = 1' 0"



2 ANGLE IRON SHELF
SCALE: 1/4" = 1' 0"

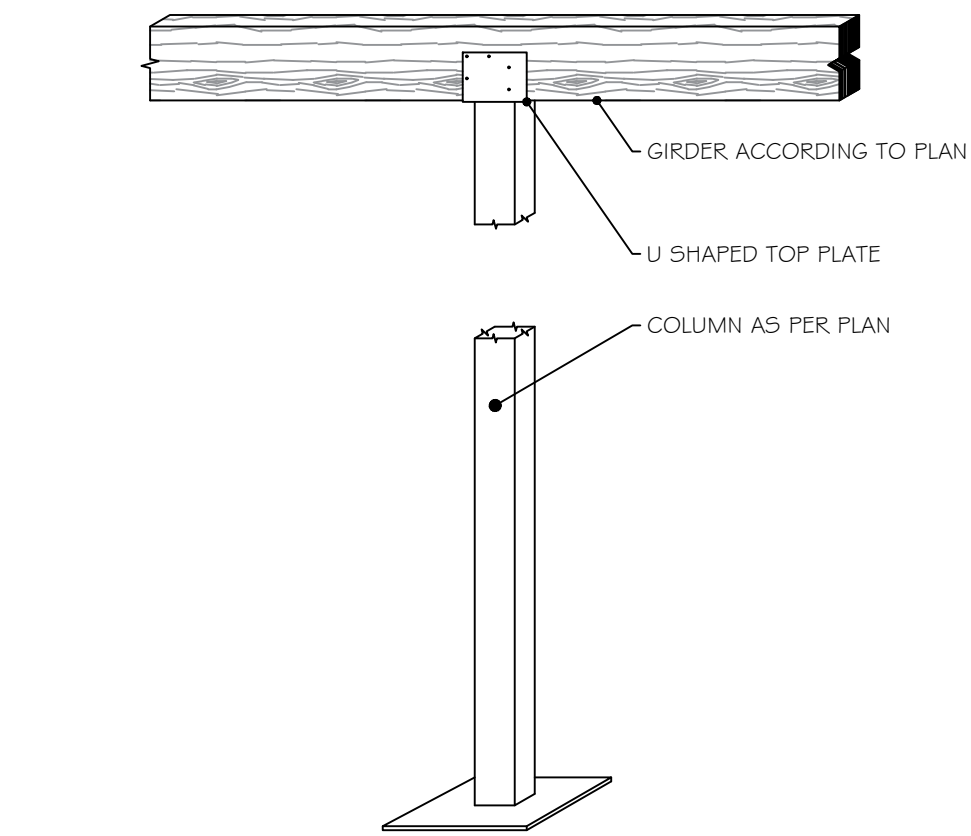

3 LEDGER BOARD TO CONCRETE
SCALE: 1/4" = 1' 0"

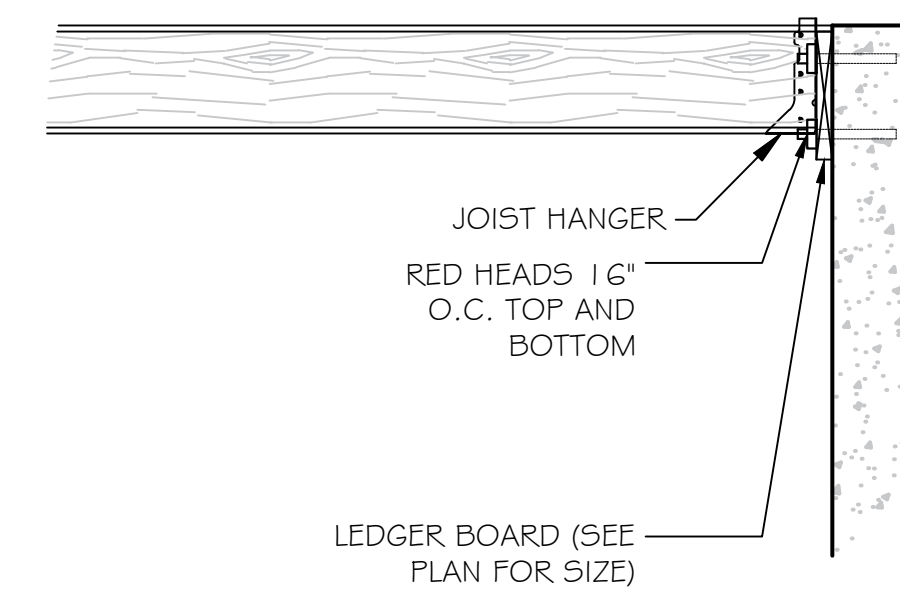

4 STAIR WELL ELEVATION
SCALE: 1/4" = 1' 0"

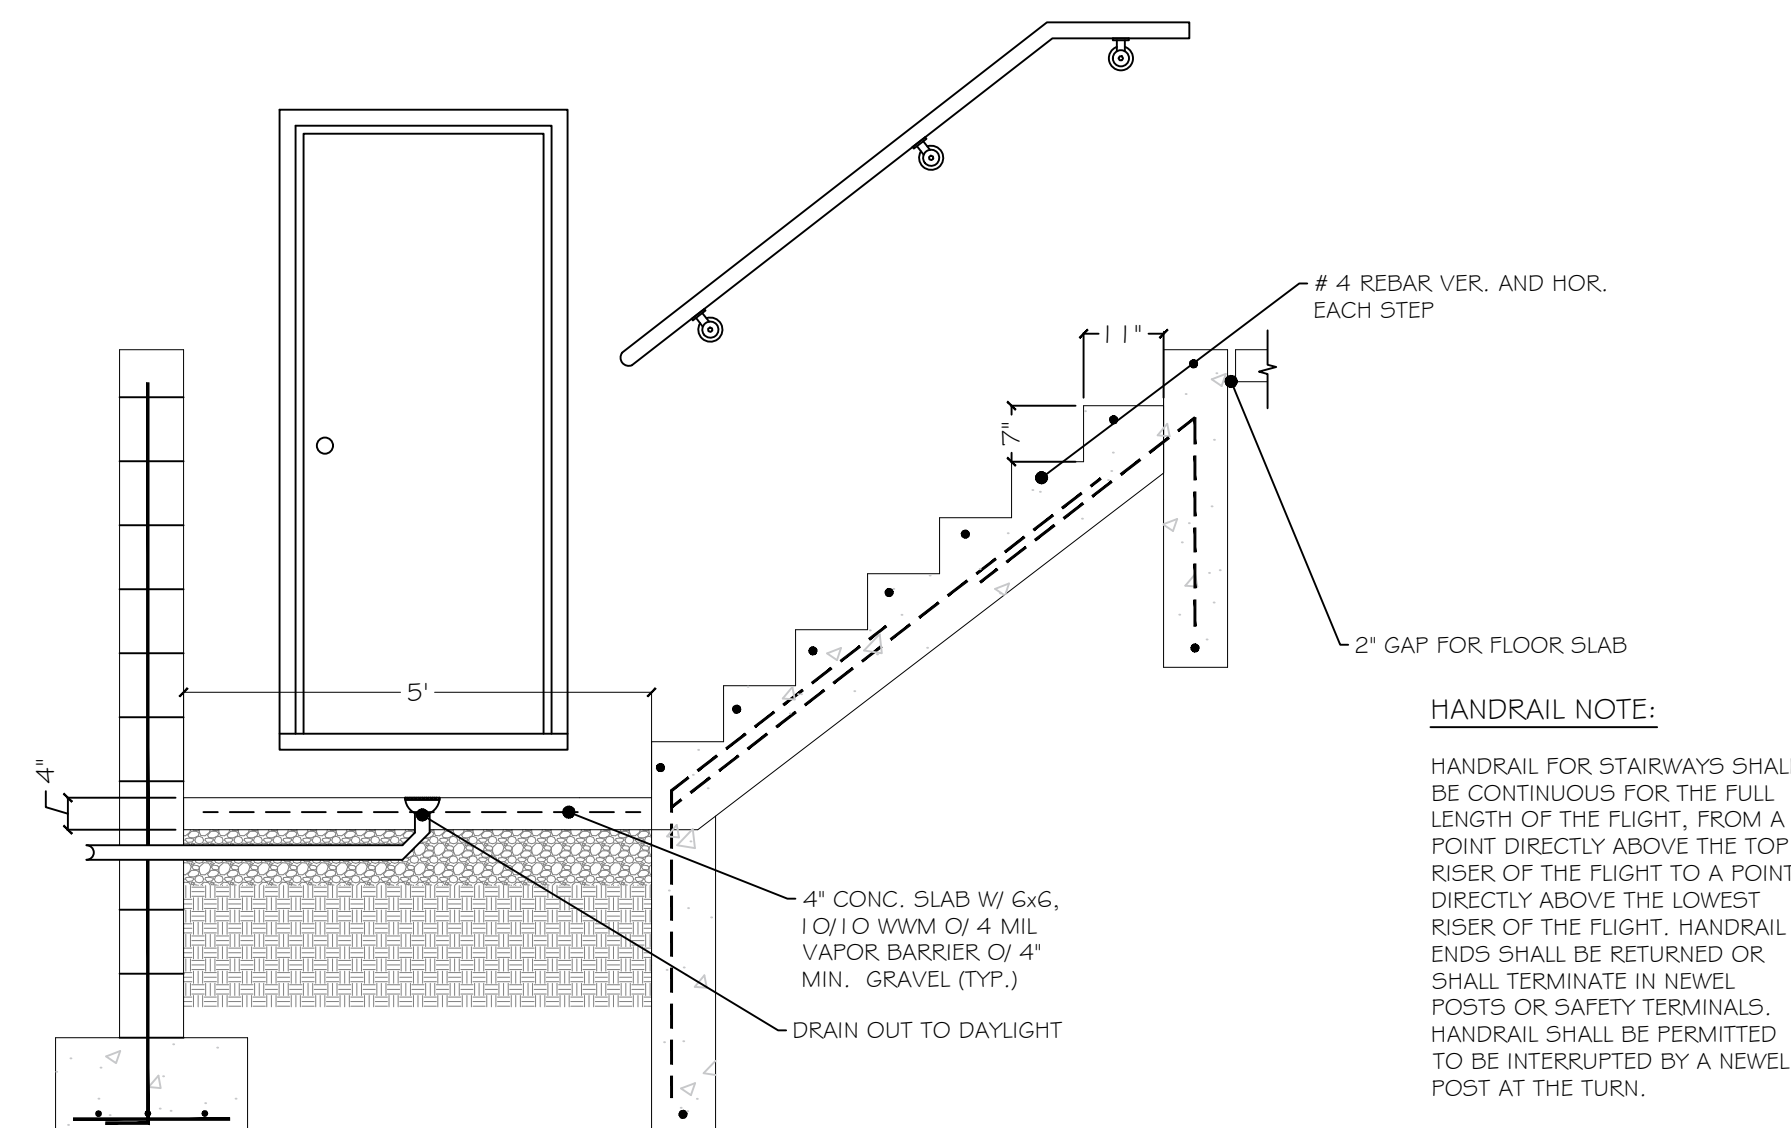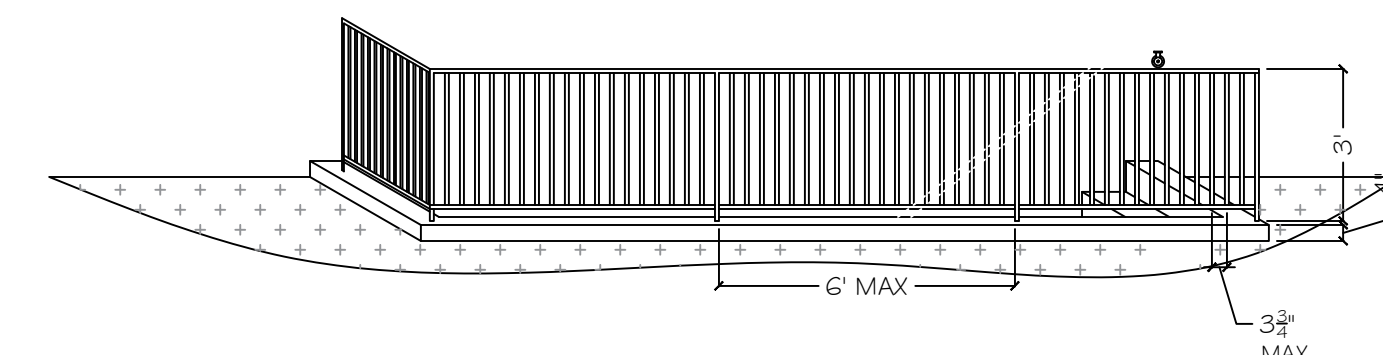


5 CONC. STAIR DETAIL SIDE VIEW
SCALE: 1/4" = 1' 0"

PROJECT:

Proposed New Addition For:
17 Sterling Forest Ln.
Montebello
Rockland County, New York

DRAWN BY:	Shlome Glauber
DATE:	7/15/2024
DATE:	8/2/2024
DATE:	8/28/2024
DATE:	1/13/2025
DATE:	10/29/2025


RODGER BRALEY,
ARCHITECTS
NYS LIC. NO. 013-832
50 PLATT'S HILL ROAD
NEWTOWN, CT 06470
T: 203.426.9918
Email: rbraley2@sbcglobal.net

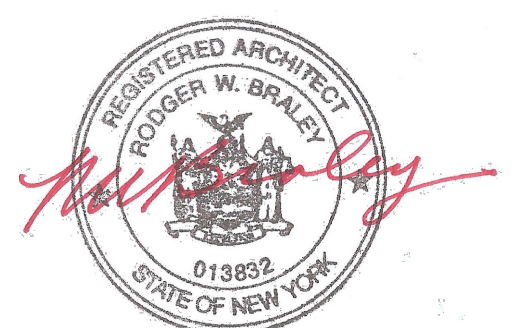


DESCRIPTION:

A-103

SCALE AS NOTED

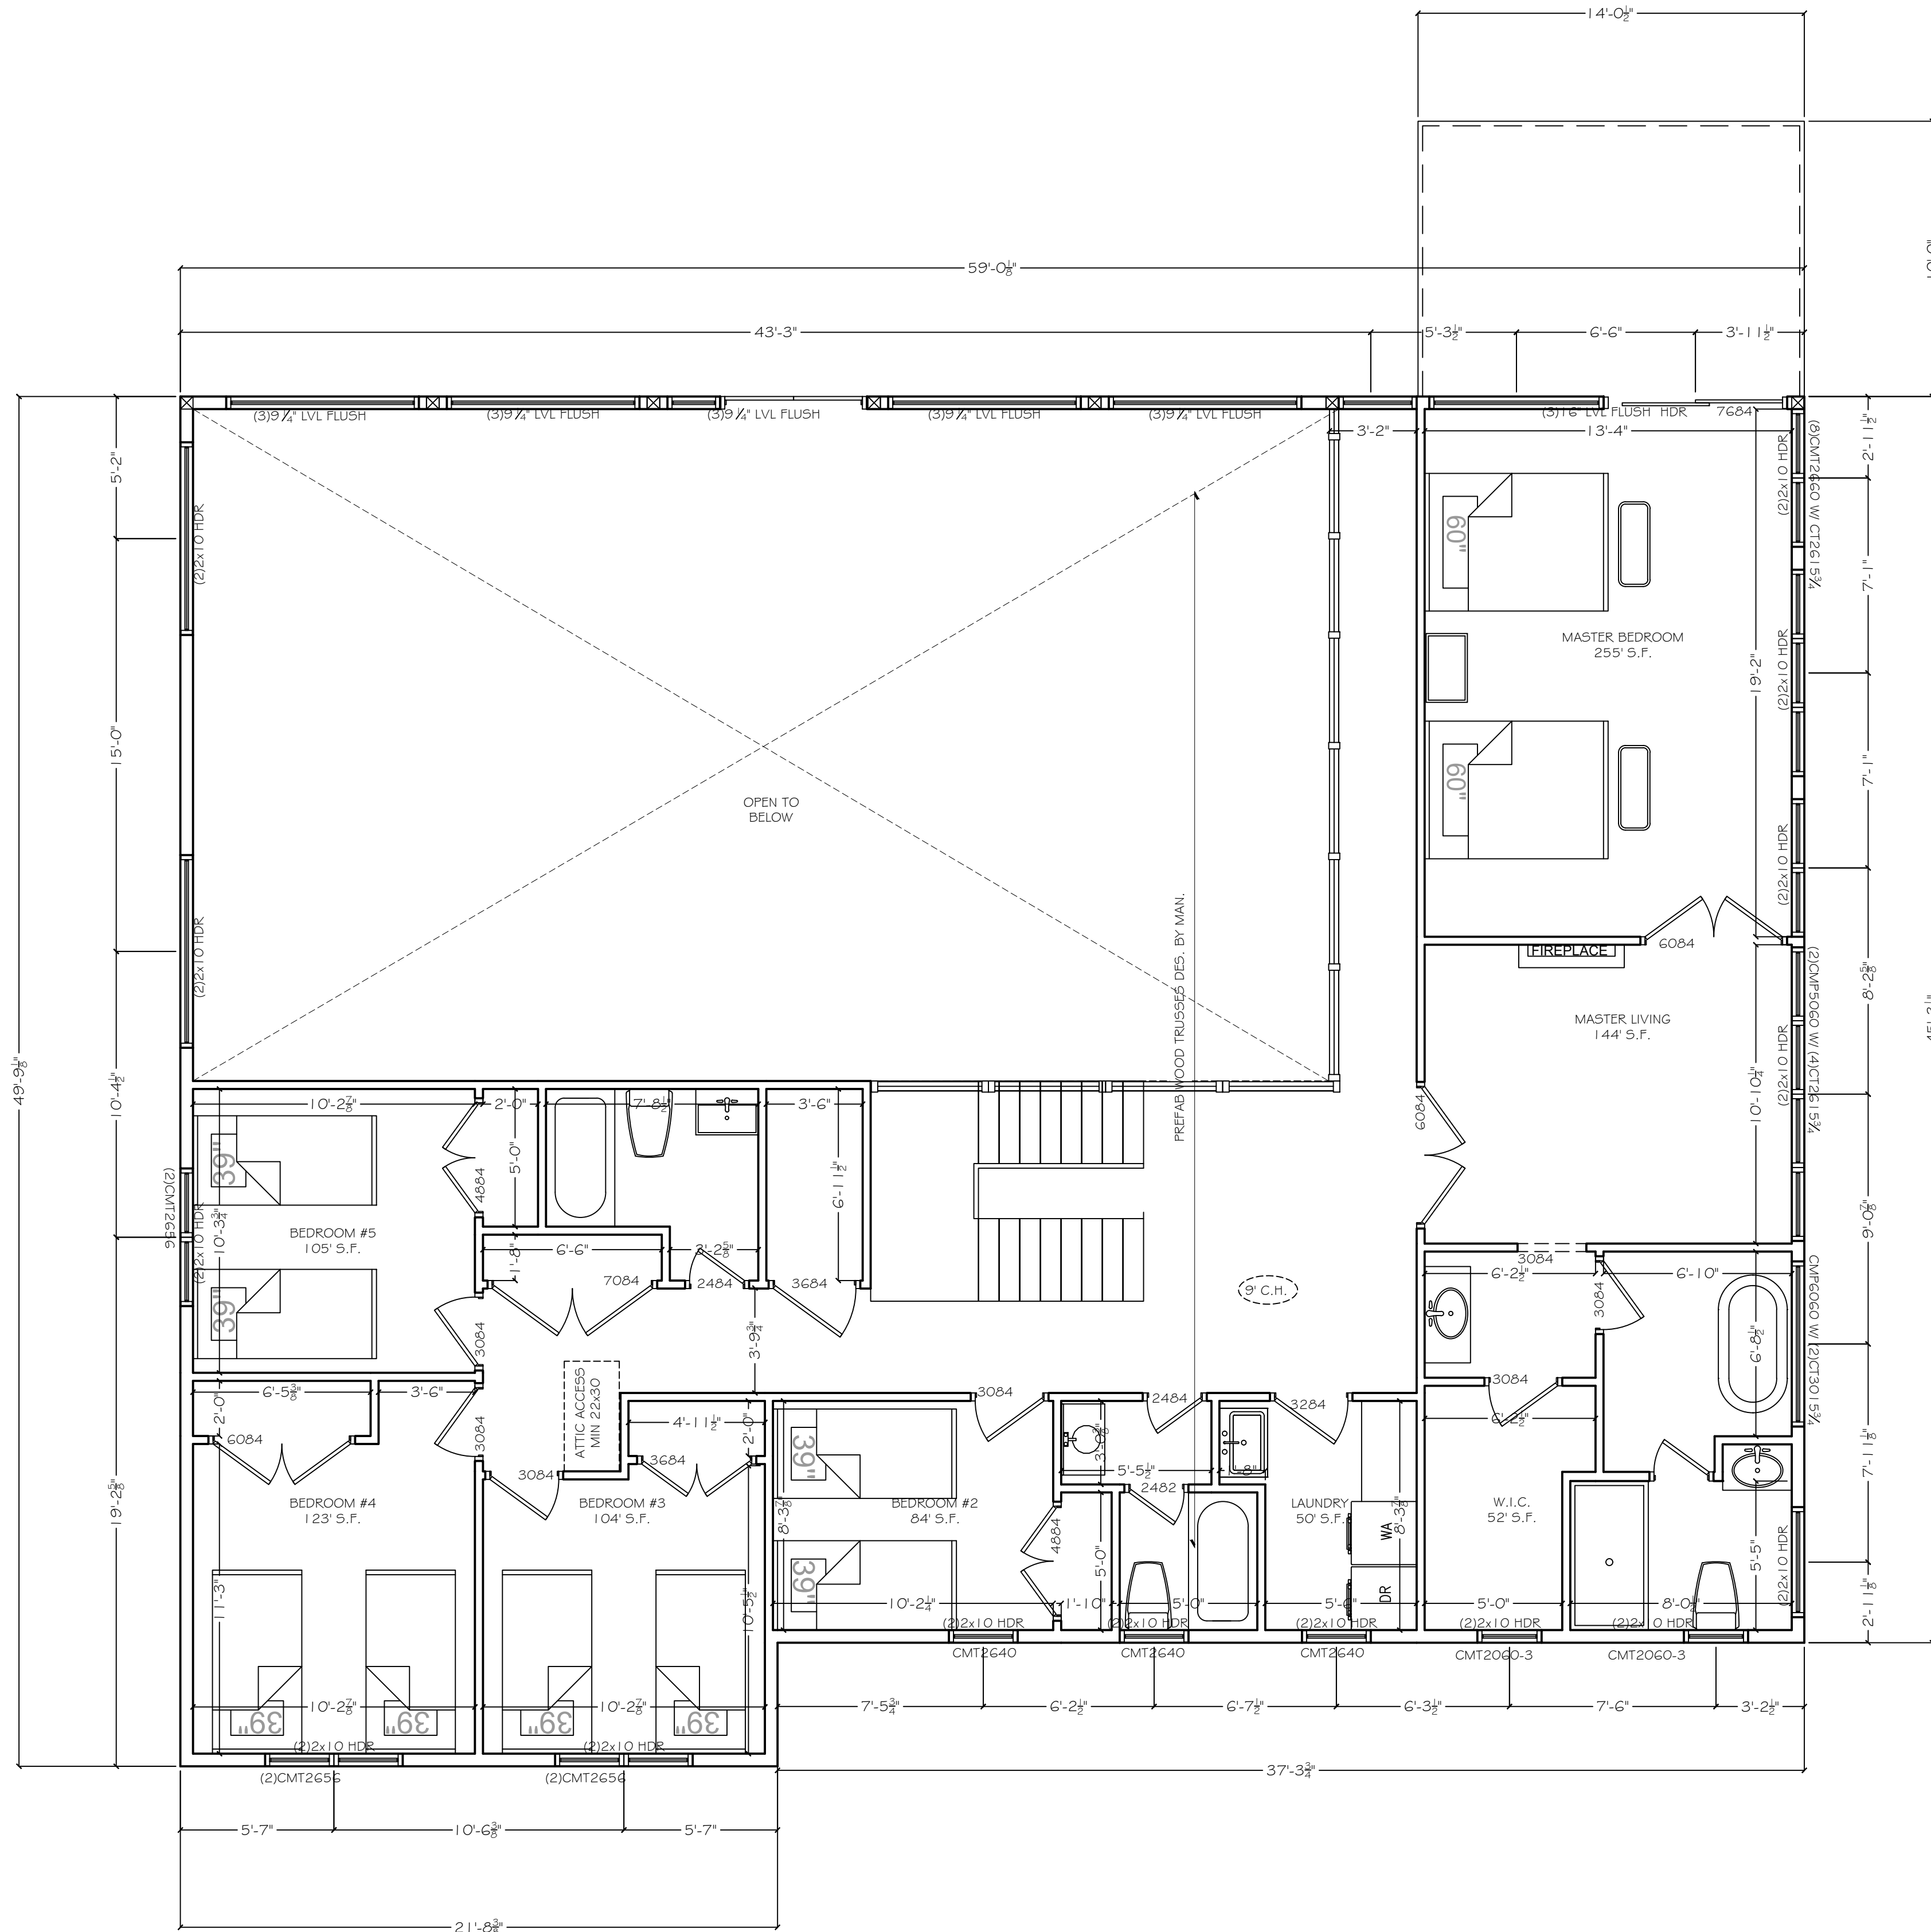

1 OPENINGS FRAMING DETAILS
SCALE: 1/4" = 1' 0"

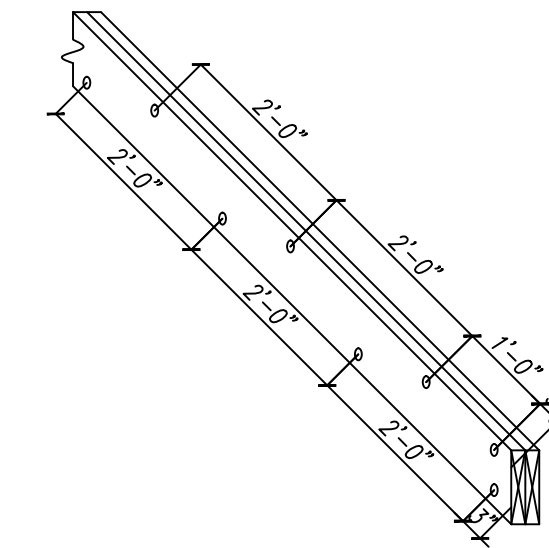


NOTES

L.V.L.'S ARE TO BE BOLTED TOGETHER @ EVERY 2'-0"

BOLTS ARE TO BE STAGGERED FROM BOTTOM TO TOP AT MIN. OF 1" OFF BOTH TOP & BOTTOM EDGE OF GIRDER ASSEMBLY. PROVIDE A BOLT AT TOP & BOTTOM OF EACH END OF ASSEMBLY.

1 LVL BOLT DETAIL
SCALE: 1/4" = 1' 0"

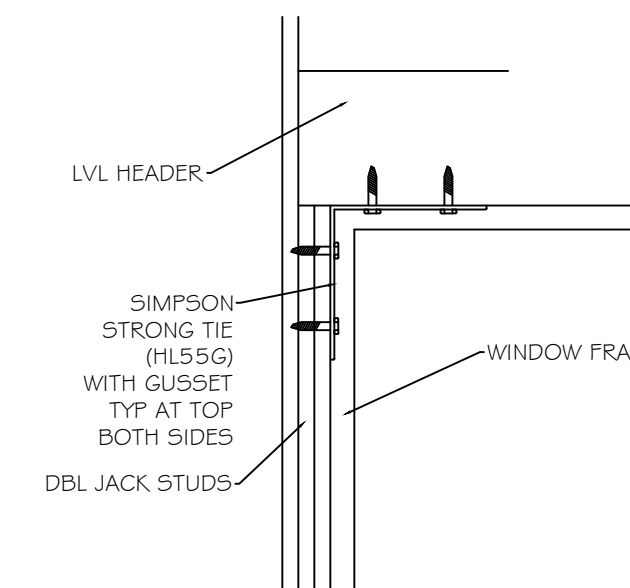

WINDOW FRAME

SIMPSON-STRONG TIE (HLS55G) WITH GUSSET TYP AT TOP BOTH SIDES


DBL JACK STUDS

DOUBLE SILL PLATE

3 WINDOW TOP AND BOTTOM DETAIL
SCALE: 1/4" = 1' 0"

DRAWN BY:	Shlome Glauber
DATE:	7/15/2024
DATE:	8/2/2024
DATE:	8/28/2024
DATE:	1/13/2025
DATE:	10/29/2025

RODGER BRALEY,
ARCHITECTS
NYS LIC. NO. 013-832
50 PLATT'S HILL ROAD
NEWTOWN, CT 06470
T: 203.426.9918
Email: rbraley2@sbcglobal.net

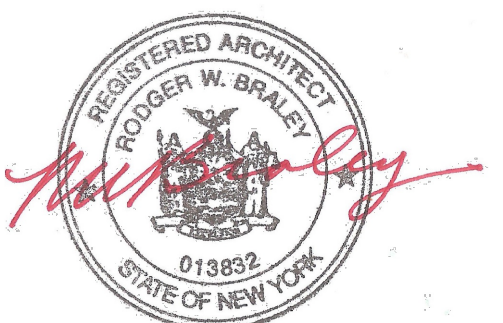




1 FRONT SIDE ELEVATION
SCALE: 3/16" = 1' 0"



2 RIGHT SIDE ELEVATION
SCALE: 3/16" = 1' 0"

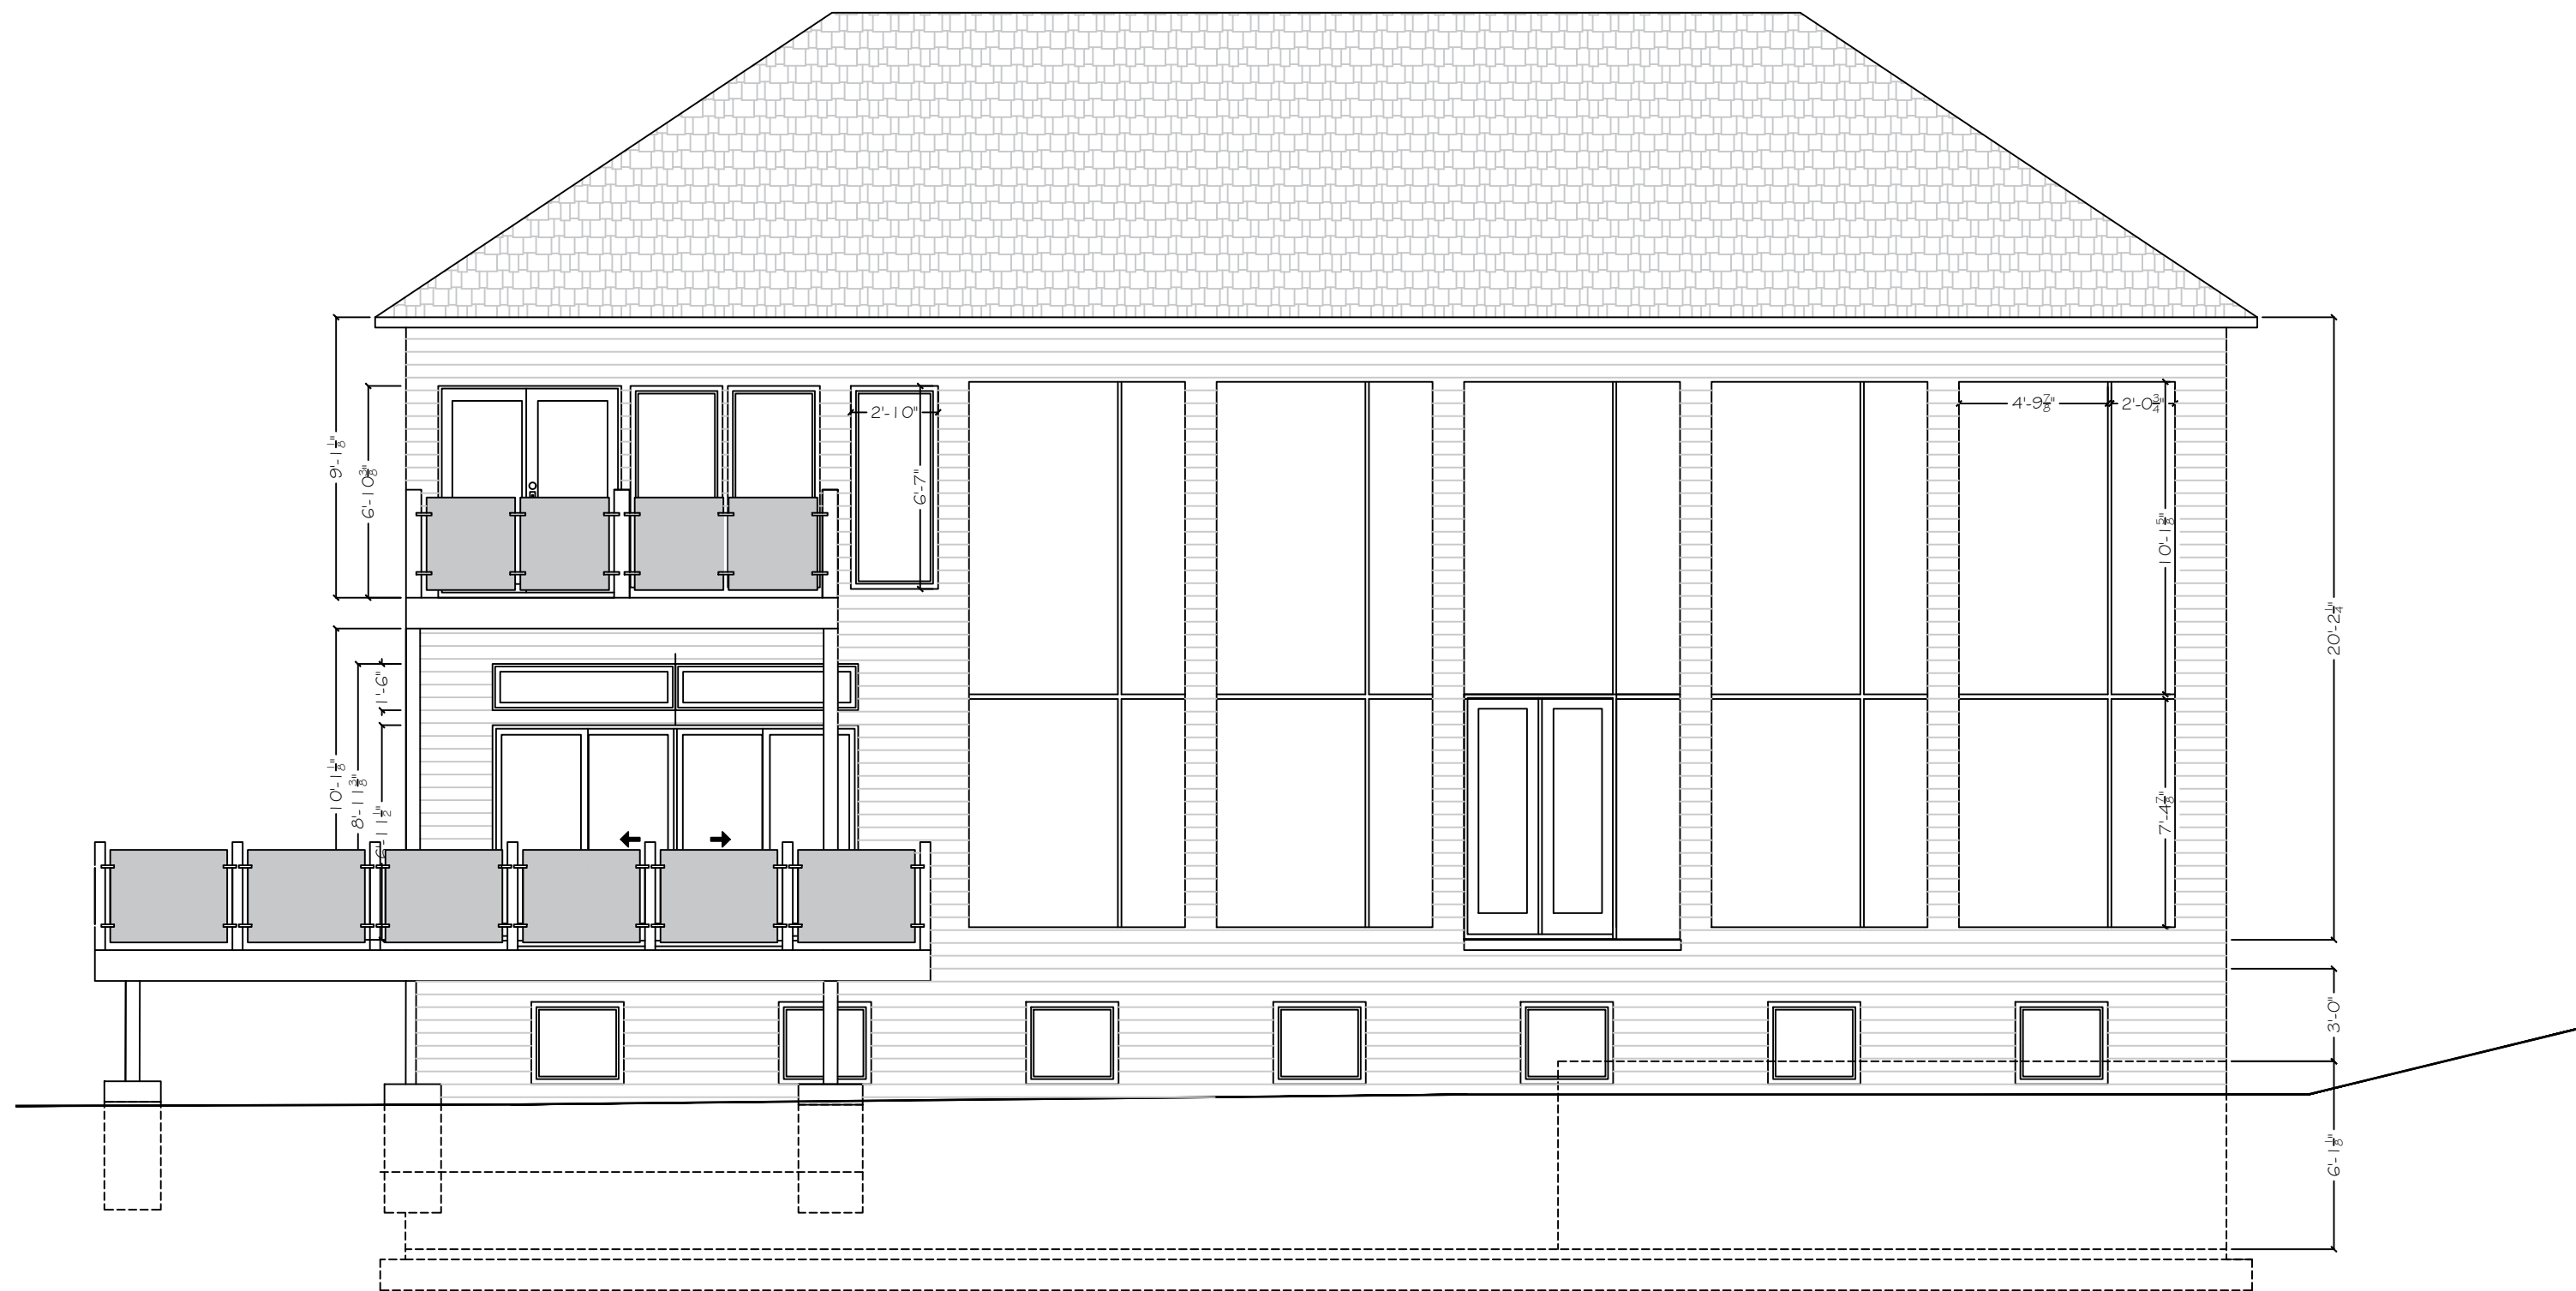

3 REAR SIDE ELEVATION
SCALE: 3/16" = 1' 0"




4 LEFT SIDE ELEVATION
SCALE: 3/16" = 1' 0"

PROJECT:

Proposed New Addition For:
17 Sterling Forest Ln.
Montebello
Rockland County, New York

DRAWN BY:	Shlome Glauber
DATE:	7/15/2024
DATE:	8/2/2024
DATE:	8/28/2024
DATE:	1/13/2025
DATE:	10/29/2025


RODGER BRALEY,
ARCHITECTS
NYS LIC. NO. 013-832
50 PLATT'S HILL ROAD
NEWTOWN, CT 06470
T: 203.426.9918
Email: rbraley2@sbeglobal.net

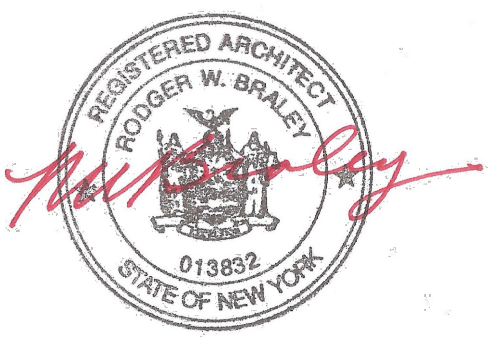


DESCRIPTION:

A-105

SCALE AS NOTED

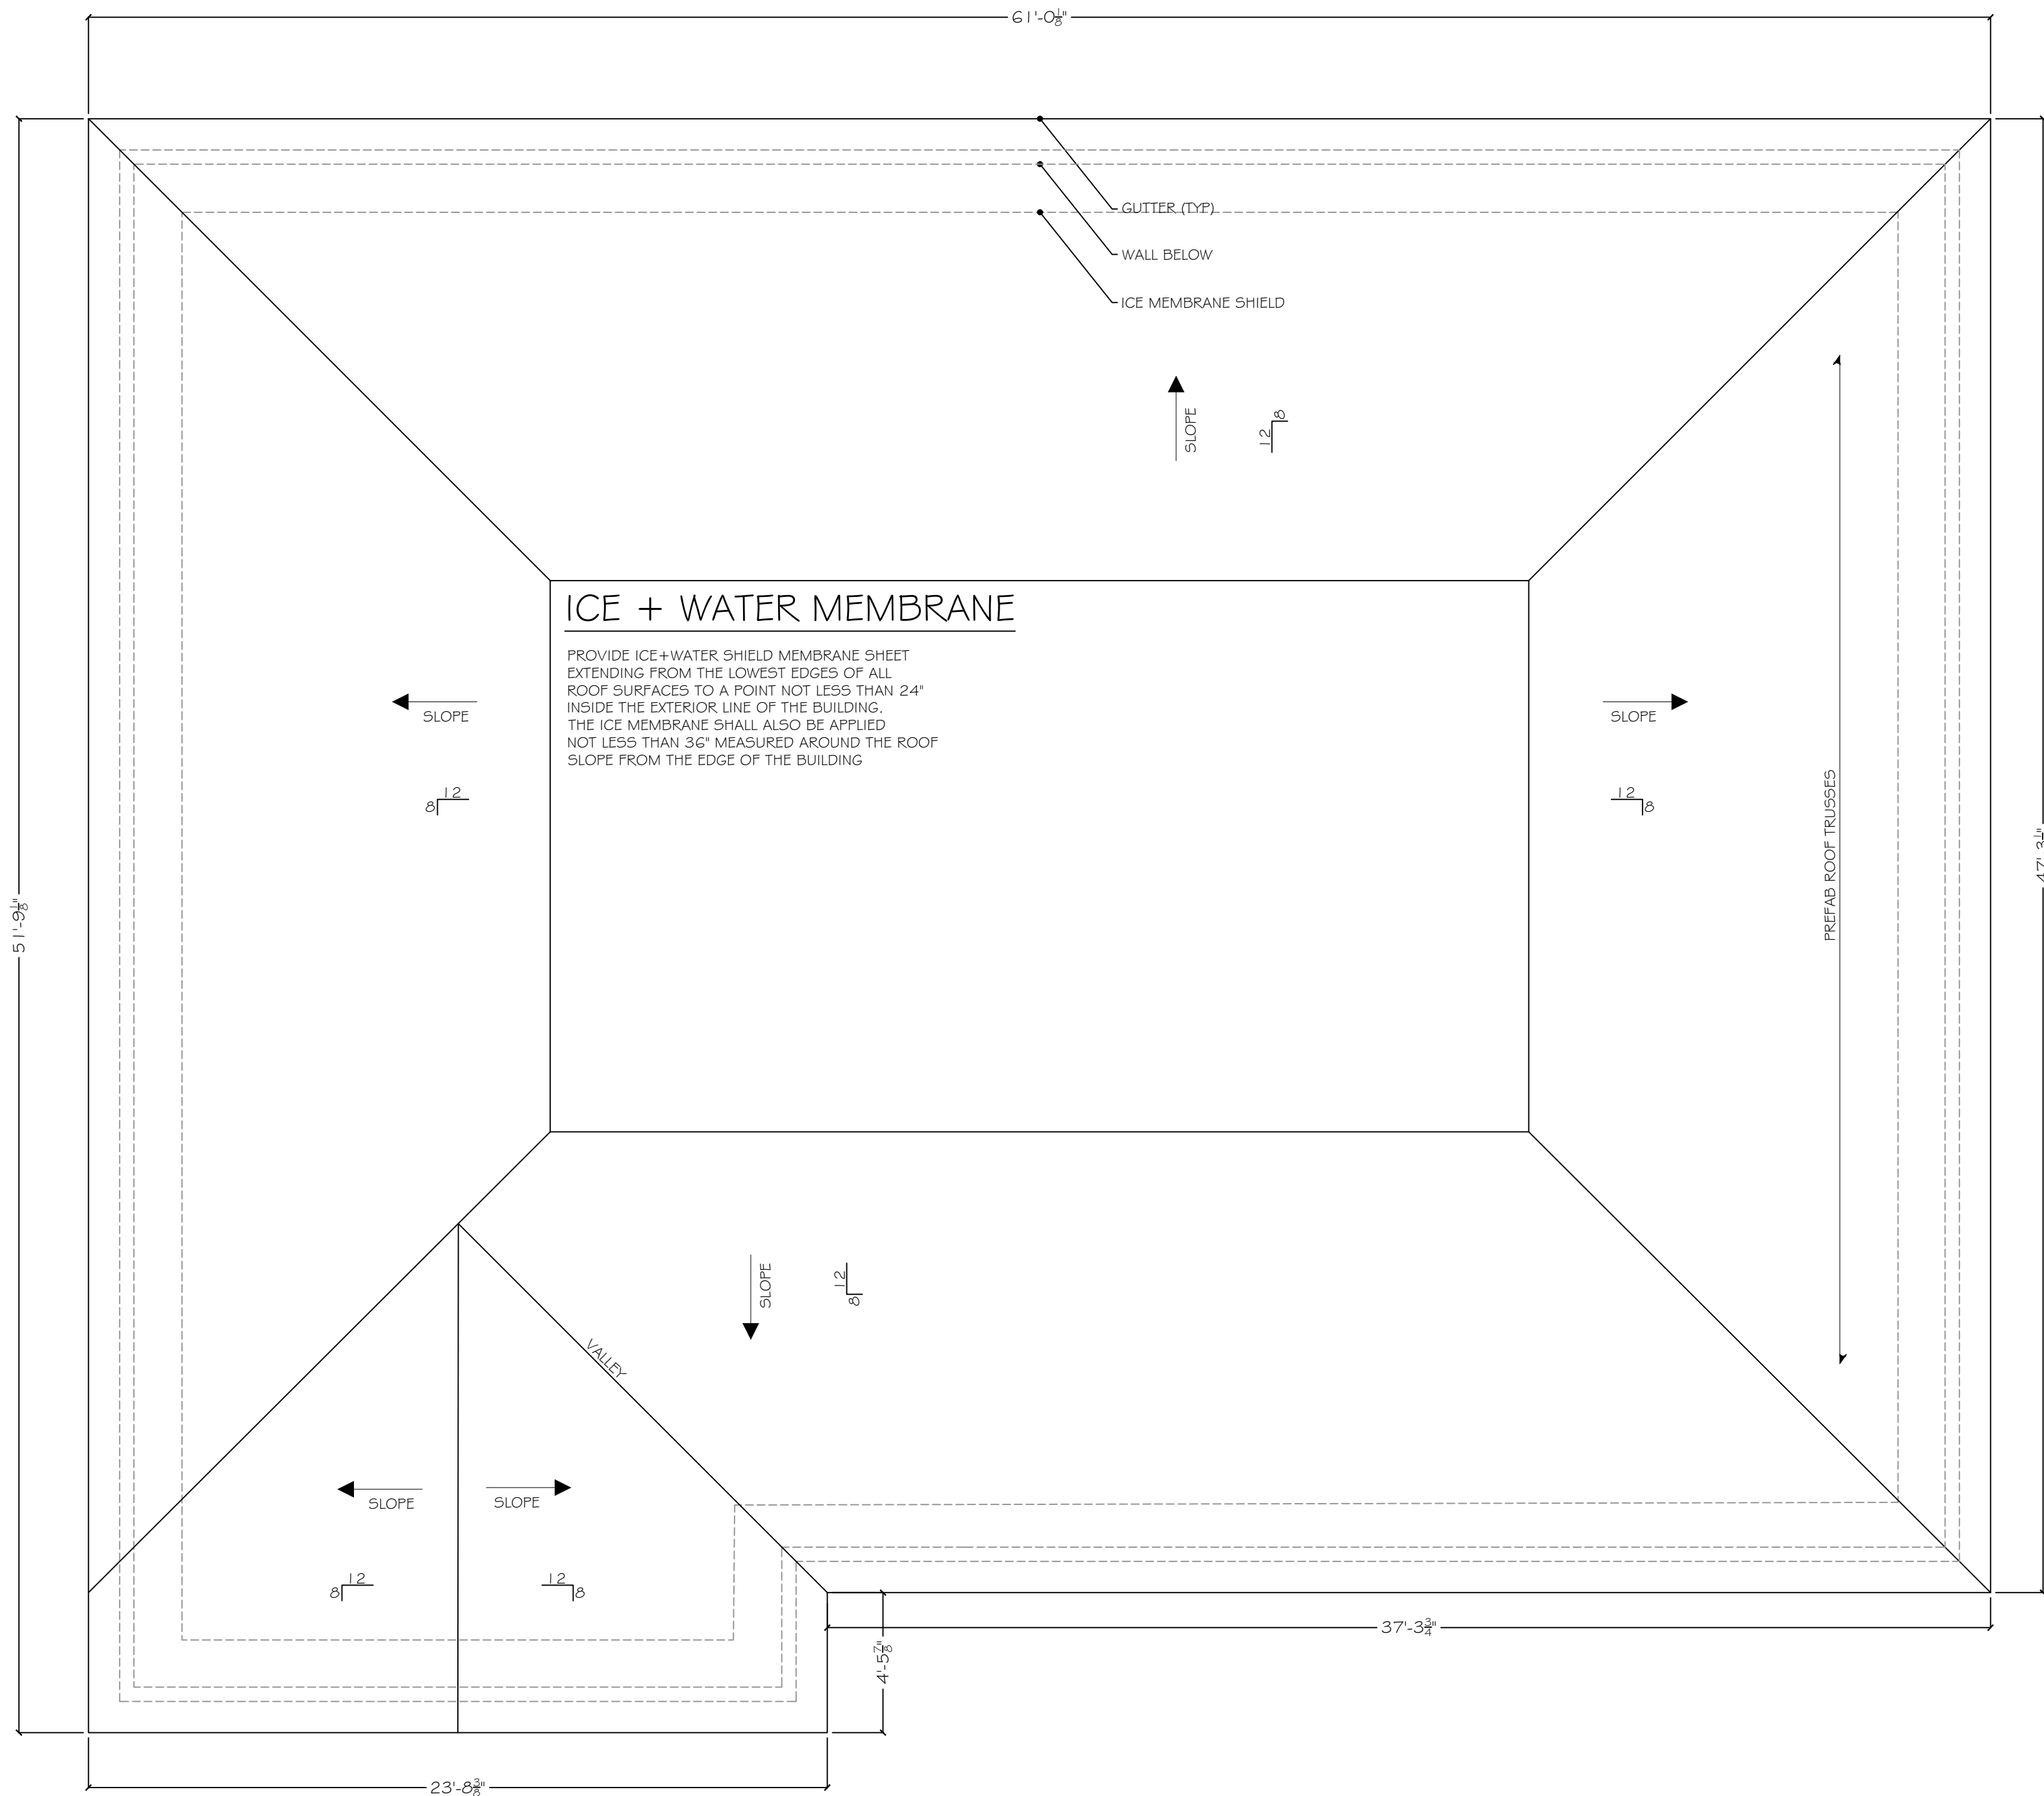


1 PROPOSED ROOF PLAN
SCALE: 1/4" = 1' 0"

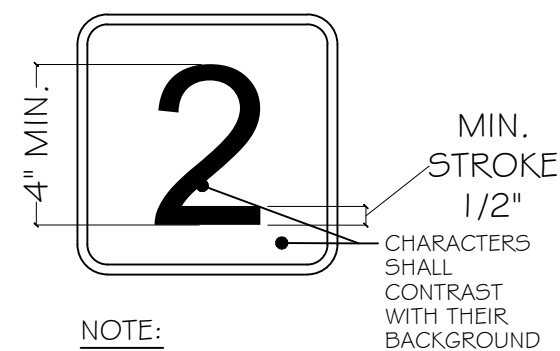

2 ADDRESS IDENTIFICATION DETAIL
SCALE: 1/4" = 1' 0"

"F"	FLOOR FRAMING, INCLUDING GIRDERS AND BEAMS
"R"	ROOF FRAMING
"FR"	FLOOR AND ROOF FRAMING

The construction type designation shall be "I", "II", "III", "IV" or "V" to indicate the construction classification of the structure under section 602 of the BCNYS

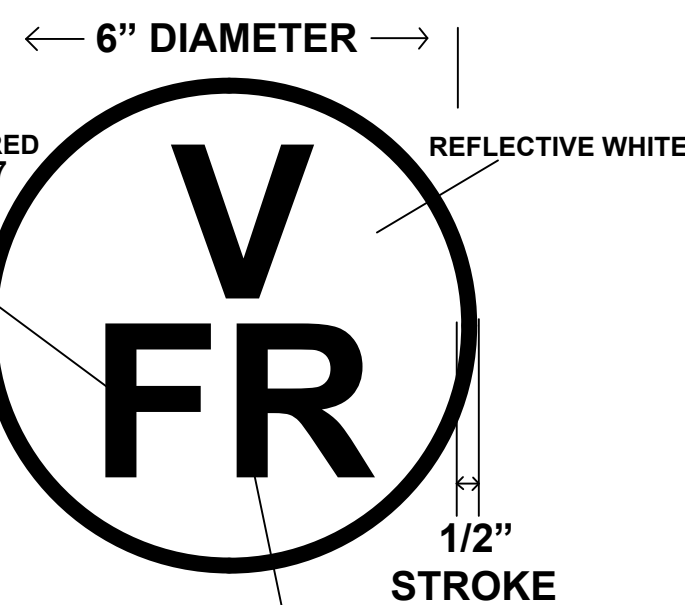


DESIGNATION FOR STRUCTURAL COMPONENTS THAT ARE OF TRUSS TYPE CONSTRUCTION

NOTE 1: CONFIRM LOCATION WITH BUILDING CODE OFFICIAL CHAPTER 33, PART 1264 OF THE NYS BUILDING CODE INSTALL IDENTIFICATION SIGN FOR BUILDINGS UTILIZING TRUSS TYPE CONSTRUCTION

INTERNATIONAL RESIDENTIAL CODE OF 2020, SECTION R302.1.3 - PROTECTION OF FLOORS
EXCEPTION 4 - WOOD FLOOR ASSEMBLIES USING DIMENSIONAL OR STRUCTURAL COMPOSITE LUMBER EQUAL TO OR GREATER THAN 2" x 1 0" NOMINAL. CODE OFFICIAL DETERMINATION - COVER UNDERSIDE OF TJI JOISTS PER CODE WITH 1/2" GYP. BD. CONTRACTOR TO SUBMIT JOIST MANUFACTURER SPECIFICATIONS TO THE BUILDING CODE OFFICIAL PRIOR TO ORDER FOR REVIEW.

3 TRUSS TYPE CONS. SIGN DETAIL
SCALE: 1/4" = 1' 0"

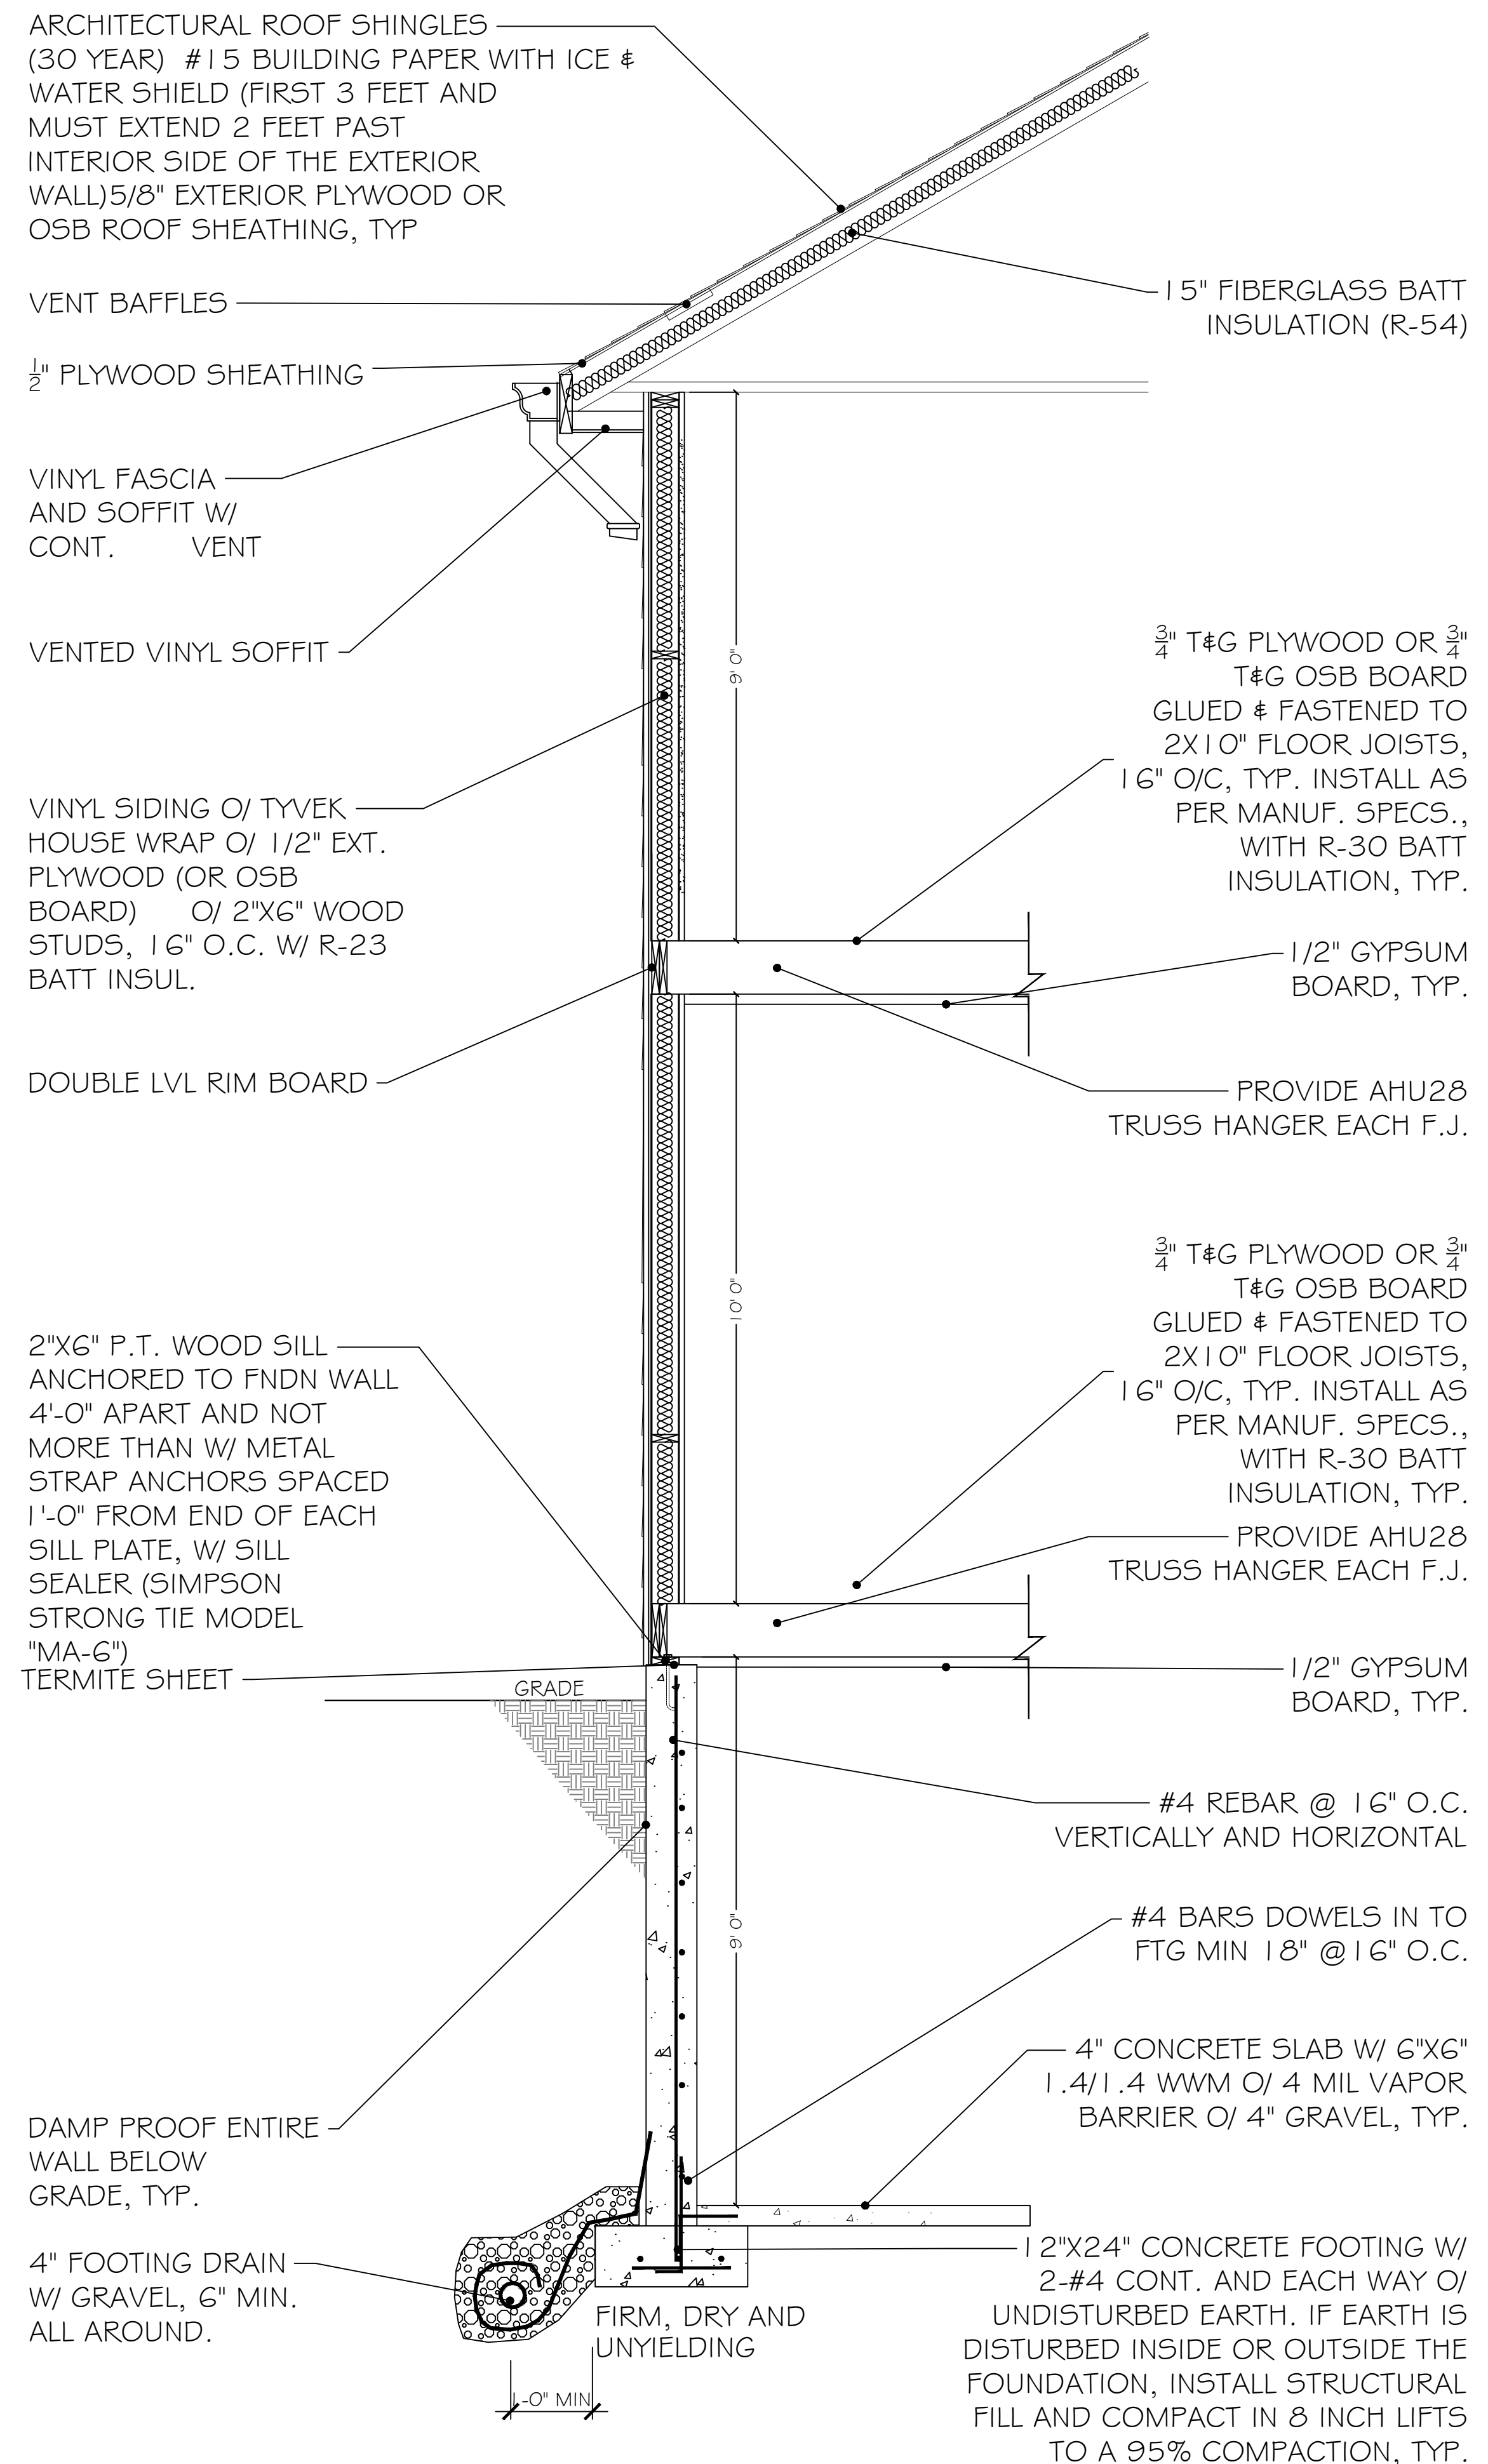


4 TYPICAL WALL SECTION
SCALE: 1/2" = 1' 0"

PROJECT:

Proposed New Addition For:
17 Sterling Forest Ln.
Montebello
Rockland County, New York

DRAWN BY:	Shlome Glauber
DATE:	7/15/2024
DATE:	8/2/2024
DATE:	8/28/2024
DATE:	1/13/2025
DATE:	10/29/2025


RODGER BRALEY,
ARCHITECTS
NYS LIC. NO. 013-832
50 PLATT'S HILL ROAD
NEWTOWN, CT 06470
T: 203.426.9918
Email: rbraley2@sbeglobal.net

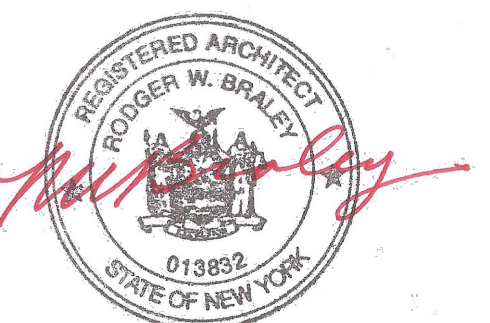


DESCRIPTION:

A-106

SCALE AS NOTED

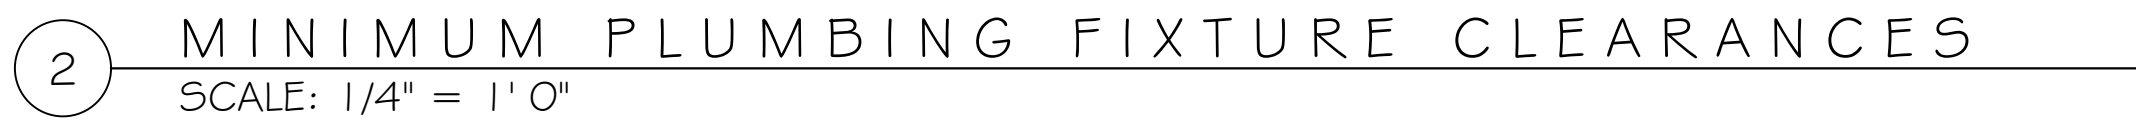

SECTION 4403.4 SYSTEMS
BUILDING MECHANICAL SYSTEMS SHALL COMPLY WITH SECTION R403.0 OF THE ENERGY CONSERVATION CONSTRUCTION CODE OF NEW YORK STATE (ECCNYS)
EACH UNIT TO HAVE AT LEAST ONE PROGRAMMABLE THERMOSTAT FOR EACH SEPARATE HEATING AND COOLING CONTROLLING THE PRIMARY HEATING OR COOLING SYSTEM OF THE DWELLING UNIT SHALL BE CAPABLE OF CONTROLLING THE HEATING AND COOLING SYSTEM ON A DAILY SCHEDULE TO MAINTAIN DIFFERENT TEMPERATURE SET POINTS AT DIFFERENT TIMES OF THE DAY. THIS THERMOSTAT SHALL INCLUDE THE CAPABILITY TO SET BACK OR TEMPORARILY OPERATE THE SYSTEM TO MAINTAIN ZONE TEMPERATURES DOWN TO 55°F (13°C) OR UP TO MAINTAIN ZONE TEMPERATURES SHALL INITIALLY BE PROGRAMMED BY THE MANUFACTURER, WITH A HEATING TEMPERATURE SET POINT NO HIGHER THAN 70°F (21°C) AND A COOLING TEMPERATURE SET POINT NO LOWER THAN 78°F (26°C). HEAT PUMPS HAVING SUPPLEMENTARY ELECTRIC-RESISTANCE HEAT SHALL HAVE CONTROLS THAT, EXCEPT DURING DEFROST, PREVENT SUPPLEMENTAL HEAT OPERATION WHEN THE HEAT PUMP COMPRESSOR CAN MEET THE HEATING LOAD.
ALL SUPPLY AND RETURN DUCTS IN ATTICS SHALL BE INSULATED TO A MINIMUM OF R-6 WHERE LESS THAN 3 INCHES IN DIAMETER AND GREATER AND R-6 WHERE LESS THAN 3 INCHES IN DIAMETER, SUPPLY AND RETURN DUCTS IN OTHER PORTIONS OF THE BUILDING SHALL BE INSULATED TO A MINIMUM OF R-6 WHERE 3 INCHES IN DIAMETER OR GREATER AND R-4.2 WHERE LESS THAN 3 INCHES IN DIAMETER.
EXCEPTION: DUCTS OR PORTIONS THEREOF LOCATED COMPLETELY INSIDE THE BUILDING THERMAL ENVELOPE.
HEATING: DUCTS, AIR HANDLERS AND FILTER BOXES SHALL BE SEALED. JOINTS AND SEAMS SHALL COMPLY WITH EITHER THE INTERNATIONAL MECHANICAL CODE OR INTERNATIONAL RESIDENTIAL CODE, AS APPLICABLE.
EXCEPTIONS:
A. IIR-IMPERMEABLE SPRAY FOAM PRODUCTS SHALL BE PERMITTED TO BE APPLIED WITHOUT ADDITIONAL JOINT SEALS.
B. OR DUCTS HAVING A STATIC PRESSURE CLASSIFICATION OF LESS THAN 2 INCHES OF WATER COLUMN (500 PA), ADDITIONAL CLOSURE SYSTEMS SHALL NOT BE REQUIRED FOR CONTINUOUSLY WELDED JOINTS AND SEAMS, AND LOCKING-TYPE JOINTS AND SEAMS OF OTHER THAN THE SNAP-LOCK AND BUTTON-LOCK TYPES.
ALL DUCTS TO BE TESTED FOR LEAKAGE ACCORDING TO SECTION R403.3.3 OF THE ENERGY CONSERVATION CONSTRUCTION CODE OF NEW YORK STATE (ECCNYS)
BUILDING FRAMING CAVITIES SHALL NOT BE USED AS DUCTS OR PLENUMS
ALL DUCTS TO COMPLY WITH SECTION R403.3 OF THE ENERGY CONSERVATION CONSTRUCTION CODE OF NEW YORK STATE (ECCNYS)
ALL MECHANICAL SYSTEM PIPING INSULATION TO COMPLY WITH SECTION R403.4 OF THE ENERGY CONSERVATION CONSTRUCTION CODE OF NEW YORK STATE (ECCNYS)
SERVICE HOT WATER SYSTEMS TO COMPLY WITH SECTION R403.5 OF THE ENERGY CONSERVATION CONSTRUCTION CODE OF NEW YORK STATE (ECCNYS)
HEATED WATER CIRCULATION SYSTEMS SHALL BE IN ACCORDANCE WITH SECTION R403.5.1.1. HEAT TRACE TEMPERATURE MAINTENANCE SYSTEMS SHALL BE IN ACCORDANCE WITH SECTION R403.5.1.2. AUTOMATIC CONTROLS, TEMPERATURE SENSORS AND PUMPS SHALL BE ACCESSIBLE.
MANUAL CONTROLS SHALL BE READILY ACCESSIBLE.
R403.5.1.1 CIRCULATION SYSTEMS
HEATED WATER CIRCULATION SYSTEMS SHALL BE PROVIDED WITH A CIRCULATION PUMP. THE SYSTEM RETURN PIPE SHALL BE A DEDICATED RETURN PIPE OR A COLD WATER SUPPLY PIPE. GRAVITY AND THERMOSYPHON CIRCULATION SYSTEMS SHALL BE PROHIBITED. CONTROLS FOR CIRCULATING HOT WATER SYSTEM PIPES SHALL SHUT OFF THE PUMP WHEN THERE IS IDENTIFICATION OF A DEMAND FOR HOT WATER WITHIN THE OCCUPANCY. THE CONTROLS SHALL AUTOMATICALLY TURN OF THE PUMP WHEN THE WATER IN THE CIRCULATION LOOP IS AT THE DESIRED TEMPERATURE AND WHEN THERE IS NO DEMAND FOR HOT WATER.
R403.5.1.2 HEAT TRACE SYSTEMS
ELECTRIC HEAT TRACE SYSTEMS SHALL COMPLY WITH IEEE 515.1 OR UL 515. CONTROLS FOR SUCH SYSTEMS SHALL AUTOMATICALLY SHUT OFF THE PUMP WHEN THE HEAT TRACING TO MAINTAIN THE DESIRED WATER TEMPERATURE IN THE PIPING IN ACCORDANCE WITH THE TIMES WHEN HEATED WATER IS USED IN THE OCCUPANCY
MECHANICAL VENTILATION TO COMPLY WITH SECTION R403.6 OF THE ENERGY CONSERVATION CONSTRUCTION CODE OF NEW YORK STATE (ECCNYS)
R403.7 EQUIPMENT SIZING AND EFFICIENCY RATING.
HEATING AND COOLING EQUIPMENT SHALL BE SIZED IN ACCORDANCE WITH ACCA MANUAL 5 BASED ON BUILDING LOADS CALCULATED IN ACCORDANCE WITH ACCA MANUAL J OR OTHER APPROVED HEATING AND COOLING CALCULATION METHODOLOGIES. NEW OR REPLACEMENT HEATING AND COOLING EQUIPMENT SHALL HAVE AN EFFICIENCY RATING EQUAL TO OR GREATER THAN THE MINIMUM REQUIRED BY FEDERAL LAW FOR THE GEOGRAPHIC LOCATION WHERE THE EQUIPMENT IS INSTALLED.
R403.8 SYSTEMS SERVING MULTIPLE DWELLING UNITS
SYSTEMS SERVING MULTIPLE DWELLING UNITS SHALL COMPLY WITH SECTIONS C403 AND C404 OF THE ECCNYS - COMMERCIAL PROVISIONS IN LIEU OF SECTION R403.
R403.9 SNOW MELT AND ICE SYSTEM CONTROLS.
SNOW- AND ICE-MELTING SYSTEMS, SUPPLIED THROUGH ENERGY SERVICE TO THE BUILDING, SHALL INCLUDE AUTOMATIC CONTROLS CAPABLE OF SHUTTING OFF THE SYSTEM WHEN THE AMBIENT TEMPERATURE IS ABOVE 50°F (10°C), AND NO PRECIPITATION IS FALLING AND AN AUTOMATIC OR MANUAL CONTROL THAT WILL ALLOW SHUTOFF WHEN THE OUTDOOR TEMPERATURE IS ABOVE 40°F (4.8°C).
THE SECTION R404 ELECTRICAL POWER AND LIGHTING SYSTEMS A MINIMUM OF 90 PERCENT OF THE LAMPS IN PERMANENTLY INSTALLED LIGHTING FIXTURES SHALL BE HIGH-EFFICIENCY LAMPS. FUEL GAS SYSTEMS SHALL NOT HAVE CONTINUOUSLY BURNING PILOT LIGHTS
IN ALL BUILDINGS HAVING INDIVIDUAL DWELLING UNITS, PROVISIONS SHALL BE MADE TO DETERMINE THE ELECTRICAL ENERGY CONSUMED BY EACH UNIT BY SEPARATELY METERING OR MONITORING INDIVIDUAL DWELLING UNITS.

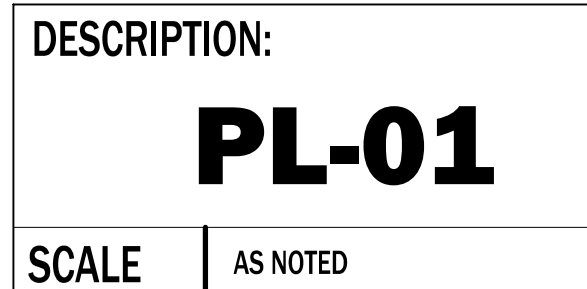

1 BASEMENT FLOOR ELECTRIC PLAN

SCALE: 1/4" = 1' 0"



ELECTRICAL SYMBOLS LEGEND

- 12 WATT LED BULB OR EQUIVALENT
- 8 WATT LED BULB OR EQUIVALENT
- 20 WATT LED BULB OR EQUIVALENT
- COMBINATION EXHAUST FAN / LIGHT (8W LED) - DIRECTLY VENTED TO EXTERIOR, MIN. 48" FROM WINDOW OR OPENING
- DUPLEX RECEPTACLE OUTLET
- GROUND FAULT PROTECTION RECEPTACLE OR CIRCUIT
- LIGHT SWITCH
- SMOKE DETECTOR INTERCONNECTED
- CARBON MONOXIDE DETECTOR INTERCONNECTED

LED Wattage Calculation (for Ambient Lighting)
Assuming 20 lumens/sq. ft. for ambient lighting and 100 lumens/watt for LED lights:

		12W BULB	8W BULB	12W BULB	TOTAL FF+B WATT
GYM	(197sq. ft. x 20) ÷ 100 = 39.4	2	0	2	48
MEDITATION ROOM	(118sq. ft. x 20) ÷ 100 = 23.6	0	3	4	48
STUDY ROOM	(136sq. ft. x 20) ÷ 100 = 27.2	0	4	0	24
FAMILY ROOM	(382sq. ft. x 20) ÷ 100 = 76.4	4	0	0	32
STAIR LOBBY	(323sq. ft. x 20) ÷ 100 = 64.6	5	0	3	84
LOBBY 1	(62sq. ft. x 20) ÷ 100 = 12.4	1	0	0	60
LOBBY 2	(49sq. ft. x 20) ÷ 100 = 9.8	0	1	0	12

		12W BULB	20W BULB	12W BULB	TOTAL FF+B WATT
DINING (double height)	(504 sq. ft. x 20) ÷ 100 = 100.8 x 2 = 201.6	0	10	0	200
LIVING (double height)	(504 sq. ft. x 20) ÷ 100 = 100.8 x 2 = 201.6	0	11	0	210
PLAYROOM	(166 sq. ft. x 20) ÷ 100 = 33.2	3	0	0	36
KITCHEN	(397 sq. ft. x 20) ÷ 100 = 79.4	7	0	0	84
DINETTE	(249 sq. ft. x 20) ÷ 100 = 49.8	4	0	0	48
OFFICE	(161 sq. ft. x 20) ÷ 100 = 32.2	3	0	0	36
MASTER BED	(255 sq. ft. x 20) ÷ 100 = 51	4	0	0	48
MASTER LOUNGE	(144 sq. ft. x 20) ÷ 100 = 28.8	3	0	0	36
BEDROOM 2	(84 sq. ft. x 20) ÷ 100 = 16.8	2	0	0	24
BEDROOM 3	(104 sq. ft. x 20) ÷ 100 = 20.8	2	0	0	24
BEDROOM 4	(123 sq. ft. x 20) ÷ 100 = 24.6	2	0	0	24
BEDROOM 5	(105 sq. ft. x 20) ÷ 100 = 21	2	0	0	24
LAUNDRY	(50 sq. ft. x 20) ÷ 100 = 10	1	0	0	12

LIGHT AND VENT CALCULATIONS

ROOM	SF	LIGHT REQUIRED	LIGHT PROVIDED	VENT REQUIRED	VENT PROVIDED
BASEMENT					
GYM	197	15.76	5.4 *	7.88	6.2 *
FAMILY ROOM	382	30.56	16.2 *	15.28	18.6 **
MEDITATION ROOM	118	4.72	56.25	9.44	61.33
STUDY ROOM	136	10.88	56.25	5.44	61.33
GROUND FLOOR					
DINING/ LIVING/ PLAYROOM	1174	93.9	874	46.9	70.6
KITCHEN / DINETTE	646	51.7	177.8	25.8	69.8
OFFICE	161	12.88	52	6.44	53.16
FIRST FLOOR					
MASTER BEDROOM	255	20.4	111.5	10.2	119
MASTER LIVING	144	11.52	57	5.76	12.1
BEDROOM #2	84	6.7	6.83	3.4	7.76
BEDROOM #3	104	8.3	18.6	4.2	21.1
BEDROOM #4	123	9.8	18.6	4.9	21.1
BEDROOM #5	105	8.4	18.6	4.2	21.1
LAUNDRY	50	4	6.83	2	7.76




MONROE, N.Y. 10950
(845) 492-1783
Email: office@szdrawings.com

PROJECT:

Proposed New Addition For:
17 Sterling Forest Ln.
Montebello
Rockland County, New York

DRAWN BY:	Shlome Glauber
DATE:	7/15/2024
DATE:	8/2/2024
DATE:	8/28/2024
DATE:	1/13/2025
DATE:	10/29/2025

RODGER BRALEY,
ARCHITECTS
NYS LIC. NO. 013-832
50 PLATT'S HILL ROAD
NEWTOWN, CT 06470
T: 203.426.9918
Email: rbraley2@sbcglobal.net

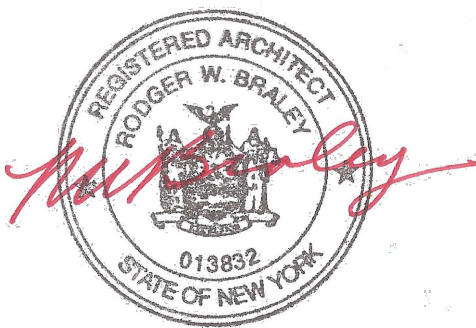

DESCRIPTION:

E-101

SCALE AS NOTED

1 BASEMENT FLOOR ELECTRIC PLAN

SCALE: 1/4" = 1' 0"



ELECTRICAL SYMBOLS LEGEND

- A 12 WATT LED BULB OR EQUIVALENT
- A 8 WATT LED BULB OR EQUIVALENT
- A 20 WATT LED BULB OR EQUIVALENT
- COMBINATION EXHAUST FAN / LIGHT (8W LED) - DIRECTLY VENTED TO EXTERIOR, MIN. 48" FROM WINDOW OR OPENING
- DUPLEX RECEPTACLE OUTLET
- GROUND FAULT PROTECTION RECEPTACLE OR CIRCUIT
- LIGHT SWITCH
- SMOKE DETECTOR INTERCONNECTED
- CARBON MONOXIDE DETECTOR INTERCONNECTED

LED Wattage Calculation (for Ambient Lighting)
Assuming 20 lumens/sq. ft. for ambient lighting and 100 lumens/watt for LED lights:

		12W BULB	8W BULB	12W BULB	TOTAL FF+B WATT
GYM	(197sq. ft. x 20) ÷ 100 = 39.4	2	0	2	48
MEDITATION ROOM	(118sq. ft. x 20) ÷ 100 = 23.6	0	3	4	48
STUDY ROOM	(136sq. ft. x 20) ÷ 100 = 27.2	0	4	0	24
FAMILY ROOM	(382sq. ft. x 20) ÷ 100 = 76.4	4	0	0	32
STAIR LOBBY	(323sq. ft. x 20) ÷ 100 = 64.6	5	0	3	84
LOBBY 1	(62sq. ft. x 20) ÷ 100 = 12.4	1	0	0	60
LOBBY 2	(49sq. ft. x 20) ÷ 100 = 9.8	0	1	0	12

		12W BULB	20W BULB	12W BULB	TOTAL FF+B WATT
DINING (double height)	(504 sq. ft. x 20) ÷ 100 = 100.8 x 2 = 201.6	0	10	0	200
LIVING (double height)	(504 sq. ft. x 20) ÷ 100 = 100.8 x 2 = 201.6	0	11	0	210
PLAYROOM	(166 sq. ft. x 20) ÷ 100 = 33.2	3	0	0	36
KITCHEN	(397 sq. ft. x 20) ÷ 100 = 79.4	7	0	0	84
DINETTE	(249 sq. ft. x 20) ÷ 100 = 49.8	4	0	0	48
OFFICE	(161 sq. ft. x 20) ÷ 100 = 32.2	3	0	0	36
MASTER BED	(255 sq. ft. x 20) ÷ 100 = 51	4	0	0	48
MASTER LOUNGE	(144 sq. ft. x 20) ÷ 100 = 28.8	3	0	0	36
BEDROOM 2	(84 sq. ft. x 20) ÷ 100 = 16.8	2	0	0	24
BEDROOM 3	(104 sq. ft. x 20) ÷ 100 = 20.8	2	0	0	24
BEDROOM 4	(123 sq. ft. x 20) ÷ 100 = 24.6	2	0	0	24
BEDROOM 5	(105 sq. ft. x 20) ÷ 100 = 21	2	0	0	24
LAUNDRY	(50 sq. ft. x 20) ÷ 100 = 10	1	0	0	12

LIGHT AND VENT CALCULATIONS


ROOM	SF	LIGHT REQUIRED	LIGHT PROVIDED	VENT REQUIRED	VENT PROVIDED
BASEMENT					
GYM	197	15.76	5.4 *	7.88	6.2 *
FAMILY ROOM	382	30.56	16.2 *	15.28	18.6 **
MEDITATION ROOM	118	4.72	56.25	9.44	61.33
STUDY ROOM	136	10.88	56.25	5.44	61.33
GROUND FLOOR					
DINING/ LIVING/ PLAYROOM	1174	93.9	874	46.9	70.6
KITCHEN / DINETTE	646	51.7	177.8	25.8	69.8
OFFICE	161	12.88	52	6.44	53.16
FIRST FLOOR					
MASTER BEDROOM	255	20.4	111.5	10.2	119
MASTER LIVING	144	11.52	57	5.76	12.1
BEDROOM #2	84	6.7	6.83	3.4	7.76
BEDROOM #3	104	8.3	18.6	4.2	21.1
BEDROOM #4	123	9.8	18.6	4.9	21.1
BEDROOM #5	105	8.4	18.6	4.2	21.1
LAUNDRY	50	4	6.83	2	7.76

PROJECT:

Proposed New Addition For:
17 Sterling Forest Ln.
Montebello
Rockland County, New York

DRAWN BY:	Shlome Glauber
DATE:	7/15/2024
DATE:	8/2/2024
DATE:	8/28/2024
DATE:	1/13/2025
DATE:	10/29/2025

RODGER BRALEY,
ARCHITECTS
NYS LIC. NO. 013-832
50 PLATT'S HILL ROAD
NEWTOWN, CT 06470
T: 203.426.9918
Email: rbraley2@sbcglobal.net

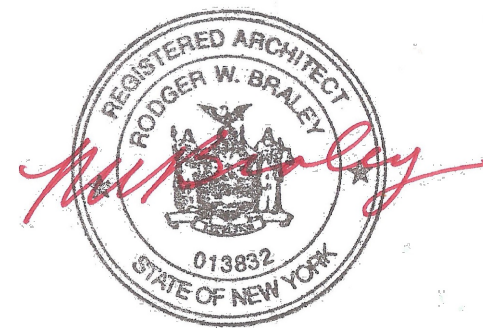

DESCRIPTION:

E-102

SCALE AS NOTED

GENERAL NOTES

ALL WORK SHALL BE IN ACCORDANCE WITH ALL PREVAILING CODES, LAWS AND ORDINANCES OF THE 2020 BUILDING & ENERGY CONSERVATION CODES OF NYS. AND THE LOCAL ZONING LAWS OF WHICH THE PROJECT IS LOCATED.

THE CONTRACTOR AND ALL SUBCONTRACTORS SHALL CARRY PRIOR, DURING AND AFTER CONSTRUCTION ALL NECESSARY LICENSES AND INSURANCES PER THE N.Y.S., LOCAL AND ALL GOVERNING REGULATIONS.

THE OWNER SHOULD READ AND REVIEW HIS/HER ENTIRE SET OF CONTRACT DOCUMENTS (PLANS & SPECIFICATIONS) PRIOR TO GIVING IT TO THE CONTRACTOR. OWNER SHALL CONFIRM THAT ALL INFORMATION IS CORRECT. SHOULD THE OWNER FIND ANYTHING THAT WASN'T WHAT THEY INTENDED TO BE DONE, THEN THEY SHALL HAVE THE ARCHITECT AMEND IT AS REQUIRED. THE ARCHITECT IS NOT RESPONSIBLE FOR CONSTRUCTION, AND/OR PROJECT SITE. THE GENERAL PUBLIC, PROSPECTIVE BUYERS AND ALL OTHER NON-CONSTRUCTION RELATED PERSONS ARE NOT TO ENTER THE CONSTRUCTION WORK AREA UNTIL A VALID CERTIFICATE OF OCCUPANCY IS ISSUED BY THE LOCAL BUILDING DEPARTMENT.

THE PROJECT SITE SHALL BE PROPERLY POSTED AND TAPED AND/OR FENCED OFF TO ENSURE PUBLIC SAFETY AND SAFEGUARD THE PUBLIC AT ALL TIMES. THE CONTRACTOR SHALL VERIFY ALL DIMENSIONS AND FAMILIARIZE HIMSELF WITH THE CONTRACT DOCUMENTS (PLANS & SPECIFICATIONS) PRIOR TO ANY ERECTION/CONSTRUCTION.

ALL DIMENSIONS SHALL BE FIELD VERIFIED BY THE CONTRACTOR AND THE CONTRACTOR SHALL REPORT ANY DISCREPANCIES, ERRORS OR OMISSIONS TO THE ARCHITECT IMMEDIATELY. ALWAYS USE DIMENSIONS AS SHOWN AND THE CONTRACTOR SHOULD REPORT ANY DISCREPANCIES IMMEDIATELY TO THE ARCHITECT.

DRAWINGS ARE NOT TO BE SCALED.

ALL CHANGES MADE BY THE CONTRACTOR SHALL FIRST BE APPROVED BY THE ARCHITECT AND OWNER PRIOR TO STARTING WITH THE WORK INVOLVED. ANY UNAUTHORIZED CHANGES MADE BY THE CONTRACTOR AND ULTIMATELY NOT BEING APPROVED BY THE OWNER AND ARCHITECT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR AND TO BE CORRECTED AT HIS OWN EXPENSE.

THE ARCHITECT HAS NOT BEEN RETAINED FOR ANY MECHANICAL DESIGN SYSTEMS, DUCTS, CHASE OPENINGS, SIZE OF FURNACE AND FRESH AIR REQUIREMENTS ETC. THESE ARE NOT SHOWN AND SHALL BE DETERMINED BY A MECHANICAL ENGINEER PRIOR TO COMMENCING THE WORK.

THE ARCHITECT HAS NOT BEEN RETAINED FOR SUPERVISION, AND CONSTRUCTION INSPECTIONS AND/OR THE REVIEW OF SHOP DRAWINGS. THE ARCHITECT HAS ONLY BEEN RETAINED FOR DESIGN PURPOSES. THEREFORE, THE ARCHITECT ASSUMES NO LIABILITY FOR WORKMANSHIP, CODE AND/OR PLAN COMPLIANCE. THE ARCHITECT'S RESPONSIBILITY IS STRICTLY LIMITED TO THESE PLANS AND RELATED SPECIFICATIONS ONLY.

THE ARCHITECT SHALL NOT BE RESPONSIBLE FOR ANY CONSTRUCTION MEANS, METHODS, DEVIATIONS, TECHNIQUES, SEQUENCES, OR PROCEDURES, OR FOR ANY SAFETY PRECAUTIONS AND PROGRAMS IN CONNECTION WITH THE WORK, FOR THE OMISSIONS OF THE CONTRACTOR, SUBCONTRACTORS OR ANY OTHER PERSONS PERFORMING ANY OF THE WORK, OR FOR THE FAILURE OF ANY OF THEM TO CARRY OUT THE WORK IN ACCORDANCE WITH THESE DOCUMENTS. THE ARCHITECT ASSUMES NO RESPONSIBILITY FOR ANY EXISTING STRUCTURES AND OR ANY UNFORESEEN PROBLEMS PRIOR TO NEW CONSTRUCTION.

THE ARCHITECT ASSUMES NO RESPONSIBILITY FOR ANY DEMOLITION, SITE WORK, NEW CONSTRUCTION, OPERATION AND METHOD.

ALL AREAS THAT ARE AFFECTED BY ALL ADDITIONS SHALL BE REPAIRED AND/OR PATCHED TO A LIKE NEW CONDITION, UNLESS NOTED OTHERWISE.

THE CONTRACTOR IS TO OBTAIN ALL NECESSARY PERMITS AND APPROVALS BY THE LOCAL AND STATE AS REQUIRED AND TO DELIVER TO THE OWNER A C.O. UPON COMPLETION OF THE PROJECT.

THE CONTRACTOR SHALL PROVIDE A CONTAINER FOR THE REMOVAL OF DEBRIS DURING CONSTRUCTION.

THE CONTRACTOR AND ALL SUBCONTRACTORS WORKING WITH THIS PROJECT SHALL KEEP THE SITE CLEAN AND HAZARD FREE AT ALL TIMES AND TO OBLIE ALL "OSHA" AND ALL LEAVE SAFETY REGULATIONS.

THE CONTRACTOR SHALL GUARANTEE A WORK SCHEDULE AND/OR DESCRIBED BY THESE DRAWINGS AND IS TO FOLLOW ALL NATIONALLY ACCEPTED TRADE PRACTICES.

SITE NOTES

THESE PLANS ARE BASED ACCORDANCE TO THE SURVEY INFORMATION PROVIDED TO THE ARCHITECT BY THE OWNER. THEY SHOULD BE REVIEWED BY A LICENSED LAND SURVEYOR AND/OR ENGINEER TO VERIFY ALL BUILDING LINES, AND SET BACKS PRIOR TO CONSTRUCTION.

THE ELEVATION SHOWN ON THE PLAN MAY NOT BE ACCURATE IN EVERY DETAIL. THE OWNER SHALL REVIEW THE PLANS WITH THE CONTRACTOR TO INSURE ACCURACY OF DETAILS AND METHODS PROVIDED BY THE CONTRACTOR.

THE CONTRACTOR SHALL BE RESPONSIBLE FOR ANY NOY OTHER UTILITIES, AND VERIFYING THE LOCATION OF THE SAME. UTILITY COMPANIES LINES, SERVICES AND ALL OTHER POSSIBLE EQUIPMENTS OF UTILITY COMPANIES. THE CONTRACTOR SHALL LOCATE AND IDENTIFY THE LOCATIONS OF ALL EXISTING UNDERGROUND UTILITIES, AND PROVIDE UNDERGROUND CONNECTIONS TO THEM.

THE CONTRACTOR SHALL NOTIFY THE ARCHITECT IMMEDIATELY OF ANY GROUND WATER, EXCESSIVE ORGANIC MATERIAL OR ANY OTHER UNUSUAL CONDITIONS DISCOVERED DURING SITE PREPARATION AND/OR EXCAVATION.

THE CONTRACTOR SHALL PROVIDE ONE PROPERLY MAINTAINED, PORTABLE TOILET FOR THE ENTIRE DURATION OF THE CONSTRUCTION.

THE CONTRACTOR SHALL PROVIDE FROM A REGISTERED LAND SURVEYOR A WRITTEN CERTIFICATE THAT THE LARGEST PORTION OF THE FIRST FLOOR MEET OR EXCEED THE REQUIRED FLOOR ELEVATION.

ALL DRIVEWAYS AND WALKWAYS FORM WORK SHALL BE APPROVED BY DEVELOPMENT REVIEW REPRESENTATIVE BEFORE ANY WORK CONTINUES. THE CONTRACTOR SHALL REMOVE AND DISPOSE ALL RUBISH, VEGETATION, STUMPS, ROOTS, AND TREES AS SHOWN ON THE PLANS.

ALL AREAS TO BE COVERED WITH FILL AND GRADED DOWN.

THE CONTRACTOR SHALL PROTECT ALL EXISTING TREES SHOWN TO REMAIN AS REQUIRED.

EXTREME CAUTION SHALL BE TAKEN DURING DEMOLITION OF EXISTING BUILDINGS. THE CONTRACTOR SHALL OBSERVE ANY VARIATIONS AND OR ANY UNFORESEEN DISCREPANCIES WITH THE PLANS, AND SHOULD REPORT IMMEDIATELY TO THE ARCHITECT.

THE CONTRACTOR SHALL BE RESPONSIBLE FOR ALL SHORING, BRACING AND ALL TEMPORARY SUPPORTS PRIOR OR REMOVING THE EXISTING WALLS, CEILINGS, FLOORS AND ROOFS AS PER ALL LOCAL AND OSHA REGULATIONS.

THE CONTRACTOR SHALL PROVIDE WEATHERPROOFING AT THE END OF EACH WORK DAY AS REQUIRED TO PREVENT WEATHER DAMAGE. THE ARCHITECT IS NOT RESPONSIBLE FOR FROZEN PIPES AND/OR MOLD CONDITIONS CREATED BY THE CONTRACTORS NEGLIGENCE.

BACKFILL SHALL NOT BE PLACED UNTIL THE MAIN FLOOR SYSTEM AND BASEMENT CONCRETE INTERIOR FLOOR SLABS ARE INSTALLED. FOOTING DRAINS SHALL BE PROVIDED AS SHOWN, AND APPROPRIATE. THEY SHOULD BE LAID IN GRAVEL BED AND PROTECTED AT THE TOP WITH FILTER FABRIC AND 6" OF 1/2" GRAVEL AROUND & PROVIDE POSITIVE OUTFALL TO A STORM DRAIN OR A DRY-WELL.

THE FINISHED GRADE AND DRIVEWAY SHOULD BE PITCHED AWAY FROM THE BUILDING SUCH THAT ALL THE SURFACE WATER FLOWS AWAY FROM BUILDING. THE FINISHED GRADE HEIGHT SHALL BE A MINIMUM OF 8" BELOW THE ADJACENT FRAMING, OR AS INDICATED ON PLANS.

THE TOP OF ANY FOUNDATION SHALL EXTEND ABOVE THE ELEVATION OF THE STREET CURB AT POINT OF DISCHARGE OR THE INLET OF AN APPROVED DRAINAGE DEVICE A MINIMUM OF 12" PLUS 2 PERCENT.

INSTALLATION OF GAS AND ELECTRICAL METERS SHOULD BE IN STRICT ACCORDANCE WITH THE LOCAL UTILITY COMPANY SPECIFICATIONS.

TABLE 301.2(1) CLIMATIC AND GEOGRAPHIC DESIGN CRITERIA

GROUND SNOW LOAD	WIND DESIGN				SEISMIC DESIGN CATAGORY	SUBJECT TO DAMAGE FROM			WINTER DESIGN TEMP	ICE BARRIER UNDERLAYMENT REQUIRED	FLOOD HAZARDS	AIR FREEZING INDEX	MEAN ANNUAL TEMP.
	SPEED (MPH)	TOPOGRAPHIC EFFECTS	SPECIAL WIND REGION	WIND BORNE DEBRIS ZONE		WEATHERING	FROST LINE DEPTH	TERMITE					
40 PSF	115 MPH				CATAGORY B	SEVERE	42"	MODERATE TO HEAVY	10	YES	NONE	1500	6063

FOUNDATION NOTES

IT'S THE RESPONSIBILITY OF THE CONTRACTOR TO CHECK AND COORDINATE DIMENSIONS BETWEEN FOUNDATION AND FLOOR PLANS PRIOR TO CONSTRUCTION. ALL EXCAVATIONS SHOULD BE SUBSTANTIALLY FREE OF WATER DURING FOUNDATION CONSTRUCTION WORK.

2 KIPS/SQ. FT. (2000#).

ALL STRUCTURAL CONCRETE SHALL BE A STONE CONCRETE WITH A 1:3:5 MIX AND HAVE A MINIMUM STRENGTH OF 3,500 PSI AT THE END OF 28 DAYS.

ALL FOOTINGS TO REST ON UNDISTURBED SOIL CAPABLE OF SUPPORTING 2 TONS PER SQ. FT.

REFERENCE THE PLANS FOR SIZE AND QUANTITY OF REINFORCING BARS.

ALL FOOTINGS SHALL BE BELOW THE FINISHED GRADE MINIMUM OF 3'-6" IN ROCKLAND COUNTY, 3'-6" IN ORANGE COUNTY OR OTHERWISE SHOWN ON THE PLAN.

PROVIDE EXPANSION JOINTS AT PERIMETERS OF ALL CONCRETE SLABS.

ALL INTERIOR FOOTINGS SHALL STEP DOWN TO PERMITER WALL FOOTING DEPTH AT ALL FOOTING INTERSECTIONS.

ALL SUB GRADE FILL MATERIAL SHALL BE COMPACTED TO A DENSITY OF 96. ALL CONCRETE SLABS SHALL BE A MINIMUM OF 4" THICK - REINFORCED WITH 6/6/10x10 WELDED WIRE MESH ON 6" MAX. VERTICAL BARRER ON 4" OF 3/4" GRAVEL, UNLESS SHOWN OTHERWISE AND TO RECEIVE A SMOOTH FINISH.

ALL CONCRETE PAVING SHALL RECEIVE A FINE BROOM FINISH UNLESS SHOWN OTHERWISE.

ALL CONCRETE SLABS TO RECEIVE CONTROL JOINTS (1/2" SAW CUTS) AT A MAXIMUM OF 25'25" TO CONTROL CRACKING WITH SHRINKAGE.

SLOPE ALL CONCRETE SLABS TO DRAIN TO EXTERIOR. SLOPES IN GARAGES SHALL BE A MINIMUM OF 1/8"-1'-0" UNLESS SHOWN OTHERWISE.

MASONRY AND CONCRETE CONTRACTOR SHALL INSTALL ALL ANCHOR BOLTS, PLATES, CHASES, JOISTS, SLEEVES, ETC. AS REQUIRED BY TRADES.

CULK WEATHER-TIGHT ALL OPENINGS.

EXTERIOR OF THE CONCRETE WALLS TO BE COATED WITH RUB-R-WALL COATING OR EQUAL.

INTERIOR COLUMNS TO BE 4" DIAM. STANDARD STEEL - PROVIDE BASE & TOP PLATES.

INTERIOR COLUMNS OVER 9'-0" IN HEIGHT TO BE 5" DIAM. STANDARD STEEL COLUMNS.

EXTREME CAUTION TO BE USED IN DELIVERY OF THE STEEL COLUMNS. MUST NOT BE DROPPED AT ANY TIME.

DOMELS MUST BE TIED INTO FOOTING RE-BARS PRIOR TO POURING FOOTINGS.

CONCRETE AIR-ENTRAINED TO NOT LESS THAN 5% OR NO MORE THAN 7% WHERE REQUIRED.

FOUNDATION ANCHOR BOLTS SHALL BE LOCATED IN THE MIDDLE THIRD OF WIDTH OF SILL > AND SUPPLIED WITH NUT & WASHER TIGHTENED TO EACH BOLT.

FRAMING NOTES

ALL STANDARD FRAMING LUMBER TO BE HEMLOCK FIR #2 OR BETTER UNLESS OTHERWISE NOTED.

ALL ENGINEERED BEAMS INDICATED ON THE PLANS ARE DESIGNED USING THIS SPECIFIC MANUFACTURER AND SHALL BE INSTALLED PER THE MANUFACTURERS SPECIFICATIONS ONLY.

WHEN USING MULTIPLE MEMBER ENGINEERED BEAMS, THE FRAMER SHALL REFERENCE WITH THE SPECIFIC MANUFACTURERS BUILDING GUIDE.

PROVIDE METAL FLASHING AT ALL EXTERIOR DOORS, WINDOWS AND OPENINGS UNLESS SHOWN OTHERWISE.

INSTALL 36" WIDE ICE & WATER SHIELD AT ALL ROOF EDGES, IN VALLEYS, UP AGAINST WALL JUNCTIONS, OVER HIPS AND WRAP OVER ALL FACIAS. THE SHIELD SHALL COVER MINIMUM 24" TOP OF EXTERIOR SIDE OF EXTERIOR WALLS. PROVIDE OPTIONAL SNOW-GUARDS IF REQUIRED WITH THE STANDARD SPACING ALONG THE BOTTOM EDGE OF THE ROOF.

FRAMING NOTES DIMENSIONS ARE TO THE NEAREST INCH. ACTUAL ROOM SIZES MAY VARY DUE TO GYPSUM BOARD.

ALL WOOD FRAMING IN DIRECT CONTACT WITH SOIL, CONCRETE, MASONRY OR WEATHER SHALL BE PRESSURE TREATED (NAPA STANDARD C2, C3).

ALL FRAMING BELOW THE REQUIRED FLOOD ELEVATION AS SET FORTH BY FEMA AND LOCAL BUILDING OFFICIALS SHALL BE PRESSURE TREATED.

SECURE ALL TEMPORARY RAILINGS WITH GUARDS TO BE INSTALLED AROUND ALL FLOOR OPENINGS AND OPEN DOOR OPENINGS. PROVIDE TEMPORARY RAMPS AND/OR STAIRS TO BE INSTALLED AT ALL LEVELS.

ALL LUMBER TO BE SOUND, DRY AND FREE FROM ROT, KNOTS, AND SPLITS.

ALL FRAMING SHALL BE FRAMED AT 16" O.C. UNLESS SHOWN OTHERWISE.

FOR ALL CONVENTIONAL FLOOR FRAMING PROVIDE A MINIMUM OF ONE ROW OF 5/4" CROSS BRIDGING FOR ALL JOISTS WITH SPANS OVER 12'-0" ? OR SHOWN OTHERWISE ON THE PLANS.

PROVIDE A MINIMUM OF DOUBLE JOISTS BELOW ALL PARALLEL PARTITIONS, MAJOR APPLIANCES, BATH FIXTURES, AND AT ALL CANTILEVERS, UNLESS SHOWN OTHERWISE.

PROVIDE A MINIMUM OF DOUBLE ALL JOISTS AT OPENINGS IN FLOORS, CEILINGS AND ROOFS.

PROVIDE A MINIMUM OF DOUBLE WALL STUDS AROUND ALL WALL OPENINGS, JACK STUDS UNDER ALL HEADERS, TRIPLE STUDS AT ALL CORNERS.

PROVIDE POSTS AT ALL RIDGE, HIP AND VALLEY INTERSECTIONS DOWN TO A MINIMUM OF TRIPLE 2"x8" CEILING JOISTS.

ALL FRAMING SHALL BE FRAMED CROWN UP UNLESS AT CANTILEVERS OR SHOWN OTHERWISE.

SOLID BLOCKING SHALL BE PROVIDED UNDER ALL POSTS THAT DON'T REST DIRECTLY ON JOISTS.

ALL INTERIOR WOOD POSTS SHALL BE SOLID STUDS, AND TO BE A MINIMUM OF THE WIDTH OF THE BEAM SUPPORTING IT AND PROVIDE MINIMUM ONE KING STUD AT EITHER SIDE.

BRACE ALL WALLS DURING CONSTRUCTION.

ALL WALL FRAMING OF 9'-0" AND GREATER SHALL HAVE CATS (SOLID BLOCKING) AT MIDHEIGHT ALL DOORS, WINDOWS AND OPENINGS SHALL HAVE A MINIMUM HEADER TO BE AS FOLLOWS UNLESS SHOWN OTHERWISE ON PLANS. UP TO 5'-0" USE (2)x12"x10", UP TO 8'-0" USE (3)x12"x10" OR (2)x12"x12" OPENINGS GREATER THAN 8'-0" SEE PLANS FOR SIZES.

PROVIDE FASTENER NAILS AS FOLLOWS: 10d AT ALL GENERAL FRAMING AND 8d AT ALL PLYWOOD, 4" SPACING MAX. - TABLES R602.3(1) THROUGH R602.3(4).

FIRE BLOCKING SHALL BE PROVIDED AS FOLLOWS

- IN CONCEALED SPACES OF STUD WALLS AND PARTITIONS, INCLUDING FURRED SPACES, AT THE CEILING & FLOOR LEVELS, CONCEALED HORIZ. FURRED SPACES SHALL ALSO BE FIRE BLOCKED AT INTERVAL NOT EXCEEDING 10 FEET. BATTS OR BLANKETS OF MINERAL OR GLASS FIBER SHALL BE ALLOWED AS FIRE BLOCKING IN WALLS CONSTRUCTED USING ROWS OF STUDS OR STAGGERED STUDS.
- AT ALL INTERCONNECTIONS BET. CONCEALED VERT. & HORIZ. SPACES SUCH AS OCCUR AT SOFFITS, DROP CEILINGS AND COVE CEILINGS.
- IN CONCEALED SPACES BET. STAIR STRINGERS AT TOP & BOTTOM OF THE RUN, CONCEALED SPACES UNDER STAIRS SHALL COMPLY w/SECTION R311.2.2.
- AT OPENINGS AROUND VENTS, PIPES AND DUCTS AT CEILING AND FLOOR LEVEL, w/ AN APPROV MATERIAL TO RESIST THE FREE PASSAGE OF FLAME AND PRODUCTS OF COMBUSTION.
- FOR THE FIRE BLOCKING OF CHIMNEYS & FIREPLACES, SEE SECTION R1001.16.
- FIRE BLOCKING OF CORNICES OF A 2 FAMILY DWELLING IS REQ'D AT THE LINE OF DWELLING UNIT SEPARATION.

ROOFING & SIDING

ROOFING, SIDING, TRIM, AND OTHER MATERIALS SHALL BE INSTALLED IN STRICT ACCORD WITH THEIR RESPECTIVE MANUFACTURERS SPECIFICATIONS AND INDUSTRY STANDARDS.

PROVIDE ALUMINUM GUTTERS & ROOF DRAIN LEADERS (ROLS) AS REQUIRED. ROLS AT OUTLET TO BE CONNECTED TO SITE STORM DRAINAGE SYSTEM.

PROVIDE APPROVED SNOW GUARDS AT ROOF EDGES WITH PITCH EXCEEDING 7:12 OVER ALL DOORWAYS, DECKS & WALKWAYS WITHIN 36" OF DWELLING ROOFING, SIDING, TRIM, AND OTHER MATERIALS COLORS TO BE DETERMINED FROM BUILDERS SELECTION PRIOR TO ORDERING. ARCHITECT IS NOT RESPONSIBLE FOR COLOR AND/OR MATERIAL SELECTIONS.

DOOR & WINDOW NOTES

ALL WINDOWS AND EXTERIOR DOORS SHALL COMPLY WITH THE ENERGY CONSERVATION CODE OF N.Y.S. AND FOR THE COUNTY THIS PROJECT IS LOCATED.

ALL DOORS SHALL CONFORM TO THE STATE CODE SIZE REQUIREMENTS. WINDOW SCHEDULE IS FOR DESIGN INTENT ONLY. THE CONTRACTOR SHALL VERIFY WITH OWNER ALL WINDOWS, DOOR, AND ADDITIONAL OPTIONS SUCH AS, COLOR, HARDWARE PRIOR TO ORDERING.

ALL WINDOWS AND DOORS SHALL BE INSTALLED WITH STRICT ACCORDANCE TO THEIR PARTICULAR MANUFACTURERS SPECIFICATIONS AND TO VERIFY WINDOW ROUGH OPENINGS WITH THE MANUFACTURER.

ALL HEADER HEIGHTS TO BE 6'-9" ABOVE THE FINISHED FLOOR, UNLESS NOTED OTHERWISE.

ALL WINDOWS IN HABITABLE SPACES SHALL COMPLY WITH THE RESIDENTIAL CODE OF THE N.Y.S. EGRESS REQUIREMENTS. THESE WINDOWS SHALL HAVE A SILL HEIGHT OF NOT GREATER THAN 4" ABOVE FINISHED FLOOR. THESE WINDOWS SHALL HAVE A MIN. OF 5.7 SQ. FT. CLEAR OPENING AND 10.3 SQ. FT. OF GLASS AREA FOR NATURAL LIGHT.

AT ALL EGRESS BASEMENT WINDOWS THAT ARE BELOW THE FINISHED GRADE SHALL BE PROVIDED WITH AN APPROVED WINDOW WELL AND DRAINAGE AS PER THE N.Y.S. AND LOCAL CODES.

ALL GLAZING LESS THAN 16" ABOVE FINISHED FLOOR/SURFACE, AND ALL GLASS TUB AND/OR SHOWER ENCLOSURES SHALL BE TEMPERED GLASS.

ALL FIXED GLASS SHALL BE IN FRAMES TO MATCH THE MANUFACTURER OF OPERABLE WINDOWS.

ALL WINDOWS SHALL BE MANUFACTURED BY ANDERSEN OR EQUAL UNLESS SHOWN OTHERWISE.

ALL SKYLIGHTS, METAL FLUES, VENTS, STACKS OR ANY OTHER ROOF ACCESSORIES THAT REQUIRE FLASHING SHALL BE INSTALLED AS PER THE MANUFACTURERS SPECIFICATIONS.

PROVIDE ADDITIONAL ALUMINUM BLIND FLASHING WHERE REQUIRED TO INSURE WATER TIGHT CONDITIONS.

INSTALL FLASHING AT ALL ENTRANCE SLABS ADJACENT TO WALL CONSTRUCTION. PROVIDE ADEQUATE AIR SPACE BEHIND BRICK, STONE AND OTHER SIDINGS AS REQUIRED.

ALL BEADS, STOPS AND TRIM SHALL BE MANUFACTURED FROM RUST RESISTANT ALL EXTERIOR SWING DOORS SHALL BE MANUFACTURED BY THERMA-TRU OR EQUAL UNLESS SHOWN OTHERWISE.

ALL WINDOW & DOOR JAMBS TO BE FOAM SEALED & WEATHER STRIPPED ON EXTERIOR AS PER THE 2015 INTERNATIONAL ENERGY CONSERVATION CODE.

DRYWALL NOTES

ALL GYPSUM BOARD DRYWALL CUT JOINTS SHALL BE ADJACENT TO CORNERS. NO BUTT JOINTS IN WALL SHALL BE PERMITTED.

ALL CORNERS AND JOINTS SHALL RECEIVE TWO COATS OF JOINT COMPOUND FEATHERED SMOOTH AND ALL DIMPLES CREATED BY FASTENERS SHALL RECEIVE THREE COATS OF JOINT COMPOUND FEATHERED SMOOTH.

ALL GYPSUM BOARD SHALL BE IN ACCORDANCE WITH THE GYPSUM CONSTRUCTION HANDBOOK, PUBLISHED BY THE UNITED STATES GYPSUM COMPANY.

ALL MATERIALS SHALL BE FURNISHED BY THE UNITED STATES GYPSUM COMPANY, NATIONAL GYPSUM COMPANY, CELOTEX CORP., OR OTHER APPROVED MANUFACTURER.

USE WATERPROOF GYPSUM BOARD AT ALL TUBS, SHOWER SURROUNDS AND OTHER WET LOCATIONS. (DUR-0-ROCK OR EQUAL)

STAIR & RAILING NOTES

ALL STAIRS AND RAILINGS SHALL COMPLY WITH THE 2020 NYS RESIDENTIAL CODE ALL STAIRWAYS SHALL NOT BE LESS THAN 36" IN CLEAR WIDTH AT ALL POINTS ABOVE THE PERMITTED HANDRAIL HEIGHT AND BELOW THE REQUIRED HEADROOM HEIGHT.

HANDRAILS SHALL NOT PROJECT INTO THE STAIRWAY MORE THAN 4" COMBINED CLEAR WIDTH OF 27" ? IF THERE IS TWO HANDRAILS AND 31" THERE IS ONLY ONE HANDRAIL WITH A MINIMUM WALL CLEARANCE OF 1" THE MINIMUM HEADROOM IN ALL PARTS OF STAIRWAYS SHALL NOT BE LESS THAN 6'-8" MEASURED VERTICALLY FROM THE SLOPED PLANE ADJOINING THE TREAD NOSING OR FROM THE FLOOR SURFACE OF THE LANDING OR PLATFORM.

ENCLOSED ACCESSIBLE SPACE UNDER STAIRS SHALL HAVE WALLS, UNDER STAIR SURFACE AND SOFFITS PROTECTED ON THE ENCLOSED SIDE w/1" GYP. BD. THE MAXIMUM RISER HEIGHT IS 8 3/4" THE GREATEST RISER HEIGHT SHALL NOT EXCEED THE SMALLEST BY MORE THAN 3/8".

THE MINIMUM TREAD DEPTH IS 9" ? THE GREATEST TREAD DEPTH SHALL NOT EXCEED THE SMALLEST BY MORE THAN 3/8".

WINDER TREADS ARE PERMITTED PROVIDED THAT THE WIDTH OF THE TREAD AT A POINT IS NOT MORE THAN 12" AND FROM THE NARROW SIDE IS NOT LESS THAN 10". WINDER TREADS SHALL HAVE A MINIMUM TREAD DEPTH OF 6" AT ANY POINT.

THE GREATEST WINDER TREAD DEPTH AT THE 12" WALK LINE SHALL NOT EXCEED THE SMALLEST BY MORE THAN

A NOSING NOT LESS OF 3/4" AND NOT GREATER THAN 1" ON STAIRWAYS WITH SOLID RISERS.

THE GREATEST NOSING PROJECTION SHALL NOT EXCEED THE SMALLEST BY MORE THAN 3/8".

OPEN RISERS ARE PERMITTED, PROVIDED THAT THE OPENING BETWEEN TREADS DOES NOT PERMIT THE PASSAGE OF A 4" DIAMETER SPHERE.

HANDRAIL HEIGHT SHALL BE A MINIMUM OF 34"

OPEN RAILINGS AND GUARDS SHALL NOT BE GREATER THAN 4".

IF DECKS OR PLATFORMS ARE 8'-0" AND GREATER ABOVE THE FINISHED GRADE THAN THE HANDRAIL SHALL BE 42" IN HEIGHT.

TRIM & PAINTING NOTES

ALL CLOSETS SHALL HAVE AS A MINIMUM OF ONE (1) HIGH SHELF AND ONE (1) ROO FOR HANGING CLOTHING. PROVIDE FIVE (5) SHELVES IN LINEN CLOSETS.

THE CONTRACTOR SHALL DOUBLE CHECK AND VERIFY ALL AS BUILT DIMENSIONS AND CONDITIONS PRIOR TO ORDERING CABINETS, COUNTER TOPS AND VANITIES.

ALL EXPOSED BASED CABINET SIDES SHALL HAVE TOE SPACE UNLESS SHOWN OTHERWISE.

ALL PAINTS AND STAINS SHALL BE OF A MANUFACTURER AS SCHEDULED OR AS DIRECTED BY BUILDER.

ALL INTERIOR GYPSUM BOARDS, WALLS AND CEILINGS, SHALL RECEIVE ONE COAT PRIMER AND TWO COATS OF PAINT OF BENJAMIN MOORE OR EQUAL.

ALL INTERIOR WOOD, TRIM, SHELING AND OAK FLOORS SHALL BE FINISHED AS SCHEDULED OR AS DIRECTED BY BUILDER.

ALL INTERIOR DOORS, TRIM AND EXPOSED WOOD SHALL BE SANDED COMPLETELY SMOOTH PRIOR TO APPLYING FINISH.

ALL EXPOSED FERROUS METAL SHALL BE PAINTED WITH A RUST INHIBITOR AND TWO COATS OF ENAMEL.

PUMBING NOTES

ALL PLUMBING WORK EQUIPMENT AND FIXTURES SHALL BE PLACED AND INSTALLED PER THE 2020 PLUMBING CODE OF NEW YORK STATE AND INDUSTRY STANDARDS.

THE CONTRACTOR SHALL VERIFY WITH THE OWNER ALL FIXTURES, MODELS, COLORS ETC. PRIOR OF ORDERING INSTALL.

IRON PIPING UNDER ALL CONCRETE SLABS, GAS LINES TO BE GROUNDED TO BLACK PIPE AT SERVICE ENTRY VENT STACK SHALL EXTEND ABOVE ROOF 18" OF 12" ABOVE AVG SNOWFALL.

THE PLUMBING CONTRACTOR SHALL PROVIDE DRYER VENTS AS PER THE RESIDENTIAL CODE OF N.Y.S.

THE PLUMBING CONTRACTOR SHALL NOT DRILL OR CUT ANY STRUCTURAL ORDERS, HEADERS, BEAMS WITHOUT PRIOR CONSENT FROM THE ARCHITECT.

DRILLING AND CUTTING OF FLOOR JOISTS SHALL BE IN STRICT ACCORDANCE WITH THE CODE AND/OR SAID JOIST MANUFACTURERS SPECIFICATIONS.

THE PLUMBING CONTRACTOR SHALL VERIFY FIXTURE AND PIPE LOCATIONS WITH OTHER TRADES INVOLVED WITH THIS JOB PRIOR TO INSTALLATION.

THE PLUMBING CONTRACTOR SHALL PROVIDE SHOWER PANS UNDER CLOTHES WASHER WITH A DRAIN CONNECTED TO THE WASTE PLUMBING SYSTEM.

THE PLUMBING CONTRACTOR SHALL PROVIDE WHOLE HOUSE BACK-FLOW PREVENTION VALVES AND ADEQUATE CLEAN-OUTS AS REQUIRED BY CODE.

PROVIDE 12"x12" ACCESS PANEL TO WHIRLPOL TUB MOTOR AND SMULAR EQUIPMENT.

THE PLUMBING CONTRACTOR SHALL PROVIDE AND INSTALL EQUIPMENT FLUES AS REQUIRED BY THE RESIDENTIAL CODE OF N.Y.S.

ALL HOSE BIBS SHALL BE FREEZE PROOF TYPE.

LOCATIONS AND QUANTITY SHALL BE AS PER OWNERS INSTRUCTIONS. UNLESS SHOWN OTHERWISE A MINIMUM OF TWO (2) HOSE BIBS SHALL BE PROVIDED; ONE (1) LOCATED AT THE FRONT AND ONE (1) LOCATED AT REAR

MECHANICAL NOTES

ALL MECHANICAL WORK (FURNACE, BOILERS, HVAC, HOT WATER, ETC.) SYSTEMS, AND INSTALLATION SHALL COMPLY IN ACCORDANCE WITH THE 2020 PLUMBING, MECHANICAL, AND FUEL CODES OF NEW YORK STATE AND INDUSTRY STANDARDS.

THE SYSTEMS SHALL BE DESIGNED AND GUARANTEED BY THE MECHANICAL SUBCONTRACTOR TO MEET AND/OR EXCEED THE FOLLOWING REQUIREMENTS: MAINTAIN 70 °F INSIDE WHEN THE OUTSIDE TEMPERATURE IS 100°F AND MAINTAIN 70°F INSIDE WHEN THE OUTSIDE TEMPERATURE IS 0°.

ALL HEATING LINES SHALL CONTAIN ANTIFREEZE.

LOCATE ATTIC MECHANICAL UNITS ON GALVANIZED DRIP PANS, DRAINED. ALL DUCTS SHALL BE FIBERGLASS INSULATED TYPE (EXCEPT GALVANIZED UNDERSLAB DUCTWORK).

THE MECHANICAL SUBCONTRACTOR SHALL SUBMIT SHOP DRAWINGS TO THE BUILDER FOR APPROVAL PRIOR TO ANY EACH SYSTEM SHALL BE SEPARATE AND COMPLETE WITH EACH SYSTEM HAVING SUPPLEMENTAL STRIP HEAT.

CARRIER, TRANE, LENNOX, AND YORK ARE APPROVED MANUFACTURERS FOR THE MECHANICAL UNIT. ANY SUBSTITUTES MUST BE APPROVED IN WRITING BY THE ARCHITECT OR OWNER.

ALL MECHANICAL UNITS IN ATTIC SHALL BE LOCATED IN SUCH MANNER THAT THEY SHALL NOT CAUSE AN OBSTRUCTION TO FUTURE ATTIC FLOORING.

PROVIDE THE PROPER FIRE RATED SEPARATION AT THE MECHANICAL ROOM (FURNACE, HVAC, HOT WATER, ETC. AS PER THE BUILDING CODE PROVIDE BACKDRAFT DAMPER EXHAUST DUCTS TO BE MIN. 0.016 INCHES RIGID METAL, AMX HORIZT. LENGTH NOT TO EXCEED 25 FT. PROVIDE BOOSTER FAN IF GREATERER THAN 25'.

BATHS & LAVS WITHOUT OPERABLE WINDOWS OR DOWNS WITH LESS THAN 1.5 S.F. OPENING SHALL BE MECHANICALLY VENTED TO EXTERIOR.

INTERMITTENT VENTILATION TO BE MIN. 50 CFM, CONTINUOUS VENTING TO BE MIN. 20 CFM.

ELECTRICAL NOTES

ALL OUTLETS, FIXTURES AND ALL OTHER ELECTRICAL WORK SHALL BE PLACED, AND INSTALLED AS PER THE 2018 NFPA LATEST EDITION, THE LATEST EDITION OF THE N.E.C., N.B.F.U., AND THE LOCAL UTILITY CO. ELECTRICAL PANELS SHALL BE FULLY RECESSED AND HAVE ALL CIRCUITS CLEARLY LABELED.

A MINIMUM OF 20 % OF CIRCUITS SHALL BE FOR FUTURE USE FOR EACH PANEL USED.

TELEPHONE AND TELEVISION OUTLETS SHALL BE WIRED TO LOCAL PROVIDERS SPECIFICATIONS TO A POINT OF ENTRY APPROVED BY THE OWNER UNLESS SHOWN ON PLANS OTHERWISE.

THE ELECTRICAL CONTRACTOR SHALL PROVIDE MECHANICAL EXHAUST FANS; FOR ALL RANGES, AND IN ALL LAUNDRY, TOILET, TUB, AND SHOWER AREAS. ALL FAN FIXTURES SHALL BE SWITCHED SEPARATELY AND VENTED TO THE EXTERIOR.

THE ELECTRICAL CONTRACTOR SHALL PROVIDE A SWITCH FOR THE DISHWASHER LOCATED IN SINK CAB.

ALL RECEPTACLES SHOWN ABOVE THE COUNTER SHALL HAVE THE BOTTOM FLUSH WITH TOP OF THE BACK SPLASH.

THE ELECTRICAL CONTRACTOR SHALL NOT DRILL OR CUT ANY STRUCTURAL ORDERS, HEADERS AND BEAMS WITHOUT PRIOR CONSENT FROM THE ARCHITECT.

THE CONTRACTOR SHALL CONSULT AND COORDINATE WITH OTHER TRADES INVOLVED WITH THIS PROJECT PRIOR TO INSTALLATION.

THE ELECTRICAL CONTRACTOR SHALL VERIFY WITH THE OWNER ALL ELECTRICAL DEVICE AND FIXTURE LOCATIONS.

THE ELECTRICAL CONTRACTOR SHALL VERIFY WITH THE OWNER ALL ELECTRICAL DEVICE AND FIXTURE OPTIONS SUCH AS COLOR, AND STYLE PRIOR OF ORDERING.

ALL SMOKE AND CARBON MONOXIDE DETECTORS SHALL BE HARWired AND INTERCONNECTED WITH BATTERY.

PROVIDE ONE SMOKE DETECTORS AS INDICATED ON PLANS AND AS PER ALL CODE REQUIREMENTS AND PROVIDE A MINIMUM OF ONE CARBON MONOXIDE DETECTOR ON EVERY FLOOR.

LOCATE SMOKE DETECTORS ON FLAT CEILINGS NO CLOSER THAN 16" FROM WALL.

ALL OUTLETS TO BE TAMPERPROOF.

ARC-FAULT OUTLETS IN ALL ROOMS EXCEPT KITCHEN AND BATHS. ALL RECESSED LIGHTS TO MEET 10" REQUIREMENTS FOR AIR INFILTRATION

50% OF LAMPS TO BE HIGH EFFICIENCY

OUTDOOR RECEPTACLES MUST BE GFCI PROTECTED AS PER LATEST NEC

RECEPTACLES MUST BE ON A MINIMUM OF 2 BRANCH CIRCUITS AS PER LATEST NEC

BATHROOM GFCI OUTLETS TO BE ON STANDALONE BRANCH CIRCUIT AS PER LATEST NEC

ALL ELECTRICAL WORK TO BE TAMPER RESISTANT

ALL ELECTRICAL WORK TO COMPLY WITH THE NYS AND INTERNATIONAL ELECTRIC CODE

ADDITIONAL NOTES

ALL THERMOSTATS TO BE PROGRAMABLE - DIGITAL AS MFG. BY WHITE ROESERS OR EQUAL.

ALL SUPPLY PIPING AND/OR DUCT WORK TO RECEIVE R-8 INSULATION WHEN IN UNCONDITIONED SPACES


ALL HEATING AND/OR COOLING PUMPS TO BE VARIABLE SPEED OF [HP.

ALL PLUMBING & PIPING TO COMPLY WITH APPLICABLE 2020 PLUMBING CODE OF NYS

FLOOR JOIST SPANS FOR COMMON LUMBER SPECIES (RESIDENTIAL SLEEPING AREAS, LIVE LOAD=30 psf, L/A =360)		DEAD LOAD = 10 psf				DEAD LOAD = 20 psf			
		2x6	2x8	2x10	2x12	2x6	2x8	2x10	2x12
		MAXIMUM FLOOR JOIST SPANS							
JOIST SPACING (inches)	SPECIES AND GRADE	(ft.-in.)	(ft.-in.)	(ft.-in.)	(ft.-in.)	(ft.-in.)	(ft.-in.)	(ft.-in.)	(ft.-in.)
12	DOUGLAS FIR-LARCH	#2 11-10	15-7	19-10	23-4	11-8	14-9	18-0	20-11
	HEM-FIR	#2 11-0	14-6	18-6	22-6	11-0	14-4	17-6	20-4
	SPRUCE-PINE-FIR	#2 11-3	14-11	19-0	23-0	11-3	14-7	17-9	20-7
16	DOUGLAS FIR-LARCH	#1 10-11	14-5	18-5	21-4	10-8	13-6	16-5	19-1
	DOUGLAS FIR-LARCH	#2 10-9	14-2	17-5	20-3	10-1	12-9	15-7	18-1
	HEM-FIR	#1 10-6	13-10	17-8	21-1	10-6	13-4	16-3	18-10
	HEM-FIR	#2 10-0	13-2	16-10	19-8	9-10	12-5	15-2	17-7
	SPRUCE-PINE-FIR	#1 10-3	13-6	17-2	19-11	9-11	12-7	15-5	17-10
	SPRUCE-PINE-FIR	#2 10-3	13-6	17-2	19-11	9-11	12-7	15-5	17-10
19.2	DOUGLAS FIR-LARCH	#2 10-1	13-0	15-11	18-6	9-3	11-8	14-3	16-6
	HEM-FIR	#2 9-5	12-5	15-6	17-1	8-11	11-4	13-10	16-1
	SPRUCE-PINE-FIR	#2 9-8	12-9	15-8	18-3	9-1	11-6	14-1	16-3
24	DOUGLAS FIR-LARCH	#2 9-3	11-8	14-3	16-6	8-3	10-5	12-9	14-9
	HEM-FIR	#2 8-9	11-4	13-10	16-1	8-0	10-2	12-5	14-4
	SPRUCE-PINE-FIR	#2 8-11	11-6	14-1	16-3	8-1	10-3	12-7	14-7

NOTE: CHECK SOURCES FOR AVAILABILITY OF LUMBER IN LENGTHS GREATER THAN 20 FEET.

FLOOR JOIST SPANS FOR COMMON LUMBER SPECIES (RESIDENTIAL LIVING AREAS, LIVE LOAD=40 psf, L/A =360)		DEAD LOAD = 10 psf				DEAD LOAD = 20 psf			
		2x6	2x8	2x10	2x12	2x6	2x8	2x10	2x12
		MAXIMUM FLOOR JOIST SPANS							
JOIST SPACING (inches)	SPECIES AND GRADE	(ft.-in.)	(ft.-in.)	(ft.-in.)	(ft.-in.)	(ft.-in.)	(ft.-in.)	(ft.-in.)	(ft.-in.)
12	DOUGLAS FIR-LARCH	#2 10-9	14-2	18-0	20-11	10-8	13-6	16-5	19-1
	HEM-FIR	#2 10-0	13-2	16-10	20-4	10-0	13-1	16-0	18-6
	SPRUCE-PINE-FIR	#2 10-3	13-6	17-3	20-7	10-3	13-3	16-3	18-10
16	DOUGLAS FIR-LARCH	#1 9-11	13-1	16-5	19-1	9-8	12-4	15-0	17-5
	DOUGLAS FIR-LARCH	#2 9-9	12-9	15-7	18-1	9-3	11-8	14-3	16-6
	HEM-FIR	#1 9-6	12-7	16-0	18-10	9-6	12-2	14-10	17-2

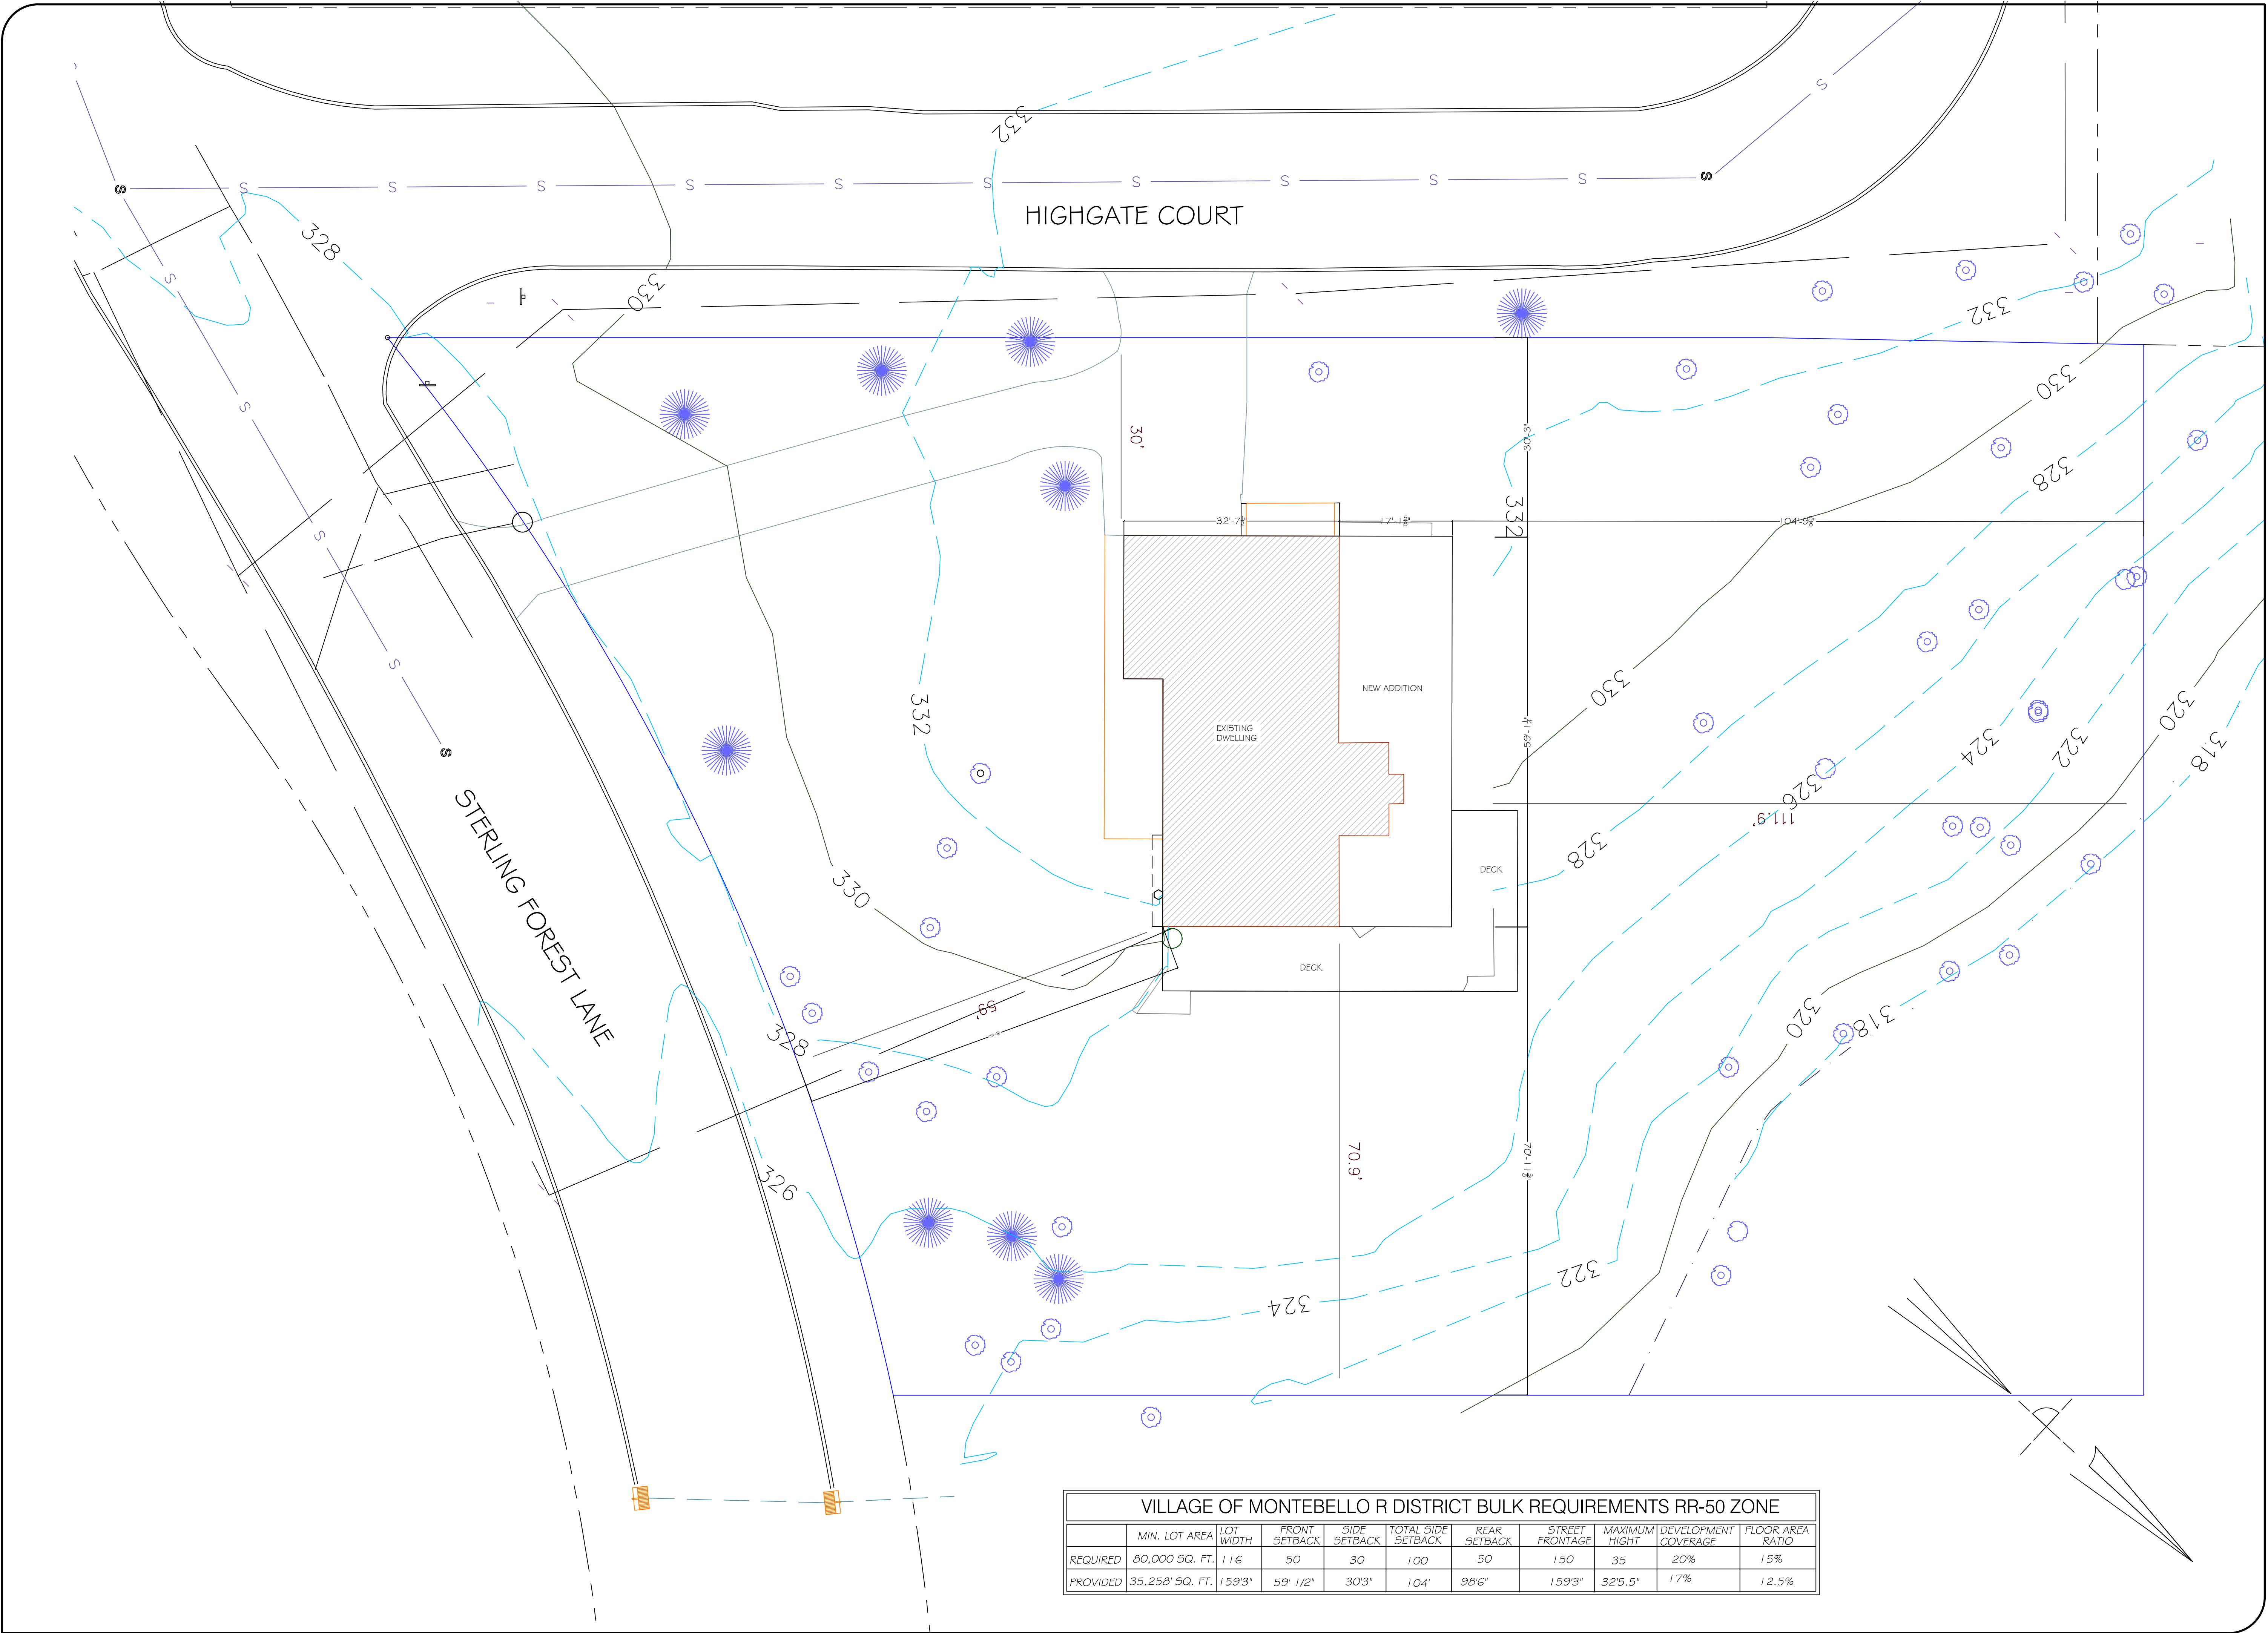

VILLAGE OF MONTEBELLO R DISTRICT BULK REQUIREMENTS RR-50 ZONE										
	MIN. LOT AREA	LOT WIDTH	FRONT SETBACK	SIDE SETBACK	TOTAL SIDE SETBACK	REAR SETBACK	STREET FRONTAGE	MAXIMUM HEIGHT	DEVELOPMENT COVERAGE	FLOOR AREA RATIO
REQUIRED	80,000 SQ. FT.	116	50	30	100	50	150	35	20%	15%
PROVIDED	35,258 SQ. FT.	159'3"	59' 1/2"	30'3"	104'	98'6"	159'3"	32'5.5"	17%	12.5%




MONROE, N.Y. 10950
(845) 492-1783
Email: office@szdrawings.com

PROJECT:

Proposed New Addition For:
17 Sterling Forest Ln.
Montebello
Rockland County, New York

DRAWN BY:	Shlome Glauber
DATE:	7/15/2024
DATE:	8/2/2024
DATE:	8/28/2024
DATE:	1/13/2025
DATE:	10/29/2025

RODGER BRALEY,
ARCHITECTS
NYS LIC. NO. 013-832
50 PLATT'S HILL ROAD
NEWTOWN, CT 06470
T: 203.426.9918
Email: rbraley2@sbeglobal.net

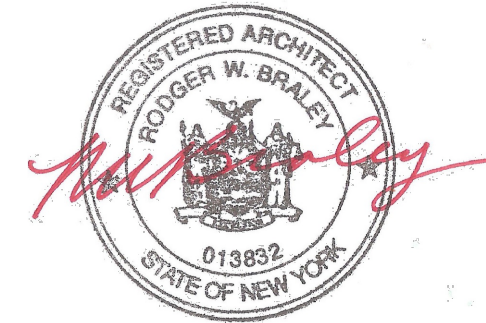

DESCRIPTION:

PLOT -01

SCALE AS NOTED